

**INSTALLATION INSTRUCTIONS FOR 5" MERV 11 AND 16 FILTER RACKS
 (47W71, 47W72, 47W73) USED WITH T-CLASS TAA SERIES AIR HANDLERS**

Description

This kit is used to convert the T-Class TAA Series Air Handlers for use with 5" MERV 11 and 16 filters.

⚠ WARNING

Risk of property damage, injury, or death.
 Installation, adjustments, alterations, service and maintenance must be performed by a licensed professional service technician (or equivalent).

Installation

1. Turn OFF power to the unit.
2. Remove the filter access panel from both ends of the unit.
3. Remove the 2" filters.
4. Remove screw from each end of each 2" filter rack (upper and lower). Remove the filter racks.

NOTE - Table 1 shows catalog numbers for the appropriate filter racks and filters.

5. Install 5" filter racks (upper and lower) and fasten with screws removed above.
6. Install 5" filters (sold separately) in the filter rack.

7. Install filter access panels.
8. Turn power to unit back ON.

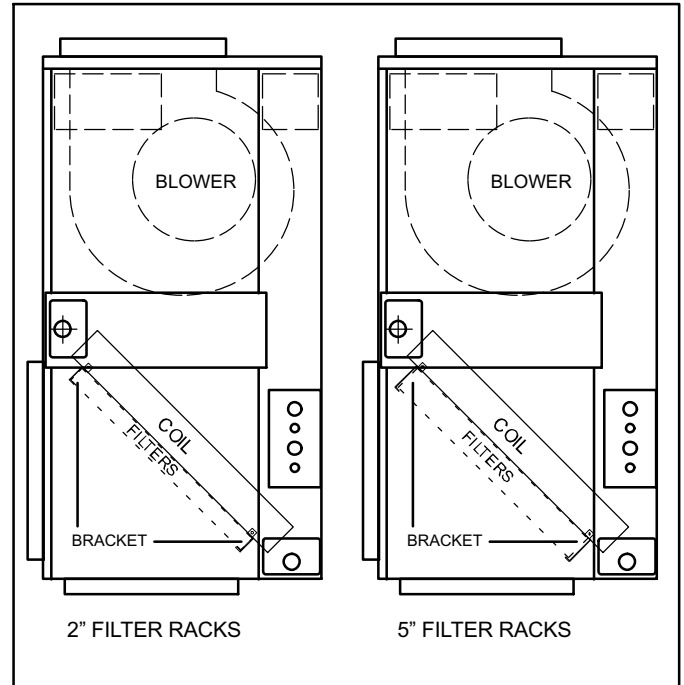


Figure 1. Installing 5" Filter Racks

Table 1. Filter and Filter Rack Catalog Numbers

Item	TAA072 / TAA090	TAA120 / TAA150	TAA180 / TAA240
5" Filter Rack Kit	47W71 (1 per unit)	47W72 (1 per unit)	47W73 (1 per unit)
16"x25"x5" MERV 11 filter	X6670 (3 per unit)	X6670 (4 per unit)	X6670 (6 per unit)
16"x25"x5" MERV 16 filter	X6672 (3 per unit)	X6672 (4 per unit)	X6672 (6 per unit)