

PACKAGED UNITS KITS AND ACCESSORIES

506427-01
2/2017
Supersedes 9/2009

VFD REPLACEMENT KIT

INSTALLATION INSTRUCTIONS FOR VARIABLE FREQUENCY DRIVE (VFD) REPLACEMENT KITS USED WITH SGA/SCA/LGH/LCH420, 480, 540, & 600 UNITS

⚠ WARNING

Improper installation, adjustment, alteration, service or maintenance can cause property damage, personal injury or loss of life. Installation and service must be performed by a licensed professional HVAC installer or equivalent, service agency, or the gas supplier

⚠ WARNING

ELECTRICAL SHOCK HAZARD.

Failure to follow instructions exactly could result in serious injury or death.

VFD HOLDS A POTENTIALLY LETHAL CHARGE UP TO 10 MINUTES AFTER POWER HAS BEEN DISCONNECTED. Do not open VFD cover until 10 minutes AFTER power source has been disconnected and power lamp has turned off.

Read manual provided by VFD manufacturer. Carefully review and follow all safety warnings in that manual also.

Shipping and Packing List

Package 1 of 1 contains:

- 1- Pre-programmed VFD (A96)

Application

604971-01 to -10 kits are used to replace the variable frequency drive (VFD) on SGA/SCA/LGH/LCH420, 480, 540, & 600 units. See table 1 for usage.

⚠ CAUTION

As with any mechanical equipment, contact with sharp sheet metal edges can result in personal injury. Take care while handling this equipment and wear gloves and protective clothing.

TABLE 1

Voltage	Kit Number	Catalog Number	HP Rating
230	604971-01	58W91	15HP
230	604971-02	58W92	20HP
460	604971-03	58W93	15HP
460	604971-04	58W94	20HP

Installation

- 1- Disconnect all power to unit and **WAIT AT LEAST 10 MINUTES** before opening the VFD cover.

⚠ WARNING

ELECTRICAL SHOCK HAZARD.

STOP! Before you continue, make sure that power to the VFD has been off for at least 10 minutes. The capacitor in the VFD holds high voltage power for up to 10 minutes after power has been disconnected.


- 2- Open the lower cover on the VFD to access wire connections. Disconnect the wires from the terminals, making special note of the wire color and identification stamping on the wire that was connected to each terminal.
- 3- *Mitsubishi VFD* -
Remove the top two screws and loosen the lower two screws securing the VFD to the mounting bracket. Remove the VFD from the controls compartment.
Toshiba VFD -
It may be necessary to remove all of the screws securing the VFD to the mounting plate. Remove the VFD from the controls compartment.
- 4- Slide keyholes on replacement VFD over lower securing screws. Reinsert and tighten two upper screws, then tighten lower screws. When replacing a Toshiba inverter, see the Toshiba VFD Replacement section.

⚠ WARNING

Power wiring must be connected properly. Improperly connected power wiring may result in damage to the VFD.



- 5- Carefully connect existing wires to the replacement VFD as illustrated in figure 1. On units without harnesses, take care to properly connect the power wiring going into and out of the VFD. When replacing a Toshiba VFD, see Toshiba Replacement section.

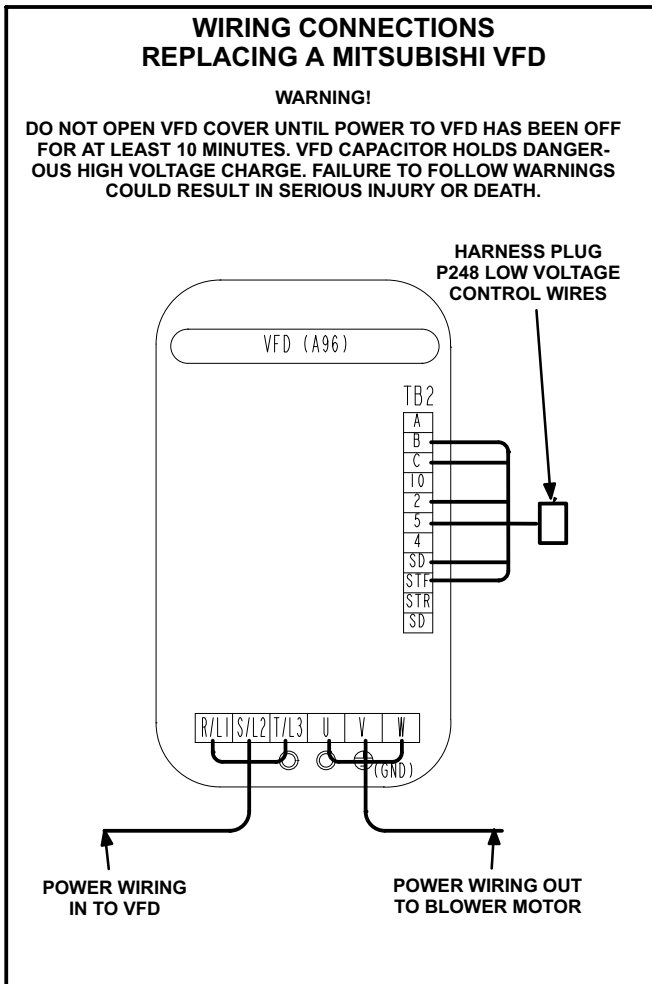

- 6- Close access panel and restore power to the unit.

Verify Proper Operation


If the blower is not rotating in the proper direction:

- 1- Disconnect all power to the unit and open the compressor / controls compartment access panel.
- 2- Reverse any two power wires going from the VFD to the blower motor.
- 3- Check all field wiring to the VFD. No wires should be connected to TB2-STR.
- 4- Check to ensure that wiring connections are secure.
- 5- Close access panel and restore power to unit.

Verify proper operation of VFD:

Refer to MSAV unit start-up instructions in unit installation instructions.

Note - Operate unit in the heating mode or mode which operates at the highest blower speed. Measure amp draw to the blower between the VFD and blower motor. Verify that the amperage does not exceed the FLA value listed on the motor nameplate.

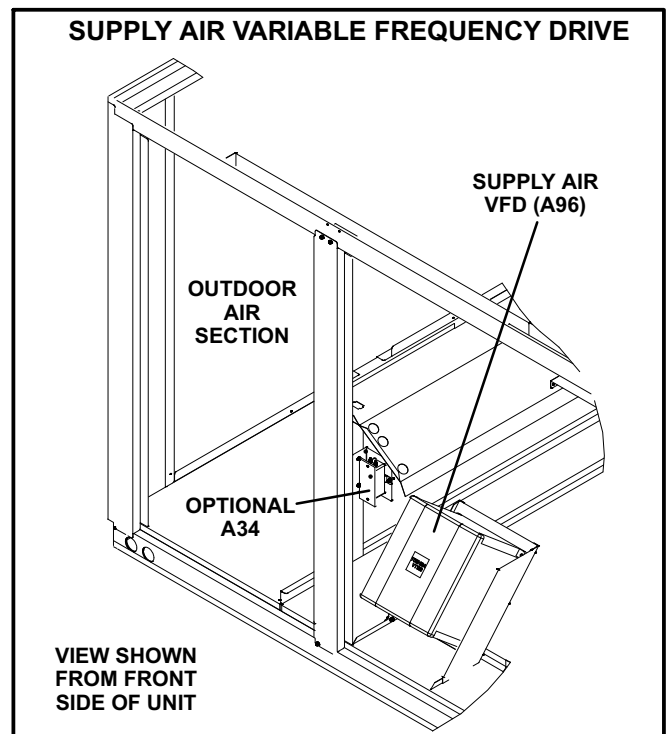

POWER EXHAUST VARIABLE FREQUENCY DRIVE

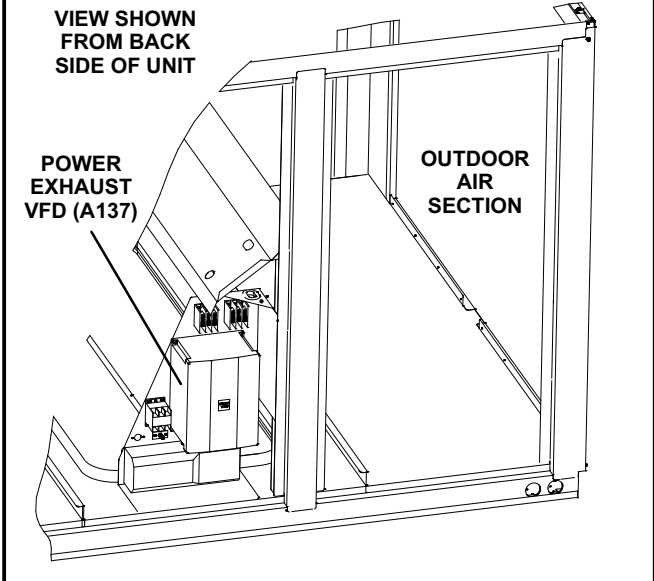


FIGURE 3

Toshiba VFD Replacement

A Mitsubishi VFD is provided in this kit. Use the following additional steps when a Toshiba VFD is being replaced

INSTALLATION

New holes must be drilled in the mounting plate when replacing a Toshiba VFD.

- 1- Use the replacement VFD as a template to mark the location of two upper holes and two lower slots.
- 2- Drill holes where marked and secure VFD to mounting plate with field-provided screws.

WIRING

The Toshiba VFD has different low voltage terminal designations compared to a Mitsubishi VFD.

- 1- Make low voltage wiring connections using table 2 as a cross reference. See figure 4 through 8.
- 2- Connect a field-provided wire between VFD terminal 5 and the unit chassis (any convenient point that is at ground potential).
- 3- Make power wiring connections as shown in figures 4 through 8.

TABLE 2

Toshiba Wire Stamp	Mitsubishi Terminal Designation
F	STF
V1/V1A	2
CC	SD
FLA	B or B1
FLC	C or C1
---	5

**WIRING CONNECTIONS - REPLACING A TOSHIBA VFD
Y VOLT UNITS WITH 15 & 20 HP BLOWER MOTORS**

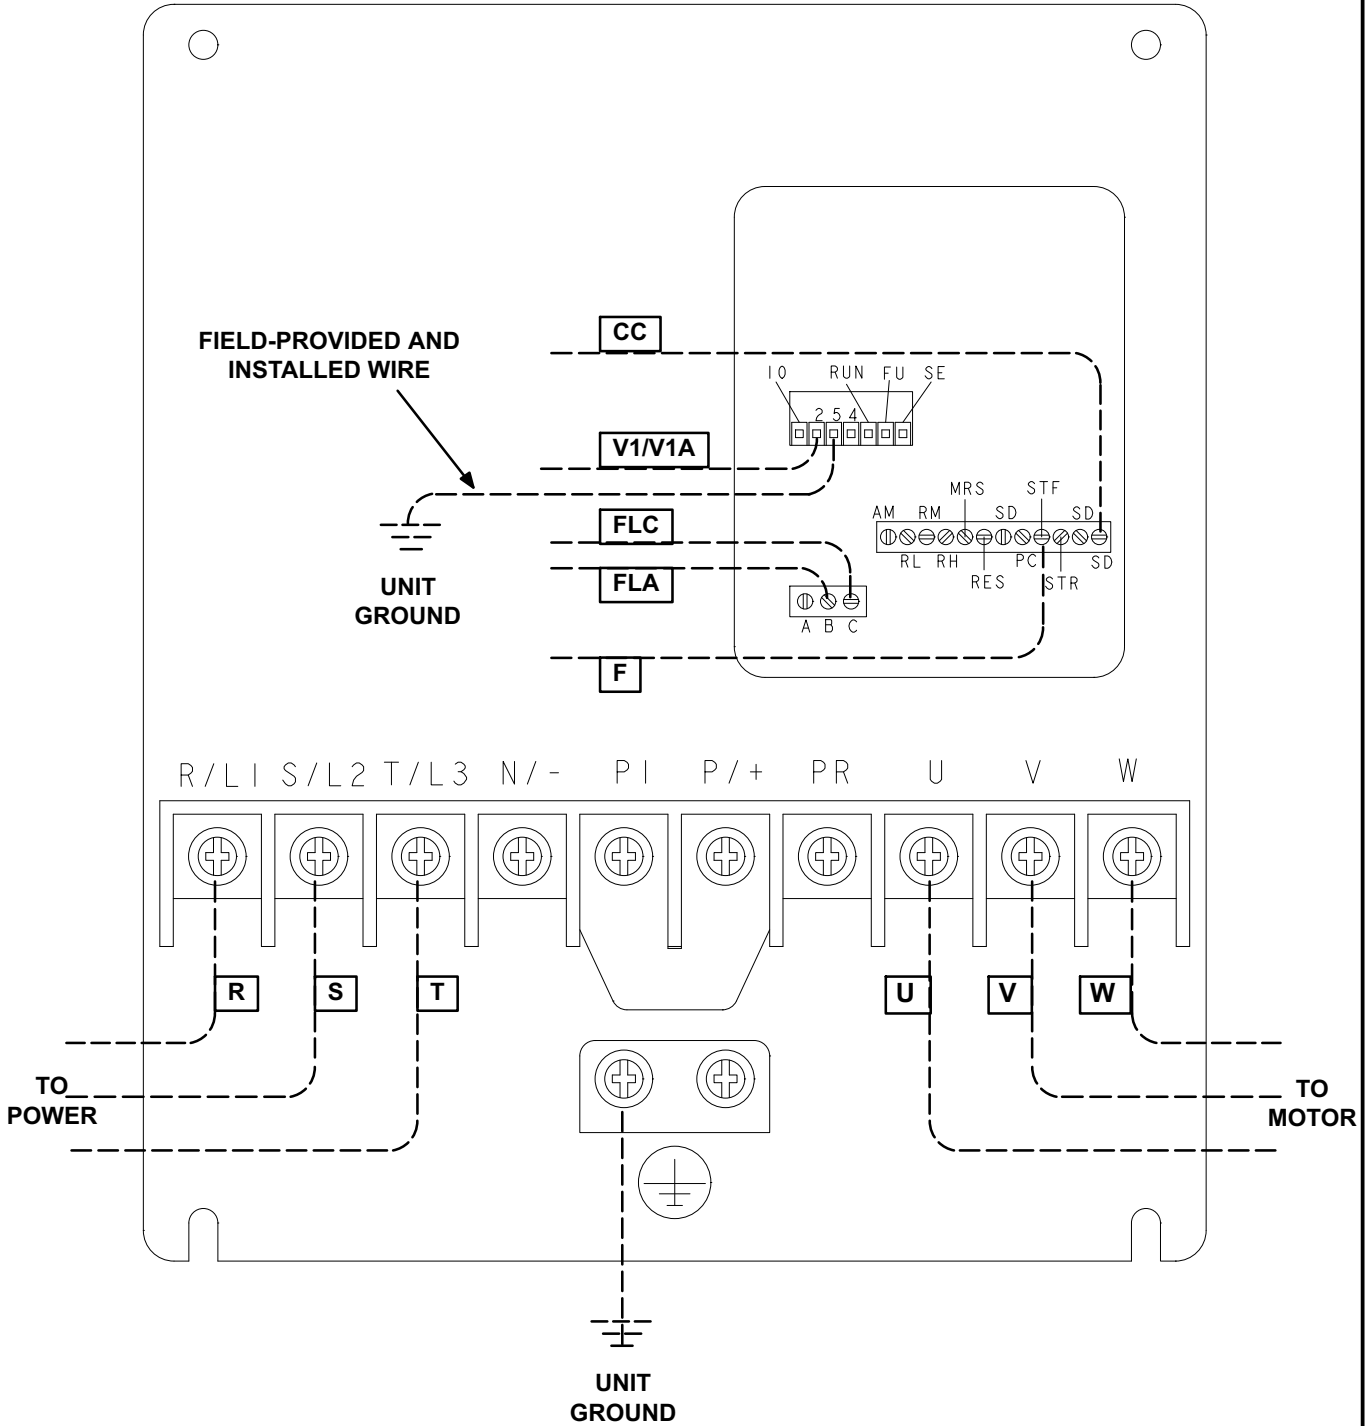


FIGURE 4

**WIRING CONNECTIONS - REPLACING A TOSHIBA VFD
G VOLT UNITS WITH 15 & 20 HP BLOWER MOTORS**

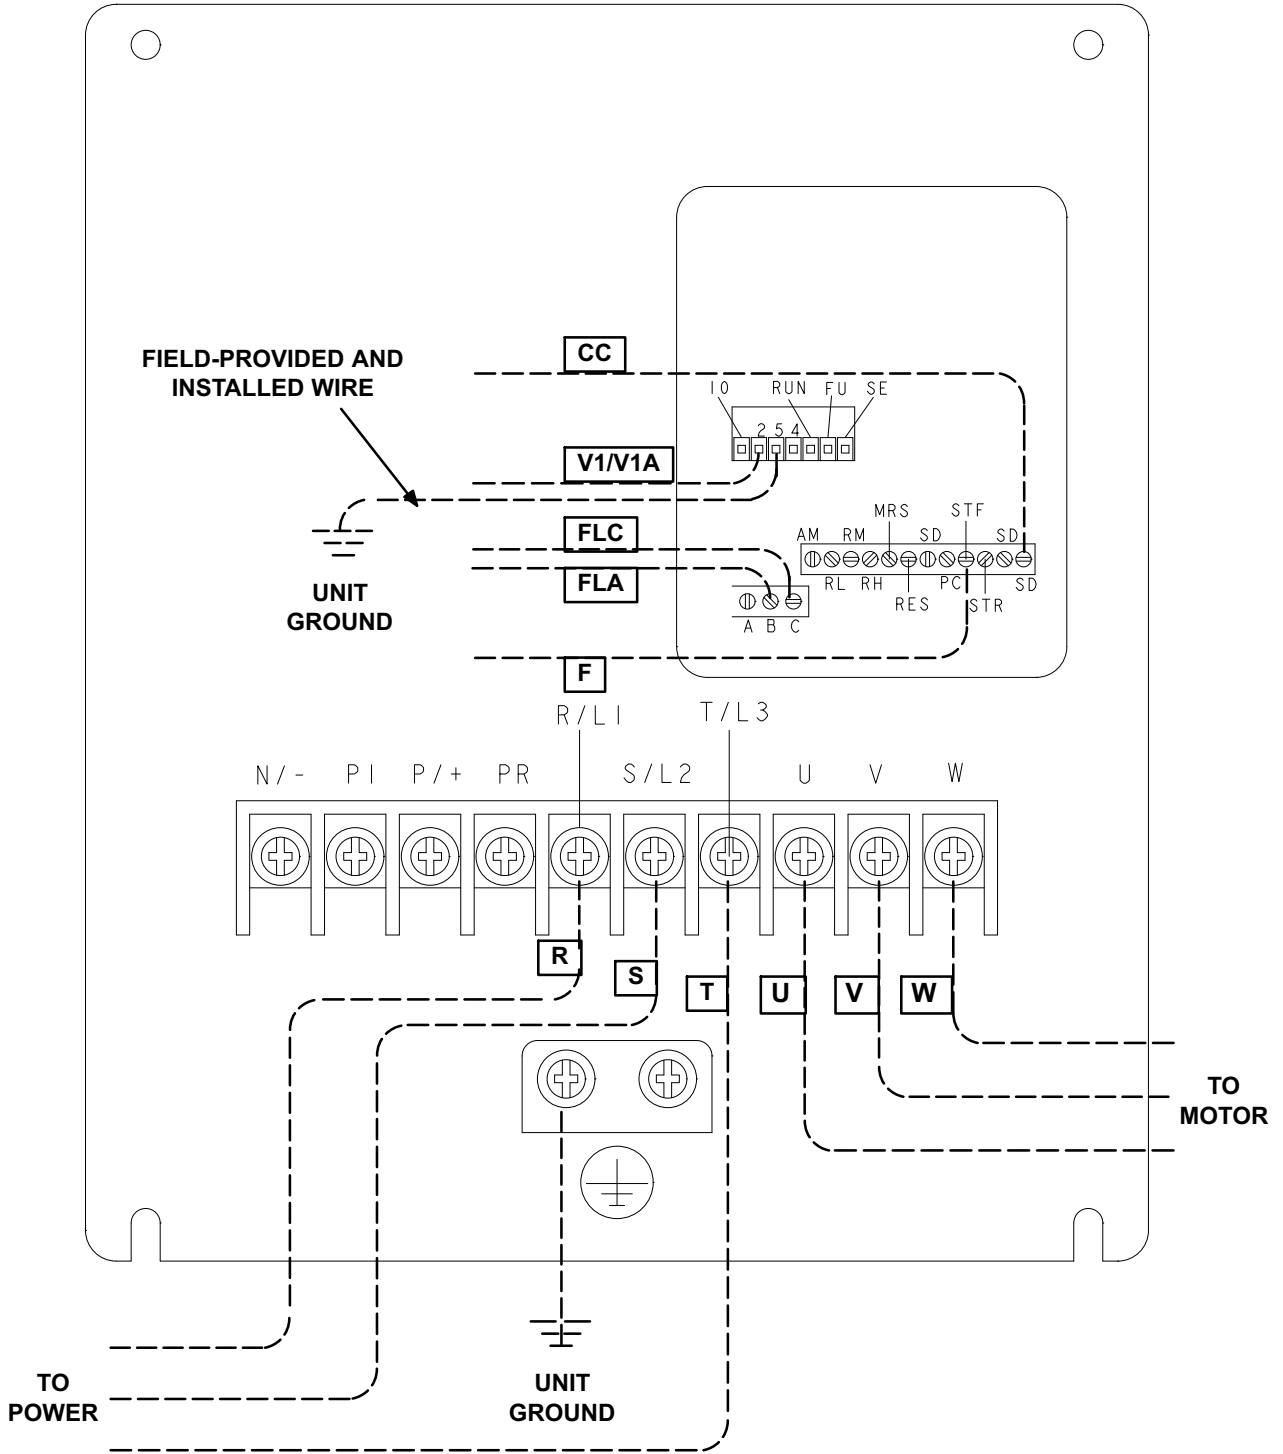


FIGURE 5

**WIRING CONNECTIONS - REPLACING A TOSHIBA VFD
Y VOLT UNITS WITH 25 & 30 HP BLOWER MOTORS AND
G VOLT UNITS WITH 30 HP BLOWER MOTORS**

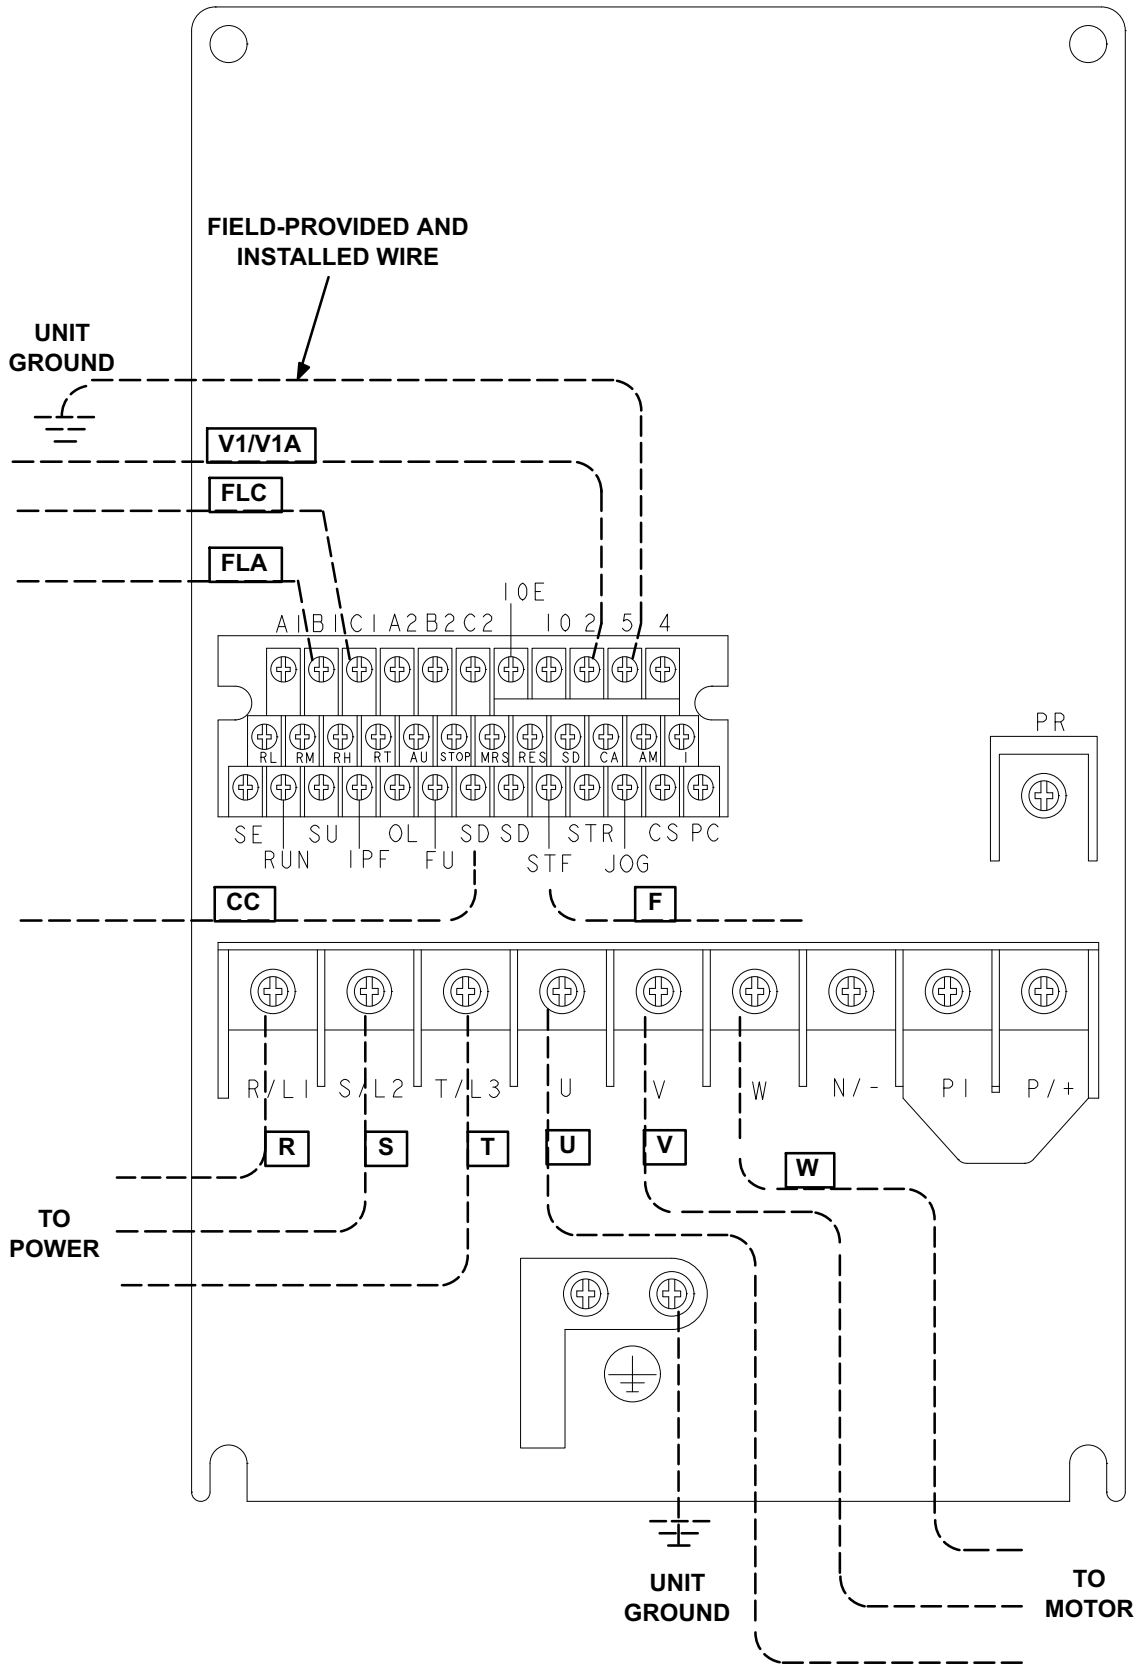


FIGURE 6

**WIRING CONNECTIONS - REPLACING A TOSHIBA VFD
G VOLT UNITS WITH 25 HP BLOWER MOTORS AND
J VOLT UNITS WITH 20 - 30 HP BLOWER MOTORS**

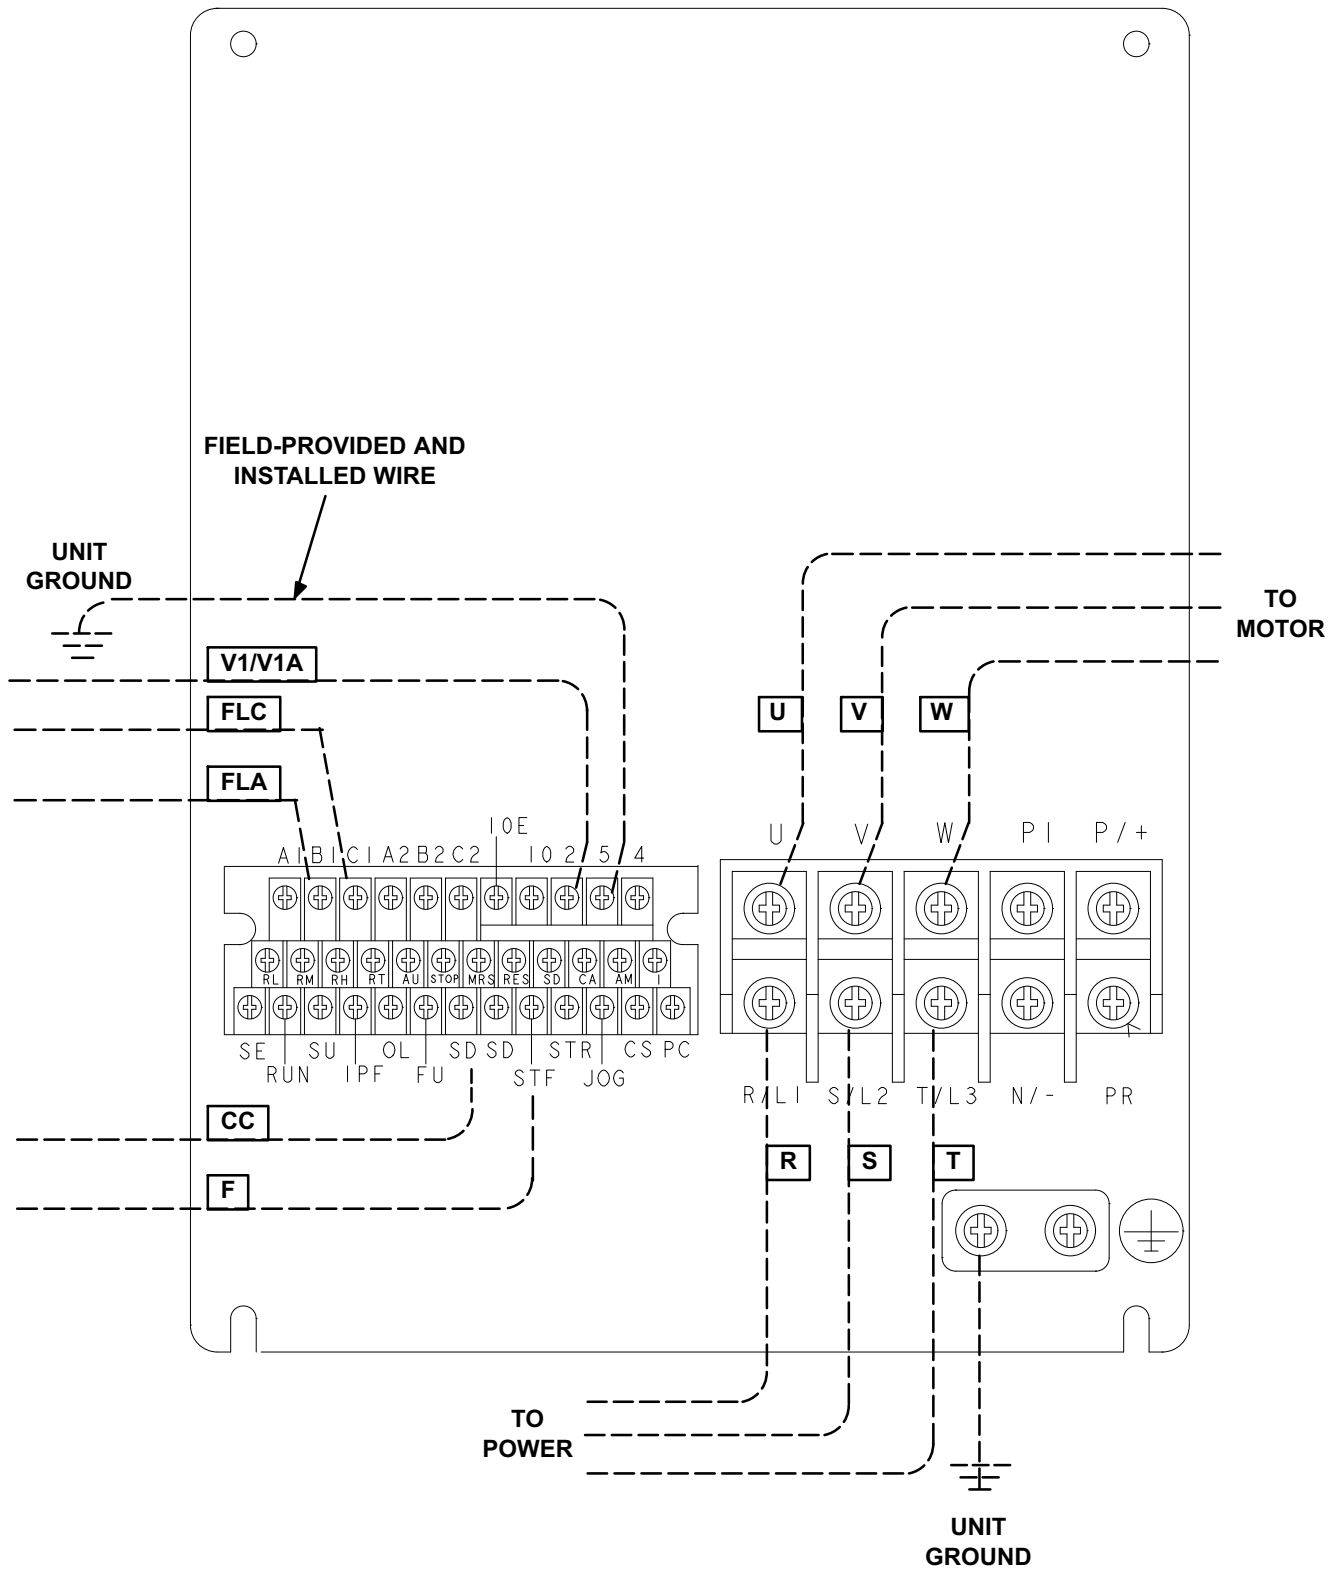


FIGURE 7

**WIRING CONNECTIONS - REPLACING A TOSHIBA VFD
J VOLT UNITS WITH 15 HP BLOWER MOTORS**

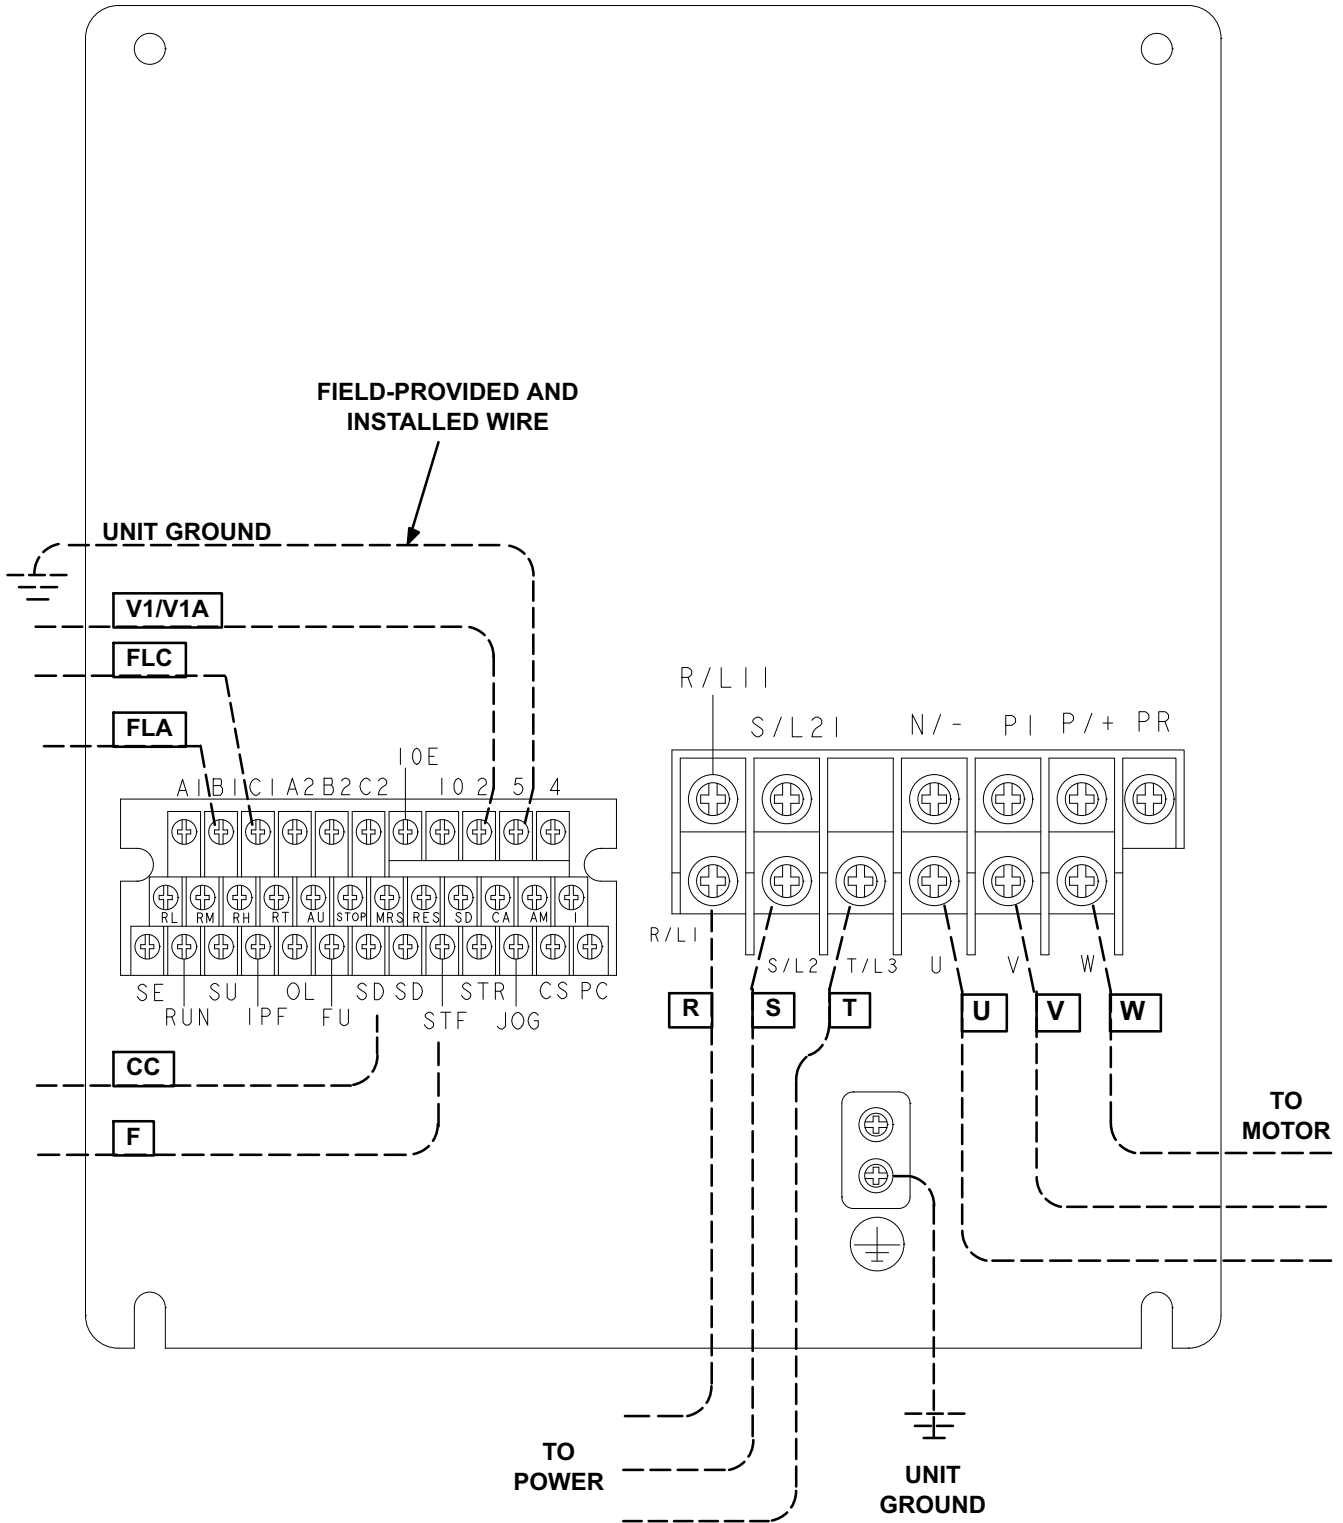


FIGURE 8