




SERVICE AND APPLICATION NOTES

VRF Outdoor Unit Placement

Issue: Connective piping between manifolded VRF outdoor units must follow strict guidelines to ensure proper performance.

Solution: Adhere to these piping requirements when connecting manifolded units:

- Minimum required space between units - 4 in. (102 mm)
- Maximum allowed space between units is limited by piping guidelines. Do not exceed 13 ft. (4 m) for any connective pipe run.
- All outdoor units must be on the same level (elevation).

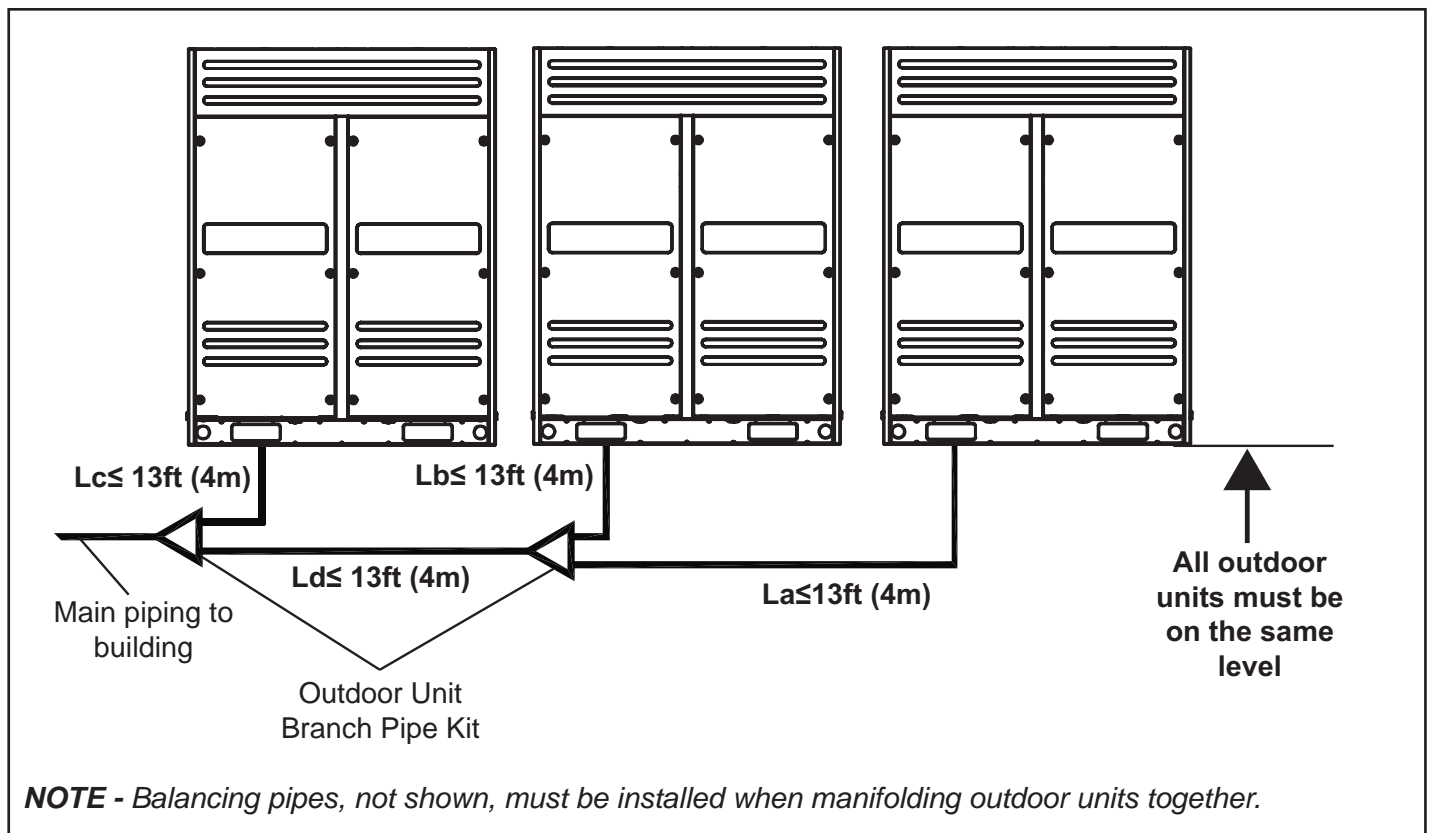

All Connective Piping Runs Must be 13 Feet or Shorter