



**ENERGY RECOVERY SYSTEM
FOR LANDMARK® ROOFTOP UNITS - 60 HZ**


PRODUCT SPECIFICATIONS

Bulletin No. 210534
May 2017
Supersedes January 2011




300 to 6200 cfm Capacity

MODEL NUMBER IDENTIFICATION

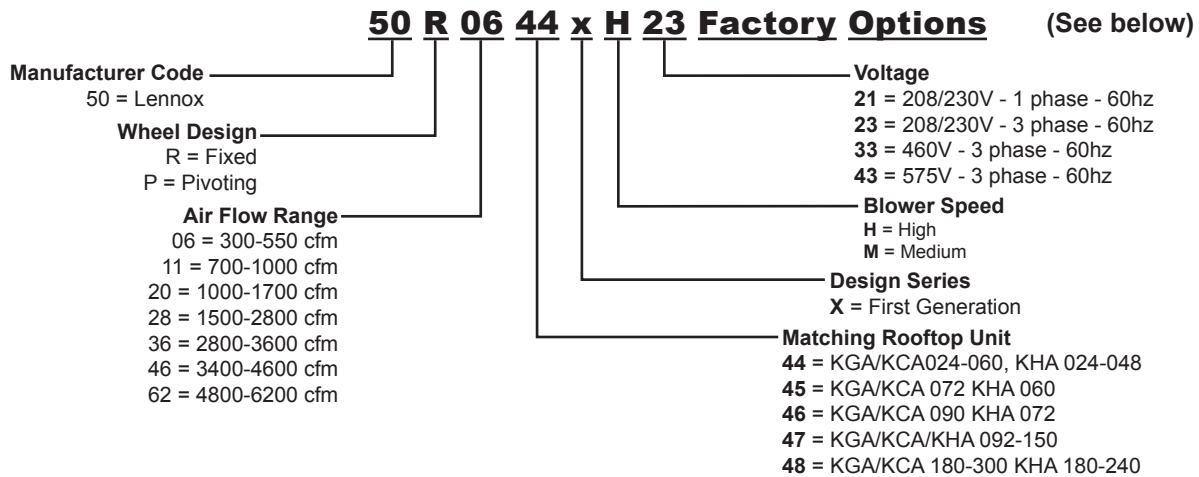

Factory Option Codes

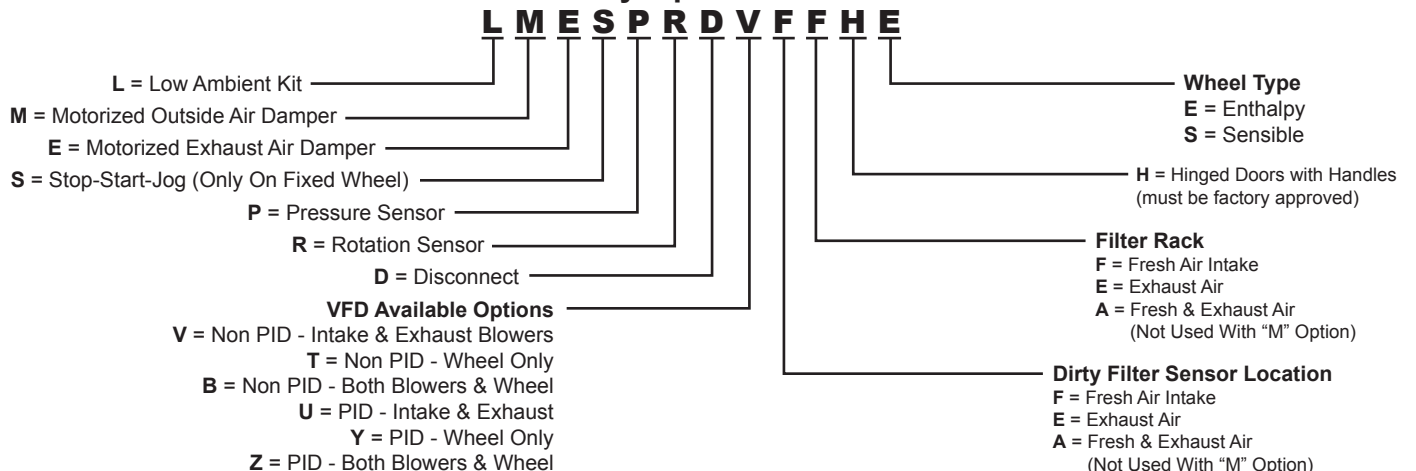

Notes:

x = Factory Option Not Selected e.g. 50R0644xH23LxESxR

ERS is a Fixed wheel with 300-550 CFM for the KGA/KCA/KHA 036-060 Unit with a Low Ambient Kit, Motorized Exhaust Air Damper, Stop-Start Jog, Rotation Sensor, Disconnect, VFD - Non PID, Dirty Filter Sensor in Exhaust Air and an Enthalpy Wheel.

FEATURES

CONTENTS

Dimensions	12
Electrical Data	11
Features.....	2
Guide Specifications	15
Model Number Identification	1
Optional Accessories	4
Specifications.....	5
Unit Clearances	13

APPROVALS

Rated in accordance with AHRI standard 1060-2005. To obtain a copy of the Standard or to view Lennox' latest certified data, please visit the AHRI web site at <http://www.ahrinet.org/>.

ETL Certified per UL 1995 and CSA/CAN C22.2 No. 236.

WARRANTY

Recovery Wheel - limited warranty for five years.

All other covered components - one year limited warranty.

APPLICATIONS

The Lennox Energy Recovery System (ERS) is a constant volume, energy recovery ventilator that is directly coupled with Lennox Landmark™ rooftop units. Its primary function is to increase overall HVAC system efficiency and to reduce long-term energy costs.

This is accomplished by capturing both sensible and latent energy from either the exhaust or intake air stream and transferring it to the other, resulting in reduced cooling loads at design temperatures up to four tons per 1000 cfm of outside air and reduced heating loads up to 12,000 Btuh per 400 cfm of outside air.

The recovery wheel provides sensible and latent energy exchange between the entering and exhaust air streams of a building allowing a substantial amount of the energy, which is normally lost in the exhaust air stream, to be returned into the entering air.

Each unit factory test operated to ensure proper operation.

OPERATION

The enthalpy wheel contains parallel layers of a polymeric material that is physically imbedded with a silica gel (desiccant).

The wheel is located in the intake and exhaust air streams of the ventilation equipment.

As the wheel rotates through each air stream, the wheel surface captures sensible and latent energy.

In the heating mode, the wheel rotates to provide a constant transfer of heat from the exhaust air stream to the colder intake air stream. During the cooling season, the process is reversed.

When used in conjunction with a rooftop unit equipped with an economizer, on pivoting models, the wheel pivots out of the air stream to allow the economizer to operate normally for "free cooling" when outdoor temperature and humidity is acceptable.

By pivoting the wheel out of the air stream, the system can utilize 100% of the rooftop unit's blower capabilities.

During economizer operation, the exhaust blower continues to run, providing power exhaust for the system. The intake blower is de-energized during economizer operation.

ERS SELECTION

Step One - Determine the air conditioning load requirements using the required amount of outside air without an ERS.

Step Two - Select the proper ERS for the outside air requirements and calculate the tonnage reduction.

Select the rooftop unit required by reducing the load determined in step one by the reduction in step two. (Example: If the load in Step 1 was 10 tons, and the reduction in Step 2 was 2.5 tons, select a 7.5 ton unit).

Select the proper ERS based on the selected unit.

NOTE - The height of the roof top unit curb MUST correspond with the required curb height needed for the ERS. See Specifications Table.

SYSTEM FEATURES

Low-voltage logic board used to control frost protection and motorized outside air damper.

Low-voltage terminal strip.

Barometric relief dampers provided standard on all ERS units.

Balancing dampers provided standard on all fixed wheel ERS units.

Metal-mesh, mist-eliminator-type filters provided in intake air hood.

Separate, fused power supply.

Continuous operation down to 10°F without defrost at indoor relative humidity up to 40%. For temperatures below 10°F an optional, factory installed Low Ambient Control Kit is required.

FEATURES

RECOVERY WHEEL

AirXchange Enthalpy Wheels. Capable of both sensible and latent heat recovery. Dry energy transfer. Moisture in supply air stream is transferred to exhaust air stream in vapor state, eliminating condensate plumbing in the ventilator.

Constructed of lightweight polymer material and coated with a desiccant silica gel that will not dissolve or liquefy in the presence of water or high humidity.

Wheels 25 in. and larger in diameter are segmented for easy removal. Wheels less than 25 in. in diameter are removed from cabinet in a slide-out cassette.

Patented, pivoting-wheel option allows unit to operate in true economizer mode when the outside temperature is suitable for cooling. Pivoting the wheel out of the air stream during economizer mode allows efficiencies to be maximized by reducing demand on the supply fan motor.

BLOWERS

Centrifugal, forward curved blowers provided for high-static capability and low sound levels.

Belt-drive blowers have permanently lubricated ball bearings, overload protection, and adjustable sheaves for blower speed adjustment.

CABINET

Fully insulated with non-hygroscopic fiberglass insulation. Constructed of galvanized steel and finished with electrostatically bonded powdered enamel coating to withstand 1000 hour salt-spray test per ASTM B117.

Attaches directly to the rooftop unit. All mounting hardware is provided.

Adjustable support legs are provided.

OPTIONS / ACCESSORIES

FACTORY INSTALLED

Low Ambient Control Kit

Prevents frost formation on energy wheel heat transfer surfaces by terminating the intake blower operation when discharge air temperature falls below a field-selectable temperature setting.

Intake blower operation resumes after temperature rises above the adjustable temperature differential. Kit includes temperature sensor.

Motorized Outside Air Damper

Damper mounts behind the outside air intake hood. Damper opens when the ERS is energized and closes when de-energized.

Motorized Exhaust Air Damper

Damper mounts in the barometric relief hood. Damper opens when the ERS is energized and closes when de-energized.

Stop-Start-Jog (Fixed Models Only)

Control option that allows intermittent operation of the enthalpy wheel during mild outdoor conditions to provide cycling and cleaning of the wheel.

Pressure Sensor

Measures the amount of outside airflow across the enthalpy wheel.

Rotation Sensor

Verifies the rotation of the enthalpy wheel.

Disconnect

Optional field device used to provide easy ability to switching the power on and off to the ERS. Must be field wired.

VFD Blower Control

Variable frequency drives are available to control the speed of the blowers only. These VFD's can be integrated with a building automation system to deliver precisely the amount of air needed to maximize efficiencies.

Dirty Filter Sensor

The dirty filter sensor sends a signal to field wired alarm when filters need to be cleaned or changed.

Filter Rack

Filter racks filter air in both the intake and exhaust sections of ERS.

Hinged Door with Handles

Hinged panel access doors with quarter turn latches that allow for easy access to the energy recovery wheel, filters and blowers.

Energy Recovery Wheel - Sensible Type

Sensible Wheel type is used for sensible heat recovery.

FIELD INSTALLED

ERS Support

8 inch high base for support of the exhaust and intake end of the ERS.

Available in 48, 60, 76 inch lengths.

See Page 4 for model numbers.

ERS Roof Curb

Used to support RTU and raise them to the correct height for mounting.

See Page 4 for model numbers.

GFI Service Outlet

Optional field powered service outlet provides power for service equipment. Must be field installed and wired.

See Page 4 for model numbers.

NOTE - Contact your local Lennox Commercial Sales Representative for ordering information.

OPTIONAL ACCESSORIES - MUST BE ORDERED EXTRA

Model No.	Fixed Wheel	50R0644xH	50R1146xH	50R2047xM	50R2848xM	50R3647xH	50R3648xH	50R4648xH	50R6248xM 50R6248xH
		50R0645xH	50R2046xH	50R2847xM	50R2848xH				
		50R1144xH		50R2847xH					
		50R1145xH							
		50R2045xH							
	Pivot Wheel	50P1144xH	50P1146xH	50P2047xM	50P2848xM	50P3647xH	50P3648xH	50P4648xH	50P6248xM 50P6248xH
		50P1145xH	50P2046xH	50P2847xM	50P2848xH				
		50P2045xH		50P2847xH					
Dirty Filter Sensor		O	O	O	O	O	O	O	O
² Disconnect		O	O	O	O	O	O	O	O
Energy Recovery Wheel - Sensible		O	O	O	O	O	O	O	O
Filter Rack		O	O	O	O	O	O	O	O
² GFI Service Outlet		X	X	X	X	X	X	X	X
Hinged Door With Handles		O	O	O	O	O	O	O	O
Low Ambient Kit		O	O	O	O	O	O	O	O
Motorized Exhaust Air Damper Kit		O	O	O	O	O	O	O	O
Motorized Outdoor Air Damper Kit		O	O	O	O	O	O	O	O
Pressure Sensor Kit		O	O	O	O	O	O	O	O
¹ Stop-Start-Jog Kit		O	O	O	O	O	O	O	O
ERS Roof	502014414	X							
Curb	502014614		X						
	502014714			X					
	502014724					X			
	502013214				X				
	502013224						X	X	X
ERS	012104808	X	X						
Equipment Support	012106008			X	X	X	X		
	012107608							X	X
Rotation Sensor		O	O	O	O	O	O	O	O
VFD		O	O	O	O	O	O	O	O

O - Configure to Order (Factory Installed)

X - Field Installed.

¹ Available on Fixed Wheel models only.

² Must be Field Wired

SPECIFICATIONS - FOR 2 TO 5 TON LANDMARK MODELS

General Data		Model Number Fixed Wheel		² 50R0644xH			50R1144xH			
		Model Number Pivoting Wheel		---			50P1144xH			
		Nominal Air Volume - cfm		300-550			700-1000			
		Matching Units		KCA/KGA 024 through 060, KHA024 through 048 models						
Required Height of Rooftop Unit Curb - in.				14			14			
Fresh Air Blower			Motor - hp	0.2			1/2			
			Wheel Size (diameter x width) - in	6-1/4 x 6-1/2			10 x 6			
			Motor Speed - rpm	1780			1120			
			Motor Speed(s)	2			3			
			Bearing Type	Sleeve			Sleeve			
Exhaust Air Blower			Motor Type	PSC			PSC			
	Motor - hp	Fixed Wheel		1/4			1/2			
		Pivoting Wheel		---			1/2			
			Wheel Size (diameter x width) - in	6-1/4 x 6-1/2			10 x 6			
			Motor Speed - rpm	1780			1120			
			Motor Speed(s)	2			3			
			Bearing Type	Sleeve			Sleeve			
Recovery Wheel	Wheel Depth x Diameter - in		2 x 19-1/4			3 x 25-1/4				
	Motor Speed - rpm		1050			1050				
Electrical Data - Line Voltage - 60hz				² 208/230V-1ph, 208/230V-3ph, 460V-3ph, and 575V-3ph			208/230V-3ph, 460V-3ph, and 575V-3ph			
Enthalpy Wheel Airflow Data			Nominal Airflow	500 cfm at 0.6 in. w.c.			900 cfm at 1 in. w.c.			
	EATR - Exhaust Air Transfer Ratio	at minus 1 in. w. c.		9.90%			9.30%			
		at 0 in. w.c.		0.20%			0.70%			
		at 1 in. w.c.		0.00%			0.00%			
	OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.		1.02%			0.97%			
		at 0 in. w.c.		1.33%			1.19%			
		at 1 in. w.c.		1.59%			1.34%			
¹ Thermal Ratings at 0 in. w.c. Pressure Differential	Total Effectiveness	100% Airflow Heating	Sensible	68%	60%	65%	Sensible	76%	68%	73%
			Latent	73%	65%	70%	81%	73%	78%	
		100% Airflow Cooling	Sensible	68%	60%	64%	76%	68%	72%	
			Latent	73%	65%	69%	81%	73%	76%	
	Net Effectiveness	100% Airflow Heating	Sensible	68%	60%	65%	76%	68%	73%	
			Latent	73%	65%	70%	81%	73%	78%	
		100% Airflow Cooling	Sensible	68%	60%	64%	76%	68%	72%	
			Latent	73%	65%	69%	81%	73%	76%	
³ Weights	Fixed	Shipping Weight - lbs.		476			475			
		Net Weight - lbs.		455			458			
	Pivoting	Shipping Weight - lbs.		---			480			
		Net Weight - lbs.		---			463			

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS - FOR 5 TO 6 TON LANDMARK MODELS

General Data		Model Number Fixed Wheel	² 50R0645xH			50R1145xH			50R2045xH		
		Model Number Pivoting Wheel	---			50P1145xH			50P2045xH		
		Nominal Air Volume - cfm	300-550			700-1000			1000-1700		
		Matching Units	KCA/KGA072, KHA060 models								
Required Height of Rooftop Unit Curb - in.			14			14			24		
Fresh Air Blower		Motor - hp	0.2			1/2			1		
		Wheel Size (diameter x width) - in	6-1/4 x 6-1/2			10 x 6			9 x 9		
		Motor Speed - rpm	1780			1120			1725		
		Motor Speed(s)	2			3			Adjustable Sheave		
		Bearing Type	Sleeve			Sleeve			Ball		
Exhaust Air Blower		Motor Type	PSC			PSC			Belt Drive		
		Fixed Wheel	1/4			1/2			1		
		Motor - hp Pivoting Wheel	---			1/2			1-1/2		
		Wheel Size (diameter x width) - in	6-1/4 x 6-1/2			10 x 6			9 x 9		
		Motor Speed - rpm	1780			1120			1725		
		Motor Speed(s)	2			3			Adjustable Sheave		
		Bearing Type	Sleeve			Sleeve			Ball		
Recovery Wheel		Wheel Depth x Diameter - in	2 x 19-1/4			3 x 25-1/4			3 x 30-5/16		
		Motor Speed - rpm	1050			1050			1050		
Electrical Data - Line Voltage - 60hz			² 208/230V-1ph, 208/230V-3ph, 460V-3ph, and 575V-3ph			208/230V-3ph, 460V-3ph, and 575V-3ph			208/230V-3ph, 460V-3ph, or 575V-3ph		
Enthalpy Wheel Airflow Data		Nominal Airflow	500 cfm at 0.6 in. w.c.			900 cfm at 1 in. w.c.			1600 cfm at 0.95 in. w.c.		
	EATR - Exhaust Air Transfer Ratio	at minus 1 in. w. c.	9.90%			9.30%			7.80%		
		at 0 in. w. c.	0.20%			0.70%			0.40%		
		at 1 in. w. c.	0.00%			0.00%			0.00%		
	OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.	1.02%			0.97%			0.97%		
		at 0 in. w. c.	1.33%			1.19%			1.16%		
		at 1 in. w. c.	1.59%			1.34%			1.29%		
¹Thermal Ratings at 0 in. w.c. Pressure Differential	Total Effectiveness	100% Airflow Heating	Sensible	Latent	Total	Sensible	Latent	Total	Sensible	Latent	Total
		75% Airflow Heating	68%	60%	65%	76%	68%	73%	68%	61%	65%
		100% Airflow Cooling	73%	65%	70%	81%	73%	78%	72%	67%	71%
		75% Airflow Cooling	68%	60%	64%	76%	68%	72%	68%	61%	64%
	Net Effectiveness	100% Airflow Heating	73%	65%	69%	81%	73%	76%	72%	67%	70%
		75% Airflow Heating	68%	60%	65%	76%	68%	73%	68%	61%	65%
		100% Airflow Cooling	73%	65%	70%	81%	73%	78%	72%	67%	71%
		75% Airflow Cooling	68%	60%	64%	76%	68%	72%	68%	61%	64%
³Weights	Fixed	Shipping Weight - lbs.	472			475			791		
		Net Weight - lbs.	455			458			706		
	Pivoting	Shipping Weight - lbs.	---			480			754		
		Net Weight - lbs.	---			463			669		

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS - FOR 6 TO 7.5 TON LANDMARK MODELS

General Data	Model Number Fixed Wheel	50R1146xH	50R2046xH						
	Model Number Pivoting Wheel	50P1146xH	50P2046xH						
	Nominal Air Volume - cfm	700 - 1000	1000-1700						
	Matching Units	KCA/KGA090, KHA072							
Required Height of Rooftop Unit Curb - in.		14	14						
Fresh Air Blower	Motor - hp	1/2	1						
	Wheel Size (diameter x width) - in	10 x 6	9 x 9						
	Motor Speed - rpm	1120	1725						
	Motor Speed(s)	3	Adjustable Sheave						
	Bearing Type	Sleeve	Ball						
Exhaust Air Blower	Motor Type	PSC	Belt-Drive						
	Motor - hp	1/2	1						
	Pivoting Wheel	1/2	1-1/2						
	Wheel Size (diameter x width) - in	10 x 6	9 x 9						
	Motor Speed - rpm	1120	1725						
	Motor Speed(s)	3	Adjustable Sheave						
	Bearing Type	Sleeve	Ball						
Recovery Wheel	Wheel Depth x Diameter - in	3 x 25	3 x 30-11/32						
	Motor Speed - rpm	1050	1050						
Electrical Data - Line Voltage - 60hz		208/230V-3ph, 460V-3ph, or 575V-3ph	208/230V-3ph, 460V-3ph, or 575V-3ph						
Enthalpy Wheel Airflow Data	Nominal Airflow	900 cfm at 1 in. w.c.	1600 cfm at 0.95 in. w.c.						
	EATR - Exhaust Air Transfer Ratio	at minus 1 in. w. c.	9.30 %	7.80%					
		at 0 in. w.c.	0.70 %	0.40%					
		at 1 in. w.c.	0.00 %	0.00%					
	OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.	0.97 %	0.97%					
		at 0 in. w.c.	1.19 %	1.16%					
		at 1 in. w.c.	1.34 %	1.29%					
¹Thermal Ratings at 0 in. w.c. Pressure Differential	Total Effectiveness	100% Airflow Heating	Sensible	Latent	Total	Sensible	Latent	Total	
		75% Airflow Heating	76%	68%	73%	68%	61%	65%	
		100% Airflow Cooling	81%	73%	78%	72%	67%	71%	
		75% Airflow Cooling	76%	68%	72%	68%	61%	64%	
	Net Effectiveness	100% Airflow Heating	81%	73%	76%	72%	67%	70%	
		75% Airflow Heating	76%	68%	73%	68%	61%	65%	
		100% Airflow Cooling	81%	73%	78%	72%	67%	71%	
		75% Airflow Cooling	76%	68%	72%	68%	61%	64%	
	³ Weights	Fixed	Shipping Weight - lbs.	475			791		
			Net Weight - lbs.	458			706		
Pivoting		Shipping Weight - lbs.	480			754			
		Net Weight - lbs.	463			669			

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS - FOR 7.5 TO 12.5 TON LANDMARK MODELS

General Data		Model Number Fixed Wheel	50R2047xH	50R2847xM	50R2847xH	50R3647xH									
		Model Number Pivoting Wheel	50P2047xH	50P2847xM	50P2847xH	50P3647xH									
		Nominal Air Volume - cfm	1000-1700	1500-2200	2200-2800	2800-3600									
		Matching Units	KCA/KGA/KHA092 through 150 models												
Required Height of Rooftop Unit Curb - in.			14	14	14	24									
Fresh Air Blower	Motor - hp		1	1-1/2	1-1/2	2									
	Wheel Size (diameter x width) - in		9 x 9	10 x 10	10 x 10	12 x 9									
	Motor Speed - rpm		1725	1725	1725	1725									
	Motor Speed(s)		Adjustable Sheave	Adjustable Sheave	Adjustable Sheave	Adjustable Sheave									
	Bearing Type		Ball	Ball	Ball	Ball									
Exhaust Air Blower	Motor Type		Belt-Drive	Belt-Drive	Belt-Drive	Belt-Drive									
	Motor - hp	Fixed Wheel	1	1-1/2	1-1/2	2									
		Pivoting Wheel	1-1/2	3	3	3									
	Wheel Size (diameter x width) - in		9 x 9	10 x 10	10 x 10	12 x 9									
	Motor Speed - rpm		1725	1725	1725	1725									
	Motor Speed(s)		Adjustable Sheave	Adjustable Sheave	Adjustable Sheave	Adjustable Sheave									
	Bearing Type		Ball	Ball	Ball	Ball									
Recovery Wheel	Wheel Depth x Diameter - in		3 x 30-11/32	3 x 37-3/4	3 x 37-3/4	3 x 41-13/16									
	Motor Speed - rpm		1050	825	825	1075									
Electrical Data - Line Voltage - 60hz			208-230V - 3ph, 460V - 3ph or 575V - 3ph	208-230V - 3ph, 460V - 3ph or 575V - 3ph	208-230V - 3ph, 460V - 3ph or 575V - 3ph	208-230V - 3ph, 460V - 3ph or 575V - 3ph									
Enthalpy Wheel Airflow Data	Nominal Airflow		1600 cfm at 0.95 in. w.c.	1500 cfm at 0.67 in. w.c.	2600 cfm at 0.95 in. w.c.	3100 cfm at 0.9 in. w.c.									
	EATR - Exhaust Air Transfer Ratio	at minus 1 in. w.c.	7.80%	6.10%	6.10%	4.90%									
		at 0 in. w.c.	0.40%	4.00%	4.00%	1.30%									
		at 1 in. w.c.	0.00%	0.00%	0.00%	0.30%									
	OACF - Outdoor Air Correction Factor	at minus 1 in. w.c.	0.97%	0.98%	0.98%	0.99%									
		at 0 in. w.c.	1.16%	1.13%	1.13%	1.07%									
		at 1 in. w.c.	1.29%	1.23%	1.23%	1.12%									
¹Thermal Ratings at 0 in. w.c. Pressure Differential	Total Effectiveness	100% Airflow Heating	68%	62%	65%	68%	60%	65%	68%	60%	65%	68%	60%	65%	
		75% Airflow Heating	72%	67%	71%	74%	67%	71%	74%	67%	71%	74%	67%	71%	
		100% Airflow Cooling	68%	61%	64%	68%	60%	63%	68%	60%	63%	68%	60%	63%	
		75% Airflow Cooling	72%	67%	70%	74%	67%	70%	74%	67%	70%	74%	67%	70%	
	Net Effectiveness	100% Airflow Heating	68%	61%	65%	68%	60%	65%	68%	60%	65%	68%	60%	65%	
		75% Airflow Heating	72%	67%	71%	74%	67%	71%	74%	67%	71%	74%	67%	71%	
		100% Airflow Cooling	68%	61%	64%	68%	60%	63%	68%	60%	63%	68%	60%	63%	
		75% Airflow Cooling	72%	67%	71%	74%	67%	70%	74%	67%	70%	74%	67%	70%	
	³Weights	Fixed	Shipping Weight - lbs.	791			811			811			1120		
			Net Weight - lbs.	706			726			726			1045		
		Pivoting	Shipping Weight - lbs.	754			928			928			1125		
			Net Weight - lbs.	669			843			843			1050		

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS - FOR 15 TO 25 TON LANDMARK MODELS

General Data		Model Number Fixed Wheel	50R2848xM	50R2848xH	50R3648xH							
		Model Number Pivoting Wheel	50P2848xM	50P2848xH	50P3648xH							
		Nominal Air Volume - cfm	1500-2200	2200-2800	2800-3600							
		Matching Units	KCA/KGA/KHA180 through 300, KHA180 through 240 models									
Required Height of Rooftop Unit Curb - in.			14	14	14							
Fresh Air Blower	Motor - hp		1-1/2	1-1/2	2							
	Wheel Size (diameter x width) - in		10 x 10	10 x 10	12 x 9							
	Motor Speed - rpm		1725	1725	1725							
	Motor Speed(s)		Adjustable Sheave	Adjustable Sheave	Adjustable Sheave							
	Bearing Type		Ball	Ball	Ball							
Exhaust Air Blower	Motor Type		Belt-Drive	Belt-Drive	Belt-Drive							
	Motor - hp	Fixed Wheel	1-1/2	1-1/2	2							
		Pivoting Wheel	3	3	3							
	Wheel Size (diameter x width) - in		10 x 10	10 x 10	12 x 9							
	Motor Speed - rpm		1725	1725	1725							
	Motor Speed(s)		Adjustable Sheave	Adjustable Sheave	Adjustable Sheave							
	Bearing Type		Ball	Ball	Ball							
Recovery Wheel	Wheel Depth x Diameter - in		3 x 37-3/4	3 x 37-3/4	3 x 41-13/16							
	Motor Speed - rpm		825	825	1075							
Electrical Data - Line Voltage - 60hz			208-230V - 3ph / 460V - 3ph / 575V - 3ph									
Enthalpy Wheel Airflow Data	EATR - Exhaust Air Transfer Ratio	Nominal Airflow	1900 cfm at 0.7 in. w.c.	2600 cfm at 0.95 in. w.c.	3100 cfm at 0.9 in. w.c.							
		at minus 1 in. w. c.	6.10%	6.10%	4.90%							
		at 0 in. w.c.	4.00%	4.00%	1.30%							
		at 1 in. w.c.	0.00%	0.00%	0.30%							
	OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.	0.98%	0.98%	0.99%							
		at 0 in. w.c.	1.13%	1.13%	1.07%							
		at 1 in. w.c.	1.23%	1.23%	1.12%							
¹Thermal Ratings at 0 in. w.c. Pressure Differential	Total Effectiveness	100% Airflow Heating	Sensible	Latent	Total	Sensible	Latent	Total	Sensible	Latent	Total	
		75% Airflow Heating	68%	60%	65%	68%	60%	65%	68%	60%	65%	
		100% Airflow Cooling	74%	67%	71%	74%	67%	71%	74%	67%	71%	
		75% Airflow Cooling	68%	60%	63%	68%	60%	63%	68%	60%	63%	
	Net Effectiveness	100% Airflow Heating	68%	60%	65%	68%	60%	65%	68%	60%	65%	
		75% Airflow Heating	74%	67%	71%	74%	67%	71%	74%	67%	71%	
		100% Airflow Cooling	68%	60%	63%	68%	60%	63%	68%	60%	63%	
		75% Airflow Cooling	74%	67%	70%	74%	67%	70%	74%	67%	70%	
	³Weights	Fixed	Shipping Weight - lbs.	811			811			1120		
			Net Weight - lbs.	726			726			1045		
Pivoting		Shipping Weight - lbs.	928			928			1125			
		Net Weight - lbs.	843			843			1050			

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS - FOR 15 TO 25 TON LANDMARK MODELS (CONTINUED)

General Data		Model Number Fixed Wheel	50R4648xH	50R6248xM	50R6248xH						
		Model Number Pivoting Wheel	50P4648xH	50P6248xM	50P6248xH						
		Nominal Air Volume - cfm	3400-4600	4800-5600	5500-6200						
		Matching Units	KCA/KGA/KHA180 through 300, KHA180 through 240 models								
Required Height of Rooftop Unit Curb - in.			24	24	24						
Fresh Air Blower	Belt-Drive Motor - hp		3	5	5						
	Wheel Size (diameter x width) - in		12 x 12	12 x 12	12 x 12						
	Motor Speed - rpm		1725	1725	1725						
	Motor Speed(s)		Adjustable Sheave	Adjustable Sheave	Adjustable Sheave						
	Bearing Type		Ball	Ball	Ball						
Exhaust Air Blower	Belt-Drive Motor - hp	Fixed Wheel	3	5	5						
		Pivoting Wheel	5	2 each - 5	2 each - 5						
	Wheel Size (diameter x width) - in		12 x 12	12 x 12	12 x 12						
	Motor Speed - rpm		1725	1725	1725						
	Motor Speed(s)		Adjustable Sheave	Adjustable Sheave	Adjustable Sheave						
	Bearing Type		Ball	Ball	Ball						
Recovery Wheel	Wheel Depth x Diameter - in		3 x 46-3/4	3 x 52	3 x 52						
	Motor Speed - rpm		1075	1075	1075						
Electrical Data - Line Voltage - 60hz			208/230V-3ph, 460V-3ph, or 575V-3ph								
Enthalpy Wheel Airflow Data	Nominal Airflow		3900 cfm at 0.95 in. w.c.	5500 cfm at 0.95 in. w.c.	5500 cfm at 0.95 in. w.c.						
	EATR - Exhaust Air Transfer Ratio	at minus 1 in. w. c.	4.40%	4.00%	4.00%						
		at 0 in. w.c.	1.10%	1.00%	1.00%						
		at 1 in. w.c.	0.20%	0.20%	0.20%						
	OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.	0.99%	0.99%	0.99%						
		at 0 in. w.c.	1.06%	1.06%	1.07%						
		at 1 in. w.c.	1.11%	1.10%	1.12%						
¹ Thermal Ratings at 0 in. w.c. Pressure Differential	Total Effectiveness	100% Airflow Heating	68%	60%	65%	68%	60%	65%	68%	60%	65%
		75% Airflow Heating	73%	67%	71%	73%	67%	71%	73%	67%	71%
		100% Airflow Cooling	68%	60%	63%	68%	60%	63%	68%	60%	63%
		75% Airflow Cooling	73%	67%	70%	73%	67%	70%	73%	67%	70%
	Net Effectiveness	100% Airflow Heating	68%	60%	65%	68%	60%	65%	68%	60%	65%
		75% Airflow Heating	73%	67%	71%	73%	67%	71%	73%	67%	71%
		100% Airflow Cooling	68%	60%	63%	68%	60%	63%	68%	60%	63%
		75% Airflow Cooling	73%	67%	70%	73%	67%	70%	73%	67%	70%
² Weights	Fixed	Shipping Weight - lbs.	1333			1566			1566		
		Net Weight - lbs.	1224			1441			1441		
	Pivoting	Shipping Weight - lbs.	1339			1623			1623		
		Net Weight - lbs.	1230			1498			1498		

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² Actual weight may vary and is dependent on configuration.

ELECTRICAL DATA

Model No.		² 50R0644xH	50R1144xH	50R2045xH	50P2045xH	50R2847xM	50P2847xM
		² 50R0645xH	50R1145xH 50R1146xH 50P1144xH 50P1145xH 50R1146xH	50R2046xH 50R2047xH	50P2045xH 50R2047xH	50R2848xM 50R2847xH 50R2848xH	50P2848xM 50P2847xH 50P2848xH
Fresh Air Blower Motor	115V-1ph	3.8	---	---	---	---	---
	208/230V-3ph	---	3.4	3.8	3.8	5.6	5.6
	460V-3ph	---	1.4	1.9	1.9	2.8	2.8
	575V-3ph	---	1.4	1.4	1.4	2.0	2.0
Exhaust Blower Motor	115V-1ph	3.8	---	---	---	---	---
	208/230V-3ph	---	3.4	3.8	5.6	5.6	9
	460V-3ph	---	1.4	1.9	2.8	2.8	4.4
	575V-3ph	---	1.4	1.4	2.0	2.0	3.6
Wheel Drive Motor - Full load amps		0.7	0.3	0.3	0.3	0.6	0.6
Maximum Overcurrent Protection (amps)	115V-1ph	10	---	---	---	---	---
	208/230V-3ph	9	10	12	15	20	25
	460V-3ph	4	6	6	8	10	12
	575V-3ph	3	6	5	6	7	10
¹ Minimum Circuit Ampacity	115V-1ph	9.3	---	---	---	---	---
	208/230V-3ph	5.4	8.0	8.9	11.1	13.2	17.5
	460V-3ph	2.7	3.5	4.6	5.7	6.9	8.9
	575V-3ph	2.2	3.5	3.5	4.2	5.1	7.1

¹ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

² A unit step down transformer is provided, 208/230/460/575V primary, 120V secondary


ELECTRICAL DATA

Model No.		50R3647xH	50P3647xH	50R4648xH	50P4648xH	50R6248xM	50P6248xM
		50R3648xH	50P3648xH			50R6248xH	50P6248xH
Fresh Air Blower Motor	208/230V-3ph	7.0	7.0	9	9	15	15
	460V-3ph	3.5	3.5	4.4	4.4	7.4	7.4
	575V-3ph	2.4	2.4	3.6	3.6	5.9	5.9
Exhaust Blower Motor	208/230V-3ph	7.0	9.4	9	15.3	15.3	15.3
	460V-3ph	3.5	4.3	4.3	6.4	6.4	6.4
	575V-3ph	2.4	3.2	3.4	5.1	5.1	5.1
Wheel Drive Motor - Full load amps		1.2	1.2	1.2	1.2	1.2	1.2
Maximum Overcurrent Protection (amps)	208/230V-3ph	25	25	30	40	50	50
	460V-3ph	12	15	15	20	25	25
	575V-3ph	10	12	12	15	20	20
¹ Minimum Circuit Ampacity	208/230V-3ph	17.0	20.0	21.5	29.4	35.4	35.4
	460V-3ph	9.0	10.0	11	13.6	16.9	16.9
	575V-3ph	6.6	7.6	9.1	11.2	13.7	13.7

¹ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

DIMENSIONS - INCHES (MM)


Note: "D" is hood depth

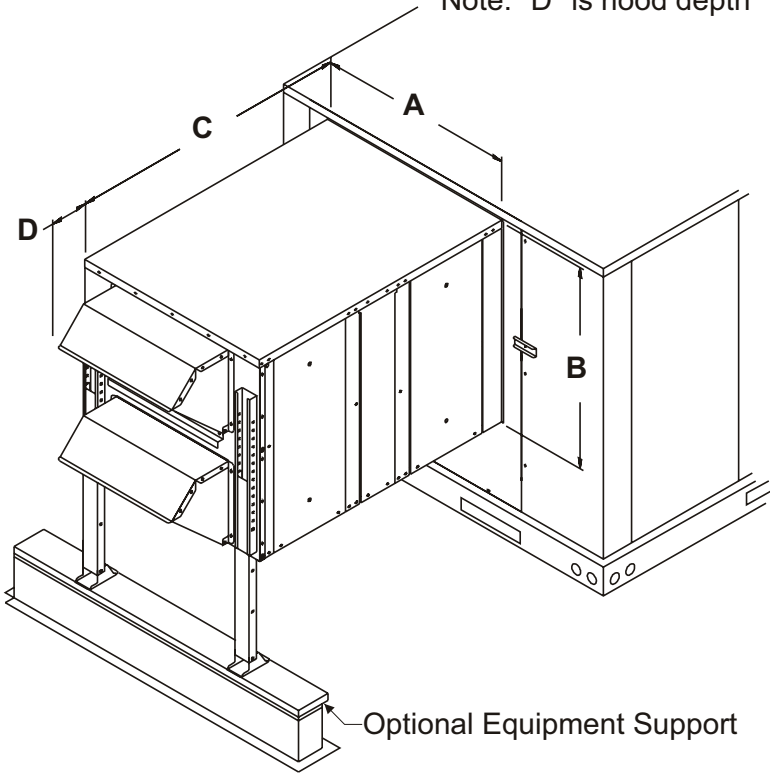

Model No.	A	B	C	D
50R0644xH	24-3/4 (629)	24-5/8 (625)	34-9/16 (876)	8 (203)
50R1144xH 50P1144xH	32-1/8 (816)	33-1/2 (851)	44-3/4 (1138)	11 (279)
50P0645xH	24-3/4 (629)	24-5/8 (625)	34-9/16 (876)	8 (203)
50R1145xH 50P1145xH 50R1146xH 50P1146xH	32-1/8 (816)	33-1/2 (851)	44-3/4 (1138)	11 (279)
50R2045xH 50P2045xH 50R2046xH 50P2046xH 50R2047xH 50P2047xH	37-1/4 (946)	37-1/2 (953)	54-3/8 (1381)	20-5/16 (516)
50R2847xM 50P2847xH 50R2847xM 50P2847xH	42-5/8 (1083)	43-9/16 (1106)	52-1/4 (1327)	18-5/16 (465)
50R3647xH 50P3647xH	46-11/16 (1186)	57-3/8 (1457)	60 (1524)	18-5/16 (465)


Note: "D" is hood depth

Model No.	A	B	C	D
50R2848xM 50R2848xH 50P2848xM 50P2848xH	42-5/8 (1083)	43-9/16 (1106)	52-1/4 (1327)	18-5/16 (465)
50R3648xH 50P3648xH	46-11/16 (1186)	57-3/8 (1457)	60 (1524)	18-5/16 (465)
50R4648xH 50P4648xH	52-11/16 (1338)	57-3/8 (1457)	60 (1524)	18-5/16 (465)
50R6248xM 50R6248xH 50P6248xM 50P6248xH	58-7/8 (1496)	57-3/8 (1457)	60 (1524)	18-5/16 (465)

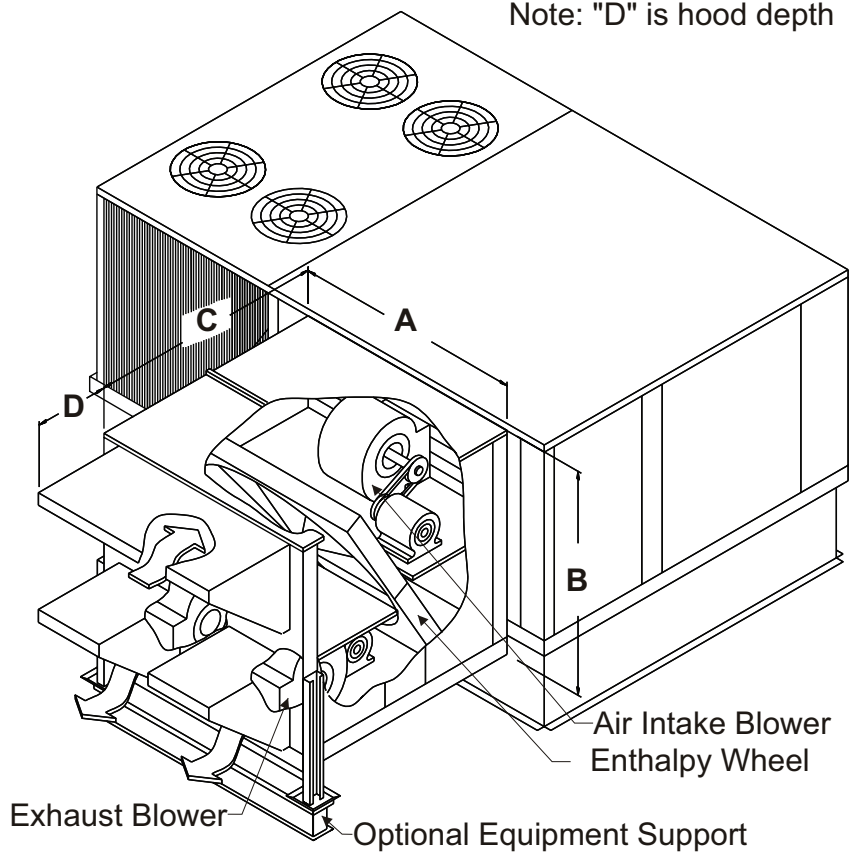


UNIT CLEARANCES - INCHES (MM)

KCA/KGA024, 030, 036, 048, 060, 072, 090 | KHA024, 030, 036, 048, 060, 072

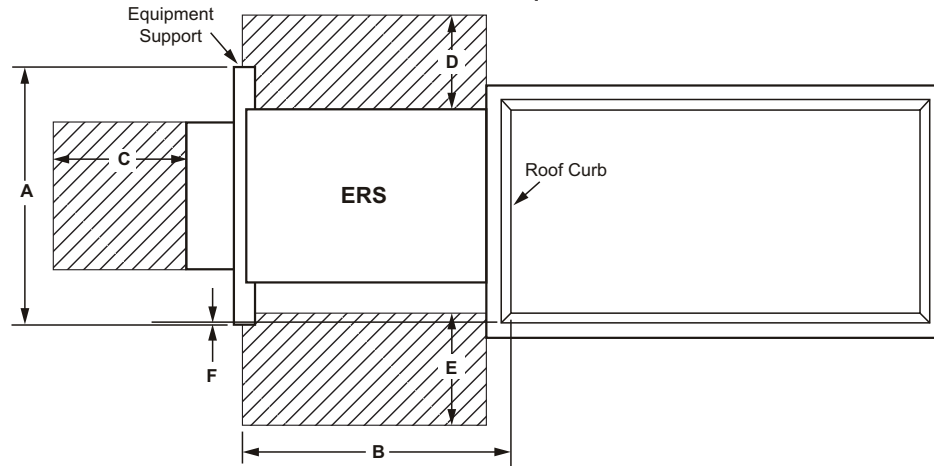


KCA/KGA092, 150

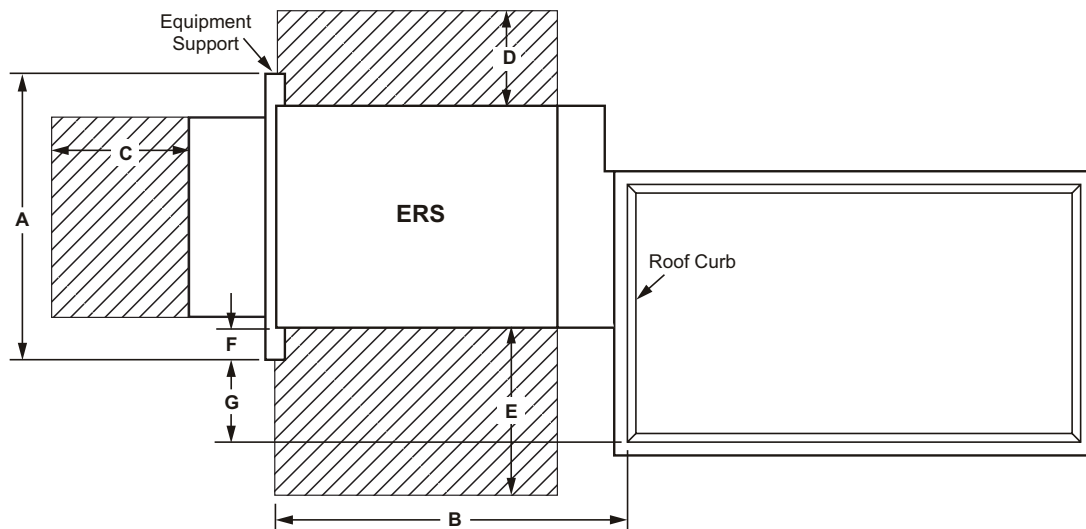

ERS Model No.	A		B		C		D		E		F		G	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
KCA/KGA024, 030, 036, 048, 060, KHA024, 030, 036, 048														
50R0644xH	48	1219	39-3/8	1000	16	406	18	457	24	610	2	51	---	---
50R1144xH 50P1144xH	48	1219	49-1/2	1257	24	610	18	457	36	914	2	51	---	---
KCA/KGA072, KHA060														
50R0645xH	48	1219	39-3/8	1000	16	406	18	457	24	610	2	51	---	---
50R1145xH 50P1145xH	48	1219	49-1/2	1257	24	610	18	457	36	914	2	51	---	---
50R2045xH 50P2045xH	48	1219	58-1/4	1480	40	1016	24	610	42	1067	2	51	---	---
KCA/KGA090, KHA072														
50R1146xH 50P1146xH	48	1219	49-1/2	1257	24	610	18	457	36	914	2	51	---	---
50R2046xH 50P2046xH	48	1219	58-1/4	1480	40	1016	24	610	42	1067	2	51	---	---
KCA/KGA092, 150														
50R2047xH 50P2047xH	48	1219	60-3/8	1533	40	1016	24	610	42	1067	5-3/8	137	18-5/8	473
50R2847xM 50P2847xM	60	1524	60-1/4	1530	36	914	24	610	48	1219	6-5/8	168	17-1/2	444
50R3647xH 50P3647xH	60	1524	70-1/2	1791	36	914	30	762	60	1524	6-5/8	168	17-1/2	444

UNIT CLEARANCES - INCHES (MM)

KCA/KGA180, 210, 240, 300, KHA180, 240

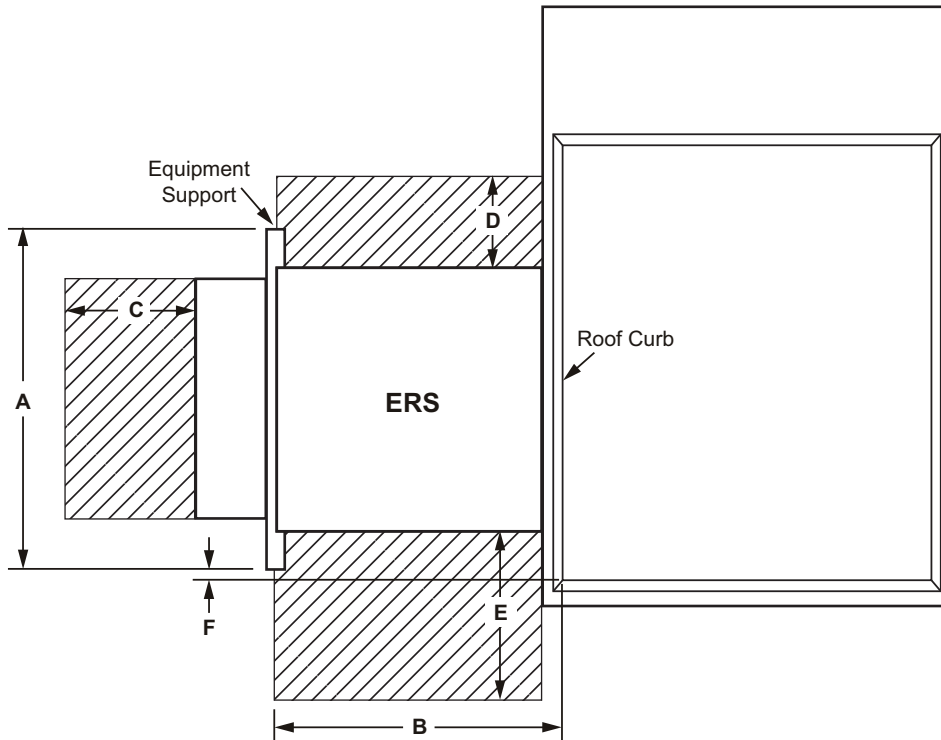

ERS Model No.	A		B		C		D		E		F	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
KCA/KGA180, 210, 240, 300, KHA180, 240												
50R2848xM 50R2848xH 50P2848xM 50P2848xH	60	1524	56-1/8	1426	36	914	24	610	48	1219	11-1/4	286
50R3648xH 50P3658xH	60	1524	63-7/8	1622	36	914	30	762	60	1524	11-1/4	286
50R4648xH 50P4648xH	76	1930	63-7/8	1622	36	914	30	762	60	1524	3-1/8	79
50R6248xM 50R6248xH 50P6248xM 50P6248xH	76	1930	63-7/8	1622	36	914	30	762	60	1524	3-1/8	79

GUIDE SPECIFICATIONS

Prepared for the guidance of architects, consulting engineers and mechanical contractors.

General

- Unit shall be a constant volume, energy recovery system used in conjunction with packaged rooftop equipment.
- Unit shall be directly coupled to the rooftop packaged unit to form a unitized system.
- Unit shall be performance rated in accordance with AHRI standards and in compliance with ASHRAE or DOE standards.
- Unit shall be certified to the applicable safety standards for the installed country.
- In addition, manufacturer shall test operate system at the factory before shipment.

Approval

- All models shall be certified in accordance with AHRI Standard 1060-2005, Air-to-Air Energy Recovery Ventilation Equipment and Standard for Safety for Heating and Cooling Equipment ANSI/UL1995, CAN CSA - 22.2 No. 236-05

Equipment Warranty

- Energy Recovery wheel shall have a limited warranty for five years.
- All other covered components have a limited warranty for one year.

Cabinet

- Shall be designed to attach directly to the rooftop unit.
- Shall be constructed of G90 galvanized steel with a powdered enamel paint finish electrostatically bonded to the metal.
- Metal shall be salt spray tested for 1000 hours per ASTM B-117.
- Cabinet panels shall be fully insulated with non-hygroscopic fiberglass insulation. Insulation shall have an R-Value of 3. 7 and shall be flame resistant per UL-723. Insulation shall be in accordance with NFPA 90A and tested to meet UL 181 erosion requirements.
- Full perimeter base rail with top mounted rigging holes and fork truck access from three sides shall be provided.
- Test ports shall be provided so airflow can be measured across the energy recovery wheel.

Energy Recovery Wheel Types

- Wheel shall be either of the enthalpy type for both sensible and latent heat recovery or the sensible type for sensible heat recovery.
- Energy transfer ratings shall be certified in accordance with AHRI Standard 1060-2000.
- Wheel shall be constructed of a lightweight polymer material.
- Enthalpy type shall be coated with a desiccant silica gel that will not dissolve or liquify in the presence of water or high humidity.
- All energy recovery wheels shall be designed to be removed from the unit for ease of inspection and maintenance, 25 inch and larger wheels shall be segmented for easy removal.
- The wheel shall be easily cleanable with standard coil cleaning solution.
- The wheel shall be available in both fixed and pivoting configurations.

Performance

- The complete line of units shall have a cfm range of 300 to 6200.
- Individual units shall be available in ranges of 300-550, 700-1000, 1000-1700, 1500-2200, 2200-2800, 2800-3600, 3400-4600, 4800-5600, and 5500-6200 cfm.
- Unit shall operate to 10oF without the need for frost protection.
- Unit shall have up to 73% net effectiveness per AHRI tests. Application effectiveness shall be higher.

Control Operation

- Operation shall be controlled by a low voltage logic board.
- Logic board shall control low ambient kit and motorized outside air damper.

Access Doors

- All components shall be accessible through removable access doors as a standard option.
- Upgradeable to a non-removable hinged access door.

Filters

- All unit shall be provided with mist eliminator type filters in the intake air hood.
- Optional internal MERV 8 pleated filters provided with filter racks.

Blowers

- Intake/exhaust air blowers shall be direct drive on ERS of 1000 cfm or less.
- Belt drive intake/exhaust air blowers shall be used on ERS over 1000 cfm.

GUIDE SPECIFICATIONS

Motors

- Blower motors on belt drive ERS shall have permanently lubricated ball bearings. Motors shall have thermal overload protection and shall have adjustable sheaves for blower speed adjustment.
- Blower motors on direct drive ERS shall be PSC type with multiple speeds.
- Intake and exhaust motors shall be individually controlled.
- Motor efficiency shall meet requirements of U.S. Energy Policy Act of 1992 (EPACT).

Electrical

- Units shall have single power point connection.
- A low voltage terminal strip shall be available.

Balancing Dampers

- Shall be provided for all fixed wheel units and shall be mounted inside the rooftop unit.

Barometric Relief Dampers

- Pressure operated dampers shall be provided for all ERS units.

OPTIONAL ACCESSORIES

Low Ambient Kit

- Low Ambient Kit shall be factory installed to prevent frost formation on the energy recovery wheel.
- Frost is prevented controlling the intake blower operation when discharge temperature is below a selectable temperature setting.

Motorized Outside Air Damper Assembly with Hood

- Shall be factory installed to provide motorized operation of intake air requirements.
- Damper assembly shall be installed behind the ERS outside air intake hood.

Motorized Exhaust Air Damper

- Shall be factory installed to provide motorized operation of exhaust air requirements.
- Damper assembly shall be install in the ERS barometric relief hood.

Stop-Start-Jog

- Shall be a factory installed option for fixed wheel units only. Matching rooftop unit should not have an economizer.

Pressure Sensor

- Shall be a factory installed option to provide the amount of outside airflow across the enthalpy wheel.

Rotation Sensor

- Shall be a factory installed option to verifies the rotation of the enthalpy wheel.

Disconnect

- Shall be factory installed and field wired to provide easy ability to turn power on/off to the ERS

VFD

- Shall be factory installed to provide variable frequency drive to control the speed of the blowers only.

Dirty Filter Sensor

- Shall be factory installed to provide a sensor to signal a field installed alarm when the filters need to be cleaned or changed.

Filter Rack

- Shall be factory installed with 2" MERV 8 pleated filters to filter air in both the intake and exhaust sections of the ERS.

Hinged Doors with handles

- Shall be factory installed to provide easy access to the energy recovery wheel, filters and blowers.

Optional Energy Recovery Wheel

- Optional wheel shall be the sensible type for sensible heat recovery.
- Energy transfer ratings shall be certified in accordance with AHRI Standard 1060-2000.
- Wheel shall be constructed of a lightweight polymer material.
- All energy recovery wheels shall be designed to be removed from the unit for ease of inspection and maintenance, 25 inch and larger wheels shall be segmented for easy removal.
- The wheel shall be easily cleanable with standard coil cleaning solution.
- The wheel shall be available in both fixed and pivoting configurations.

GFI Service Outlet

- Shall be field installed and field wired to provide powered service outlet.

ERS Equipment Support

- Shall be field installed to provide support of the exhaust and intake end of the ERS.
- Supports are available in 48, 60, and 76 inch lengths.

ERS Roof Curb

- Shall be field installed to provide support of the RTU and raise them to the correct height for mounting.

REVISIONS

Sections	Description of Change
Electrical Data	Updated for 50R0644xH 50R0645xH models



Visit us at www.lennox.com

For the latest technical information, www.lennoxcommercial.com

Contact us at 1-800-4-LENNOX

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2017 Lennox Industries, Inc.