

Job: _____
 Location: _____
 Schedule No.: _____
 System Designation: _____

Engineer: _____
 Architect: _____
 Location: _____
 Date: _____

For: Reference Approval Review Construction

Medium-Static Concealed Duct Indoor Unit

FEATURES

- Pre Heat Function
- Auto Addressing
- Auto Restart
- Four Built-In Dry Contact Relays
- Electronic Expansion Valve
- High-Efficiency DC Motor
- Brazed Connections
- LED Display
- Foldable Return Air Filter
- Refrigerant R-410A
- Nine capacity sizes from 7,000 to 48,000 Btu/h

WARRANTY

- 10-year limited warranty.*See warranty for details.

SPECIFICATIONS

PERFORMANCE

Cooling Capacity ¹ (Btu/h)	48,000
Heating Capacity ¹ (Btu/h)	54,000
Airflow (CFM)	Low/Medium/High 980/1100/1370
External Static Pressure (in. w.g.)	0.10 - 0.60
Sound (dBA)	Low/Medium/High 41.2/43.8/48

ELECTRICAL DATA

Power Supply (Volts/Hertz/Phase)	208-230/60/1
Minimum Circuit Ampacity (MCA) (A)	5
Maximum Overcurrent Protection (MOP) (A)	15
Cooling Power Input ² (W)	230
Cooling Rated Current (A)	1.5
Heating Power Input ² (W)	230.00
Heating Rated Current (A)	1.5
Indoor Fan Motor Input (W)	370

DIMENSIONS

Unit Dimensions (in)	Width	50-3/4
	Height	11-7/8
	Depth	34
Liquid Pipe Connection (in) (I.D.)		3/8
Gas Pipe Connection (in) (I.D.)		5/8
Drain Connection (in) (O.D.)		1
Net Weight (lb)		124
Shipping Weight (lb)		143



OPTIONAL ACCESSORIES

<input type="checkbox"/> Non-Programmable Controller	V0STAT54P-3
<input type="checkbox"/> Programmable Wired Controller	V0STAT51P-3
<input type="checkbox"/> Infrared Wireless Controller	V0STAT52P-1
<input type="checkbox"/> Occupancy Sensor	V0SNSR78P-3
<input type="checkbox"/> Remote Sensor	V0SNSR00P-1
<input type="checkbox"/> HHE Relay Kit	VOCTRL92P-3
<input type="checkbox"/> Hotel Keycard Interface	VOCTRL88P-1

NOTES


1. Cooling and Heating capacity data is rated at the following conditions:
 Cooling: 80°FDB / 67°FWB Indoor, 95°FDB
 Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor.
2. Power Input values are rated at high fan speed.
3. Complies with AHRI 1230-2014 testing standards



NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

DIMENSIONAL DRAWINGS - INCHES (MM)

048H4

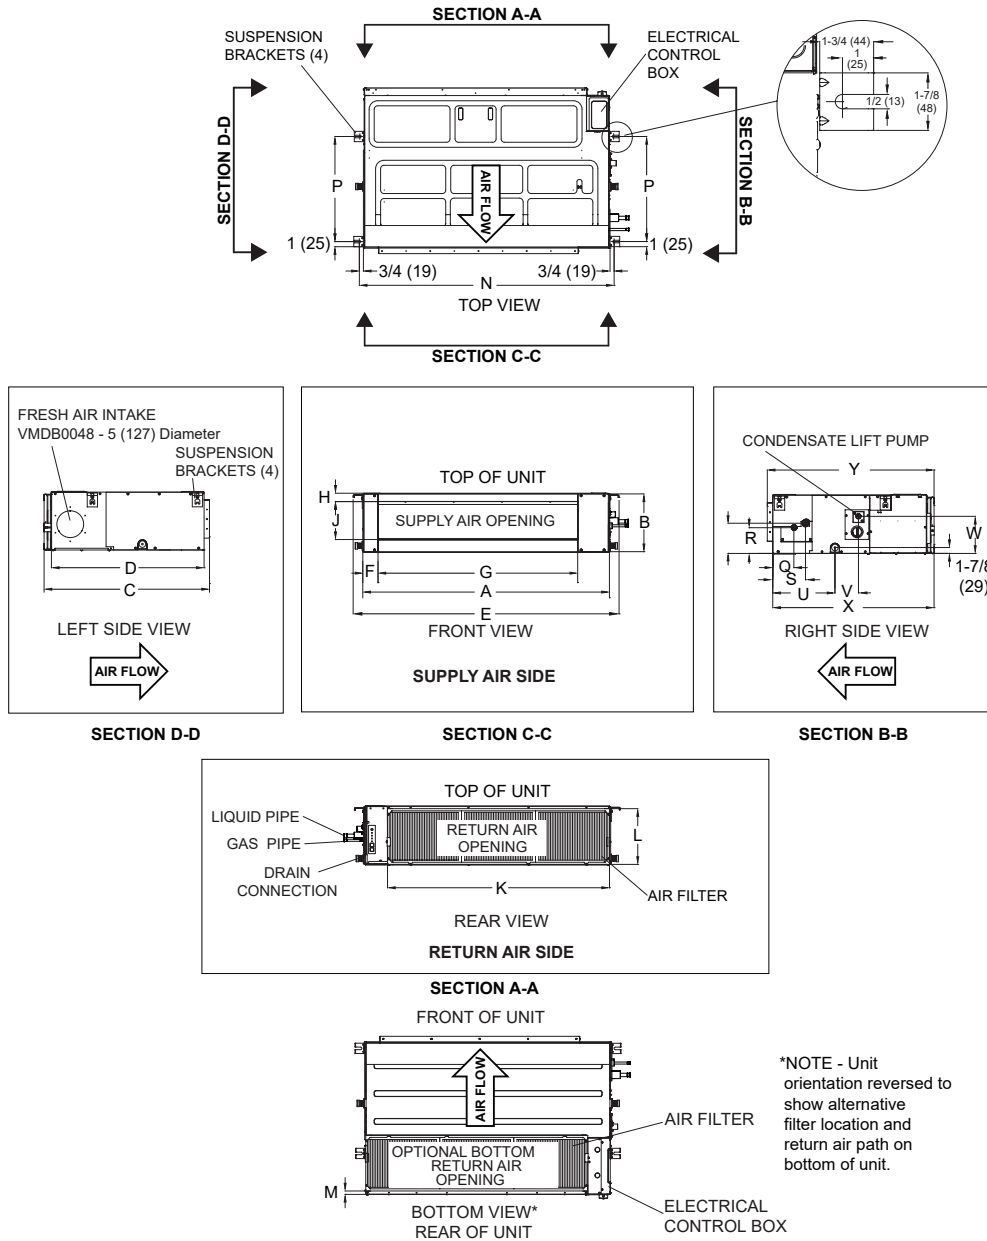

*NOTE - Unit orientation reversed to show alternative filter location and return air path on bottom of unit.

Size	A		B		C		D		E		F		G		H		J	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
048	47-1/4	1200	11-7/8	302	34-1/8	867	31-1/2	800	50-3/4	1289	3-1/8	79	38-1/8	968	1-1/2	38	8	203

Size	K		L		M		N		P		Q		R		S		T		U	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
048	43	1092	11-3/8	289	2	48	49	1246	19-3/4	502	6-3/8	162	6-7/8	175	8-3/8	213	7-5/8	194	9-3/4	248

Size	V		W		X		Y	
	in.	mm	in.	mm	in.	mm	in.	mm
048	7-1/4	184	6-3/4	171	33-1/8	841	34	864

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.