

SUBMITTAL DATA - OUTDOOR UNIT VPB144L4M-3G

VPB072L4M-3G + VPB072L4M-3G

VRF Heat Pump

Construction

Job:	Engineer:
Location:	Architect:
Schedule No.:	Location:

System Designation:

Heat Pump Outdoor Unit

FEATURES

- · Split coil heat exchanger
- · Dual hinged electrical boxes for ease of maintenance
- High-efficiency vapor injection inverter compressor
- · Intelligent Duty Cycle operation

Date:

For:

Reference

· Night Silent operation

460/3/60

(2) 27.5

(2) 30

(2) 19.6

(2) 1

(2) 750/850 (2) 1.4/1.6

50% to 130%

25

R-410A

23.8 lbs.

- · Hinged service doors
- · Built-in service console
- · Built-in base pan heater

Approval

- · Heating Operation down to -22F
- · Low Ambient Cooling down to -10F w/ kit

Review

WARRANTY

· Compressor - 10-year limited warranty

· All other components - 10-year limited warranty *See warranty for details

SPECIFICATIONS

ELECTRICAL DATA

Compressor RLA (A)

Outdoor Fan FLA (A) **GENERAL DATA Connection Ratio**

Refrigerant Type

conditions:

NOTES

1.

2.

3.

4.

5.

Number of Compressors

Power Supply (Volts/Phase/Hertz)

Maximum Overcurrent Protection (A)

Minimum Circuit Ampacity (A)

Outdoor Fan Power Input (W)

Maximum Number of Indoor Units

Factory Refrigerant Charge (each unit)

local power for maintenance.

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	144,000
2001	Rated ²	138,000
EER	Ducted	11.3
	Non-Ducted	11.9
IEER	Ducted	22.7
	Non-Ducted	23.7
Heating Capacity ¹ (Btu/h)	Nominal	162,000
	Rated ²	154,000
COP47	Ducted	3.76
	Non-Ducted	4.04
COP17	Ducted	2.51
	Non-Ducted	2 58

Cooling and Heating capacity data is rated at the following

To achieve cooling lower than 5°F a Low ambient hood must be

A local 115V power outlet is available as an accessory to provide

Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor. Complies with AHRI 1230-2014 testing standards

Operating Voltage Range 410V to 525V

installed. This is purchased as an accessory.

]	

DIMENSIONS (Each Module)				
Unit	Height	64-3/8		
Dimensions (in)	Width	52-3/4		
	Depth	31-1/2		
Main System Piping (in)				
Liquid Pipe Connection		5/8		
Gas Pipe Connection 1				
Balancing Pipework between Modules (in)				
L.P. Gas Balance Pipe Co	1-1/8			
H.P. Gas Balance Pipe Co	nnection	3/4		
Oil Balance Pipe Connecti	5/16			
Unit Net Weight (lb)		800		

C RETIFIED www.ahridirectory.org	C
AHRI Štandard 210/240 Certification applies only when the complete system Is justed with ARI.	Intertek

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. 495868 (202006)


Installation and service must be performed by a qualified installer and servicing agency.



DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

CORNER WEIGHTS								
Model No.	A	AA BB		В	CC		DD	
	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg
072L4M-3Y	118	54	198	90	206	93	245	111
072L4M-3G	124	56	207	94	215	98	256	116

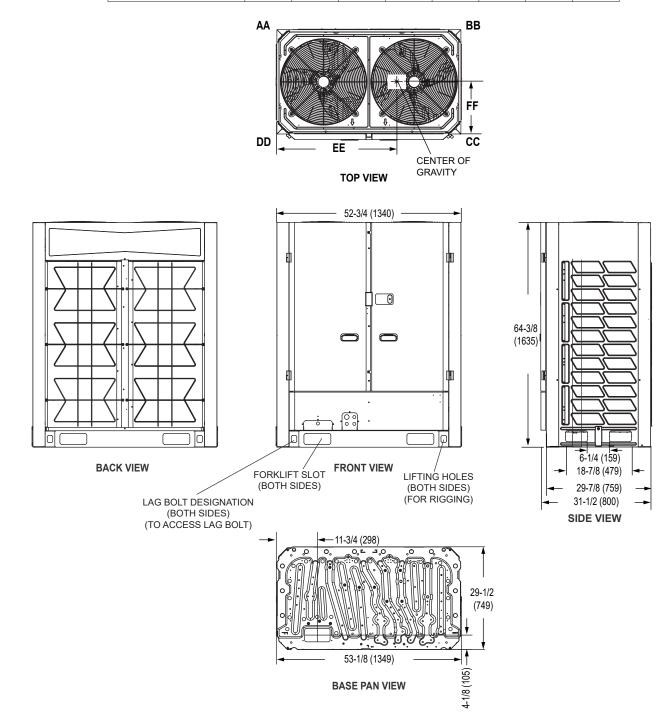


NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495868 (202006)




MULTI-MODULE INFORMATION

Multi-Module Dimensions

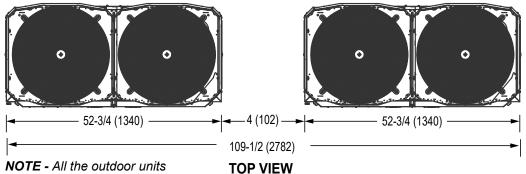

NOTE - All the outdoor units manifolded together should be installed at the same elevation.

Multi-Module Power

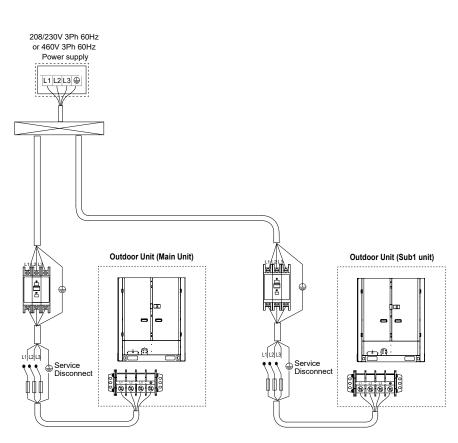

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

Installation and service must be performed by a qualified installer and servicing agency. 495868 (202006)