

SUBMITTAL DATA - OUTDOOR UNIT VRB360L4M-3G

VRB120L4M-3G + VRB120L4M-3G+VRB120L4M-3G

VRF Heat Recovery

Job:	Er
Location:	A
Schedule No.:	Lo
System Designation:	n.

Engine	er:			
Archite	ct:			
Locatio	n:			
Date:				
For:	Reference	Approval	Review	Construction

Heat Recovery Outdoor Unit

FE,	ΔТ			2
	Π	Un	ц с.,	2

- · Split coil heat exchanger
- · Dual hinged electrical boxes for ease of maintenance
- High-efficiency vapor injection inverter compressor
- Intelligent Duty Cycle operation
- · Night Silent operation
- · Hinged service doors
- · Built-in service console
- · Built-in base pan heater
- · Heating Operation down to -22F
- · Low Ambient Cooling down to -10F w/ kit

WARRANTY

· Compressor - 10-year limited warranty

· All other components - 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	360,000
	Rated ²	344,000
EER	Ducted	10.3
	Non-Ducted	10.3
IEER	Ducted	19.3
	Non-Ducted	20.3
SCHE	Ducted	26.4
	Non-Ducted	26.7
Heating Capacity ¹ (Btu/h)	Nominal	405,000
	Rated ²	380,000
COP47	Ducted	3.70
	Non-Ducted	3.40
COP17	Ducted	2.41
	Non-Ducted	2.25

ELECTRICAL DATA

Power Supply (Volts/Phase/Hertz)	460/3/60
Minimum Circuit Ampacity (A)	(3) 43
Maximum Overcurrent Protection (A)	(3) 45
Compressor RLA (A)	(3) 17+17
Number of Compressors	2+2+2
Outdoor Fan Power Input (W)	(3) 1200/1200
Outdoor Fan FLA (A)	(3) 2.2/2.4

GENERAL DATA Connection Ratio 50% to 130% Maximum Number of Indoor Units 64 R-410A Refrigerant Type Factory Refrigerant Charge (each unit) 23.8 lbs.

NOTES

- Cooling and Heating capacity data is rated at the following 1. conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor.
- Complies with AHRI 1230-2014 testing standards 2
- 3. Operating Voltage Range 410V to 525V
- To achieve cooling lower than 5°F a Low ambient hood must be 4. installed. This is purchased as an accessory.
- A local 115V power outlet is available as an accessory to provide 5. local power for maintenance.



DIMENSIONS		VRB120	VRB120	VRB120		
Unit	Height	72	72	72		
Dimensions (in)	Width	68-1/2	68-1/2	68-1/2		
	Depth	32-5/8	32-5/8	32-5/8		
Main System Piping (in)						
Liquid Pipe Connectio	n	3/4	3/4	3/4		
Gas Pipe Connection		1-1/4	1-1/4	1-1/4		
Balancing Pipework	between	Modules (in)			
L.P. Gas Balance Pipe Connection)	1-1/4	1-1/4	1-1/4		
H.P. Gas Balance Pipe Connection	9	3/4	3/4	3/4		
Oil Balance Pipe Conr	nection	5/16	5/16	5/16		
Unit Net Weight (lb)		1076	1076	1076		



NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

495903 (202006)




SUBMITTAL DATA - OUTDOOR UNIT **VRB360L4M-3G** VRB120L4M-3G + VRB120L4M-3G+VRB120L4M-3G **VRF Heat Recovery**

DIMENSIONAL DRAWINGS - INCHES (MM)

VRB120

Model No.	AA		BB		CC		DD	
	Ibs.	kg	Ibs.	kg	Ibs.	kg	Ibs.	kg
096, 120L4M-3Y	171	78	262	119	327	148	318	144
096, 120L4M-3G	173	78	266	121	332	151	323	147

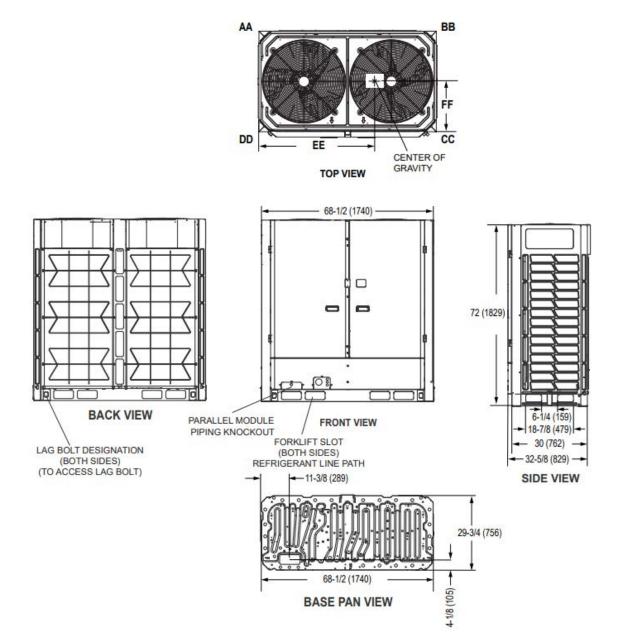

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495903 (202006) Installation and service must be performed by a qualified installer and servicing agency.

©2020 Lennox Industries Inc.



SUBMITTAL DATA - OUTDOOR UNIT VRB360L4M-3G VRB120L4M-3G + VRB120L4M-3G+VRB120L4M-3G VRF Heat Recovery

MULTI-MODULE INFORMATION


Multi-Module Dimensions



NOTE - All the outdoor units manifolded together should be installed at the same elevation.

TOP VIEW

Multi-Module Power

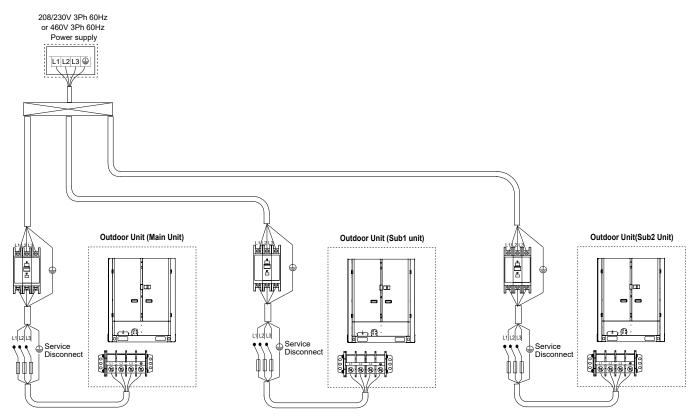

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.