



© 2003 Lennox Industries Inc.  
Dallas, Texas, USA

# ADDENDUM

TP Technical  
Publications  
Litho U.S.A.

504,803M  
07/03

---


## ADDENDUM TO COMPLETEHEAT® INSTALLATION INSTRUCTIONS FOR THE COMMONWEALTH OF MASSACHUSETTS

---

***NOTE - The illustration on the reverse side of this addendum provides a general representation of a CompleteHeat® combination system. This illustration supersedes figure 20 in installation instruction 504728M. The cold water supply and hot water piping shown in the addendum illustration are preferred in the Commonwealth of Massachusetts over those shown in the installation instruction (figures 18, 19, 21, 22, 23, 24, 25, 26 and 27).***

- 1 - The CompleteHeat® System shall not be directly connected to baseboard or radiant heating systems. A heat exchanger or tankless water heater approved by the State Board of Examiners of Plumbers and Gas Fitters shall be used to prevent potable water from entering baseboard or radiant heating systems.
- 2 - Only water coils approved by the State Board of Examiners of Plumbers and Gas Fitters shall be used with potable water heating applications.
- 3 - Should an AM30 water coil need to be replaced, it shall be done by a licensed plumber after obtaining a permit and the replacement coil must be supplied by Lennox Industries.
- 4 - The CompleteHeat® System can only be installed by a licensed plumber.
- 5 - A tee-handle gas cock must be used.

WATER HEATER KBTU INPUT LENNOX IND. HM6 I	FAN COIL LENNOX IND. AM30	CIRCULATING PUMP FOR REMOTE INSTALLATION GREATER THAN 30'
100 & 150	AM3002-40	TACO 008B LENNOX P/N 53J75 OR EQUAL
100 & 150	AM3002/3-70	
100 & 150	AM3003/4-90	
100 & 150	AM3004/5-90	TACO 008B LENNOX P/N 53J76 OR EQUAL
150	AM3003/4-105	
150	AM3004/5-120	

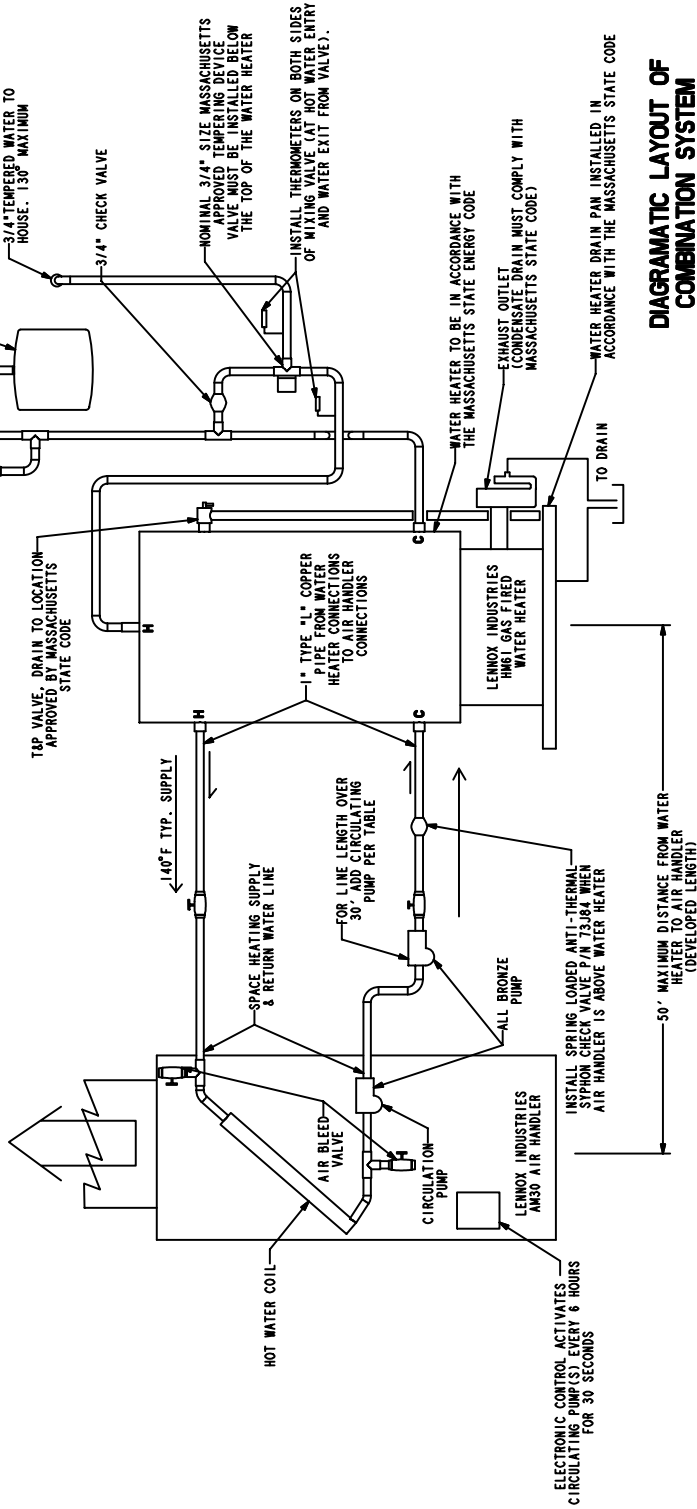

**DIAGRAMATIC LAYOUT OF  
COMBINATION SYSTEM  
FOR MASSACHUSETTS**

ALL WATER PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE MASSACHUSETTS STATE ENERGY CODE