



Installation and Setup Guide

Color Touchscreen Programmable Thermostat

ComfortSense® 5500 (13H13)

Table of Contents

Shipping and Packing List	2
ComfortSense® 5500 Thermostat	3
Features	3

Thermostat Installation

Mounting Thermostat	5
Wiring Thermostat	10

Installer Settings

Menu (Installer Settings)	13
Unit Part (Catalog) and Serial Number	18
Memory Protection	18
Appendix A. Diagnostic Information	19
Appendix B. Supported Configurations	21
Appendix C. Installer Checklist	22

Shipping and Packing List

- 1 ComfortSense[®] 5500 touchscreen, 7-day programmable thermostat with back plate
- 1 Wall plate
- 2 Mounting screws (M3.5x25mm self-tapping screws)
- 2 Wall Anchors

1 each - Homeowner and Installer Guides

NOTE - This thermostat is equipped with automatic compressor protection to prevent potential damage due to short cycling or extended power outages. The short cycle protection provides a 5-minute delay between heating or cooling cycles to prevent the compressor from being damaged.



Read this manual before programming the thermostat.

Use this thermostat only as described in this manual.

ComfortSense[®] 5500 Thermostat (Catalog No. 13H13)

Description

The ComfortSense[®] 5500 thermostat is an electronic 7-day single-stage programmable touch screen thermostat. It also offers enhanced capabilities which include:

- worry-free memory storage feature
- menu-driven touch-screen display
- equipment maintenance reminders

This thermostat supports single-stage non-heat pump units.

Dimensions (H x W x D)

Case dimensions: 3-5/16 x 4-5/16 x 7/8 in. (84 x 110 x 22mm)

Features

Compressor Short Cycle Protection

A 5-minute compressor short cycle protection timer begins when a compressor output is de-energized. Also, if a power loss occurs, the system will go into compressor protection mode and will display a snow flake icon and the word "waiting" next to it if there is a cooling compressor call.



Improper installation, adjustment, alteration, service or maintenance can cause property damage, personal injury or loss of life.

Installation and service must be performed by a licensed professional HVAC installer (or equivalent) or service agency.



This is a 24VAC low-voltage thermostat. Do not install on voltages higher than 30VAC.

Do not short (jumper) across terminals on the gas valve or at the system control to test installation. This will damage the thermostat and void the warranty.

In all applications, the ComfortSense[®] Model 5500 thermostat can only be used with all residential units and approved commercial splitsystem matches, and those which meet the following installation criteria:

- installation uses 18 GAUGE thermostat wire or larger,
- thermostat wire run length DOES NOT EXCEED 300' (91m),
- load from any thermostat connection is 1 AMP or LESS.



Always turn off power at the main power source by switching the circuit breaker to the OFF position before installing or removing this thermostat.

All wiring must conform to local and national building and electrical codes and ordinances.

THERMOSTAT INSTALLATION

Before beginning installation, note the type of equipment, number of stages, and any accessories being installed. This thermostat is a 24VAC low-voltage thermostat and requires a common wire to the thermostat to operate.

DO

- Shut off all power to system before installing.
- Read this entire document, noting which instructions pertain to your equipment and system requirements.
- Make sure that all wiring conforms to local and national building and electrical codes and ordinances.
- load from any thermostat connection is less than 1 AMP.

DO NOT

- Install On voltages higher than 30VAC.
- Short (jumper) across terminals on the gas valve or at the system control to test installa-

tion. This will damage the thermostat and void the warranty.

- Install on outside walls or in direct sunlight
- Thermostat wire run length DOES NOT EX-CEED 300' (91m),

INSTALLING THERMOSTAT

- 1. Unpacked the thermostat and open the case with a thin-blade screwdriver. Place between wall base and unit and twist to separate unit from base.
- Select a location for the thermostat about 5 feet (1.5m) above the floor in an area with good air circulation at average temperature.
- 3. Do not install the thermostat where it can be affected by:
 - Drafts or dead spots behind doors and in corners.
 - Not close to entrance or automatic doors.
 - Not close to heat generating equipment such as kitchen equipment.

- Not in an enclose environment unless a remote indoor sensor is used.
- Hot or cold air from ducts.
- Radiant heat from sun or appliances.
- Concealed pipes and chimneys.
- Unheated (uncooled) areas such as an outside wall behind the thermostat.








Figure 1. Removing Back Plate


4. Use steps **A** through **J** (step **J** applicable when using provided wall plate) to install the thermostat.





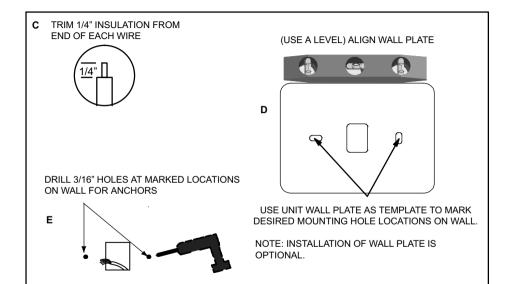

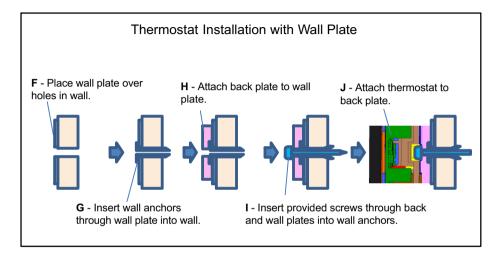

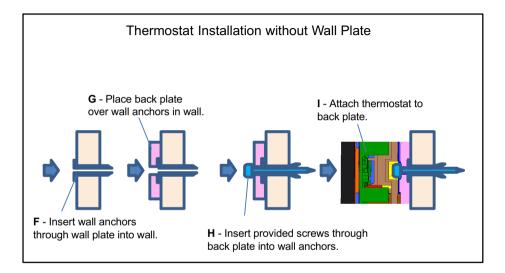


WIRING THERMOSTAT


- Connect wiring between thermostat, indoor unit, and outdoor unit as shown in the appropriate wiring diagram.
- 2. Seal the hole in the wall with a suitable material to prevent drafts from entering the thermostat case.
- 3. Configure thermostat and equipment for system type (gas or electric heat), program the thermostat, and test system.

TERMINAL DESIGNATIONS

- C Common 24 VAC
- G Fan relay
- W1 1st stage heating (electric or gas heat)
- Y1 1st stage cooling
- R 24VAC power

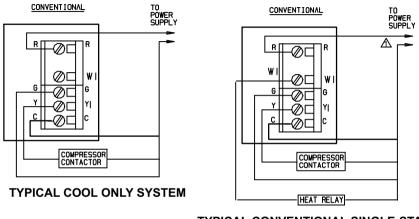

TYPICAL CONVENTIONAL SINGLE-STAGE HEAT / COOL SYSTEM



A POWER SUPPLY. PROVIDE DISCONNECT MEANS AND OVERLOAD PROTECTION AS REQUIRED

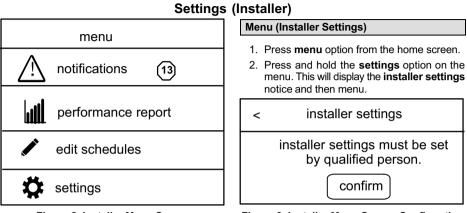


Figure 2. Installer Menu Screen

Figure 3. Installer Menu Screen Confirmation

3. Available options are as follows:

< installer settings	
system setup	>
residual cool	>
dead band	>
smooth set recovery	>
contact information	>
stage 1 diff	>
temperature offset	>
compressor protect	>
custom reminder	>
reset setting	>
energy saving default	>
system test mode	>

SYSTEM SETUP

Sets the thermostat heat options.

<	system settings	
indoor unit s	settings	
No heat		
gas/oil		1
electric		

Figure 4. System Setup

RESIDUAL COOL

Default is 0 seconds. This is the time, in seconds, that the fan runs after a call for cooling is satisfied in order to deliver any residual cooling ability from the coil and ductwork into the conditioned space. Options are 0, 30, 60, 90 and 120 minutes. Press < to return to previous menu.

DEADBAND

Default is 3°F (2°C). The deadband setting is the minimum difference between the cooling and heating set points. This setting is used in cool/heat mode to ensure smooth equipment operation. The deadband is adjustable from 3 to 8°F. Use the + or - option to select desired deadband. Press < to return to previous menu.

SMOOTH SET RECOVERY(SSR)

Options are enable or disable. Default is Disabled. When enabled, smooth set back begins recovery up to two hours before the programmed time so that the programmed temperature is reached at the corresponding programmed event time. Assume 12°F per hour for gas/electric heating and 6°F per hour for first stage compressor based cooling. With Smooth Set Back disabled, the control will start a recovery at the programmed time.

DEALER INFORMATION

This allows the installer to add dealer name, address, phone, email, website and number.

Press < to return to previous menu.

STAGE 1 DIFF

The default is 1.0° F but can be programmed between 0.5° and 8.0° F in 0.5° F increments. Press < to return to previous menu.

TEMPERATURE OFFSET

Default is 0°F. This setting can be used to offset the displayed space temperature by up to +/-5°F. This offset also applies to the control temperature. Press < to return to previous menu.

COMPRESSOR PROTECT

Default is ON and it can be turned OFF, however only for one compressor cycle and then it will revert back to ON. If the system is running in compressor protection, the home screen displays "WAIT" only if there is cooling call for the compressor (Y1).

If compressor protection is running and there is a demand for electric heating, the system waits for the compressor protection timer to expire.

CUSTOM REMINDERS

Two additional reminders may be created using a text message. This will appear in the list of reminders and the user can then select the time for the reminder to be displayed. Scroll to CUSTOM REMINDER 1 or 2. Press ENTER. To create a reminder, press EDIT.

A cursor will appear on the second line. Use the arrows to scroll through letters, numbers and special characters. When the desired character appears, press NEXT to advance to the right by one character. Continue until the message is complete (up to 19 characters). When finished, press < to return to previous menu.

RESET SETTINGS

To reset the thermostat to factory defaults, scroll to RESET SETTINGS and press to select. Read the message and to continue press **CONFIRM**.



RESET SETTINGS erases all programming and returns the thermostat to the factory conditions, including the installer settings. Use this only as a last resort.

ENERGY SAVING DEFAULT


Energy saving recommended set points for heating and cooling can help save energy. The time and temperatures reference in table 1 are pre-programmed into the thermostat to achieve energy savings.

Scroll to ENERGY SAVING DEFAULT and press to select. Read the message on the screen and to continue, press **CONFIRM**.

Time	Time Heating Coolin			
Wake	70°F (21°C)	78°F (25°C)		
Leave	62°F (17°C)	85°F (29°C)		
Return	70°F (21C)	78°F (25°C)		
Sleep	62°F (17°C)	82°F (28°C)		

SYSTEM TEST MODES

After the thermostat has been installed and set-up, the installer may run a system test function (accessed through the installer settings menu), to test all cooling, heating and FAN outputs. Scroll to SYSTEM TEST MODES and press ENTER; select TEST OUTPUTS and press ENTER.



Pressing the **OFF** button next to the desired option will change the status to **ON** and will enable the relay for that terminal. Pressing again will turn **OFF** the relay. Press the left arrow (<) to exit the system test mode.

Risk of equipment damage.

Can cause compressor failure.

All HVAC components can be tested to confirm the signals between thermostat and unit are being sent and were received.

NOTES: After 5 minutes without a test being initiated, the test modes is disabled and system goes back to the normal mode (i.e. HOME screen).

When in SYSTEM TEST MODE, the compressor minimum off timer is bypassed.

Unit Part (Catalog) & Serial Numbers

A label on the back of the thermostat is visible through an opening in the back of base plate. This identifies the Lennox Catalog Number, Part Number and Serial Number. Separate the base plate from the thermostat to see additional manufacturing information.

Memory Protection

The thermostat stores all the information concerning its programming (state, mode, program information, last temperature measured) in a nonvolatile memory.

This function avoids the loss of the state of the thermostat when a power-down occurs. The only thing that might be lost is the clock and date information, however, a lithium battery will remember clock / date information for as long as it has a charge (approximately 24 hours). When power down occurs (due to a power outage) the thermostat is able to switch off all relays. When power is restored the thermostat will be in heat /cool mode so either mode can run to re-satisfy the temperature setting in the home. Day and time (schedules) may be off due to battery power loss.

Appendix A. Diagnostic Information

Error Code	Screen Text	Priority 0:high 1:middle 2:low	Message Type	Condition	System Action	Action to Clear / Recovery Condition
4	high temperature protection	0	critical	High temperature protec- tion when outdoor ambient temperature exceeds 96°F (35.6°C).	All stages of heat are turned off by safety relay. This error is displayed on notifi- cation screen.	Once tempera- ture drops be- low 96°F (35.6°C), the system resume operation.
5	temperature sensor error	0	critical	Local temperature sensor is out of range -40°F to 158°F. There is a finite difference between main thermistor and sub-thermistor which is greater than $5^{\circ}F$.	Indoor temp is displayed as "" on the home screen. This will STOP all temperature related operation. All stages of heat are turned off by safety relay. This error is displayed on notifi- cation screen.	Either thermo- stat will have to be replace or if the sensor re- tums to normal operating range, the error mes- sage will auto- matically clear and the system will resume op- eration.

Error Code	Screen Text	Priority 0:high 1:middle 2:low	Message Type	Condition	ondition System Action	
7	memory error	0	critical	EEPROM error (Power ON)	System will restore using to En- ergy Star defaults and resume operations. This error is displayed on notifi- cation screen.	Thermostat will need to be re-
8	memory error	0	critical	EEPROM error (Operating)	System will operate in normal mode operation until power off. This error is displayed in notifi- cation screen.	placed.

Appendix B. Supported Configurations

This thermostat supports air conditioner systems only with single speed compressors.

	Backup/ Indoor Heat	Comp. stages	Indoor Heat Stages	Heat Stages	1st Heat Stage	Cool Stages	1st Cool Stage
Non HP	GAS/OIL OR ELEC.	1	1	1	W1	1	Y1
Non HP	NONE	1	0			1	Y1

Appendix C. Installation Checklist

ltem Number	Item	Yes	No
1	Is the thermostat level where mounted on the wall?		
2	Is the thermostat installed away from direct sunlight or dis- charge air vents?		
3	Has the thermostat been wired correctly based on the type of equipment installed (air handler, outdoor unit and accessories?		
4	Is the thermostat wiring secured tightly to the terminals?		
5	Is the common wire (terminal C) connected?		
6	Has the System Test Mode located under the installer settings been used to verify proper operation?		

INDEX

С

Checklist, 22 Compressor Protection, 15 Compressor Short Cycle Protection, 3 Custom Reminders, 16

D

Deadband, 15 Dealer Information, 15 Diagnostic Information, 19 Dimensions, 3

Ε

Energy Saving Default, 16

F

Features, 3

Μ

Memory Protection, 18 Mounting Screws, 2

R

Reset Settings, 16 Residual Cool, 15

S

Screws, 2 Serial Numbers, 18 Settings - Installer, indoor unit settings, gas/oil, electric, 14 Smooth Set Back (SSR), 15 Stage 1 Differential, 15 Supported Configurations, 21 System Test Modes, 17

Т

Temperature Offset, 15 Thermostat Installation, 5 23

U

Unit Part (Catalog) & Serial Numbers, 18

W

Wall Anchors, 2 Wall Plate Removal, 6 Wiring Diagrams, 11, 12 Wiring Thermostat, 10

® U.S. Registered Trademark Model: 13H13 507501-01 3/2015



©2015 Lennox Industries Inc. Dallas, Texas, USA