


24V POWER

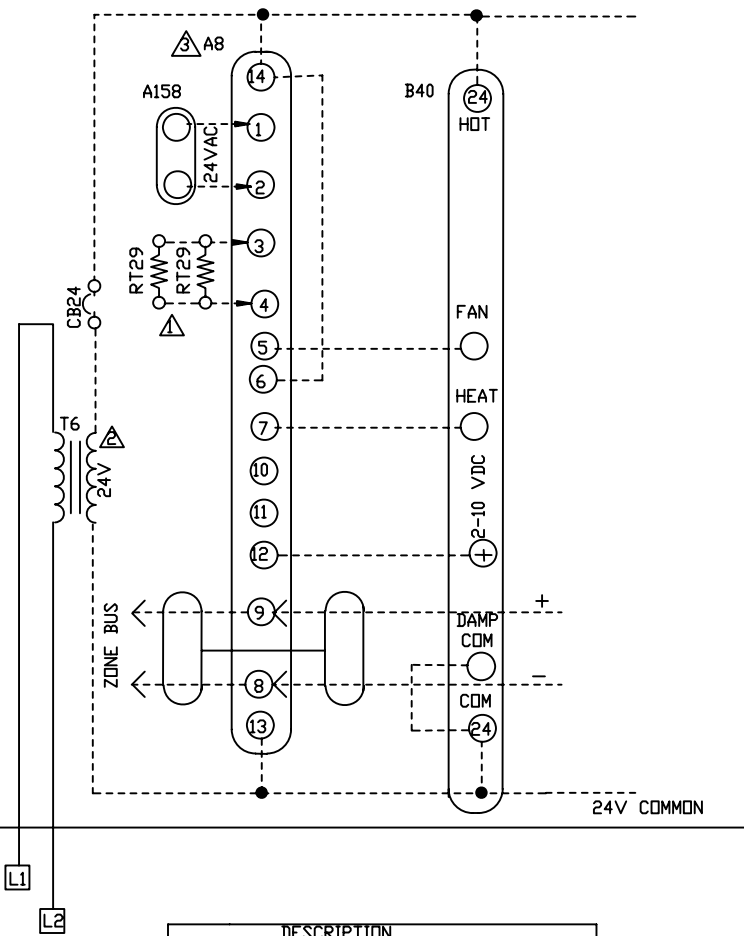

KEY	DESCRIPTION
A8	THERMOSTAT-ELECTRONIC, ZONE
A158	CONTROL-OCCUPANCY/OPT
B40	ZONE BOX,FAN POWERED
CB24	CIRCUIT BREAKER-TRANS T6
RT29	SENSOR-AVERAGING, 11K OHM
T6	TRANSFORMER-ZONE

△ OPTIONAL AVERAGING SENSOR.
ONE TO FOUR MAY BE USED.
(TWO ARE SHOWN)

△ OPTIONAL TRANSFORMER

△ A8-SELECT ONE OF FOUR CONTROL VARIATIONS
WITH OR WITHOUT DISPLAY.
1-TEMP ONLY
2-TEMP AND RH
3-TEMP AND CO2
4-TEMP,RH AND CO2

←————→ DESIGNATES OPTIONAL COMPONENTS

----- CLASS II FIELD WIRING

WIRING DIAGRAM		7/06
ACCESSORIES		
CONTROL WIRING FOR TYPICAL FAN POWERED ZONE TERMINAL BOX W/HEAT AND COMFORT SENSOR ZONING		
CONTROL SECTION E6		
Supersedes Form No.	New Form No. 535,520W	