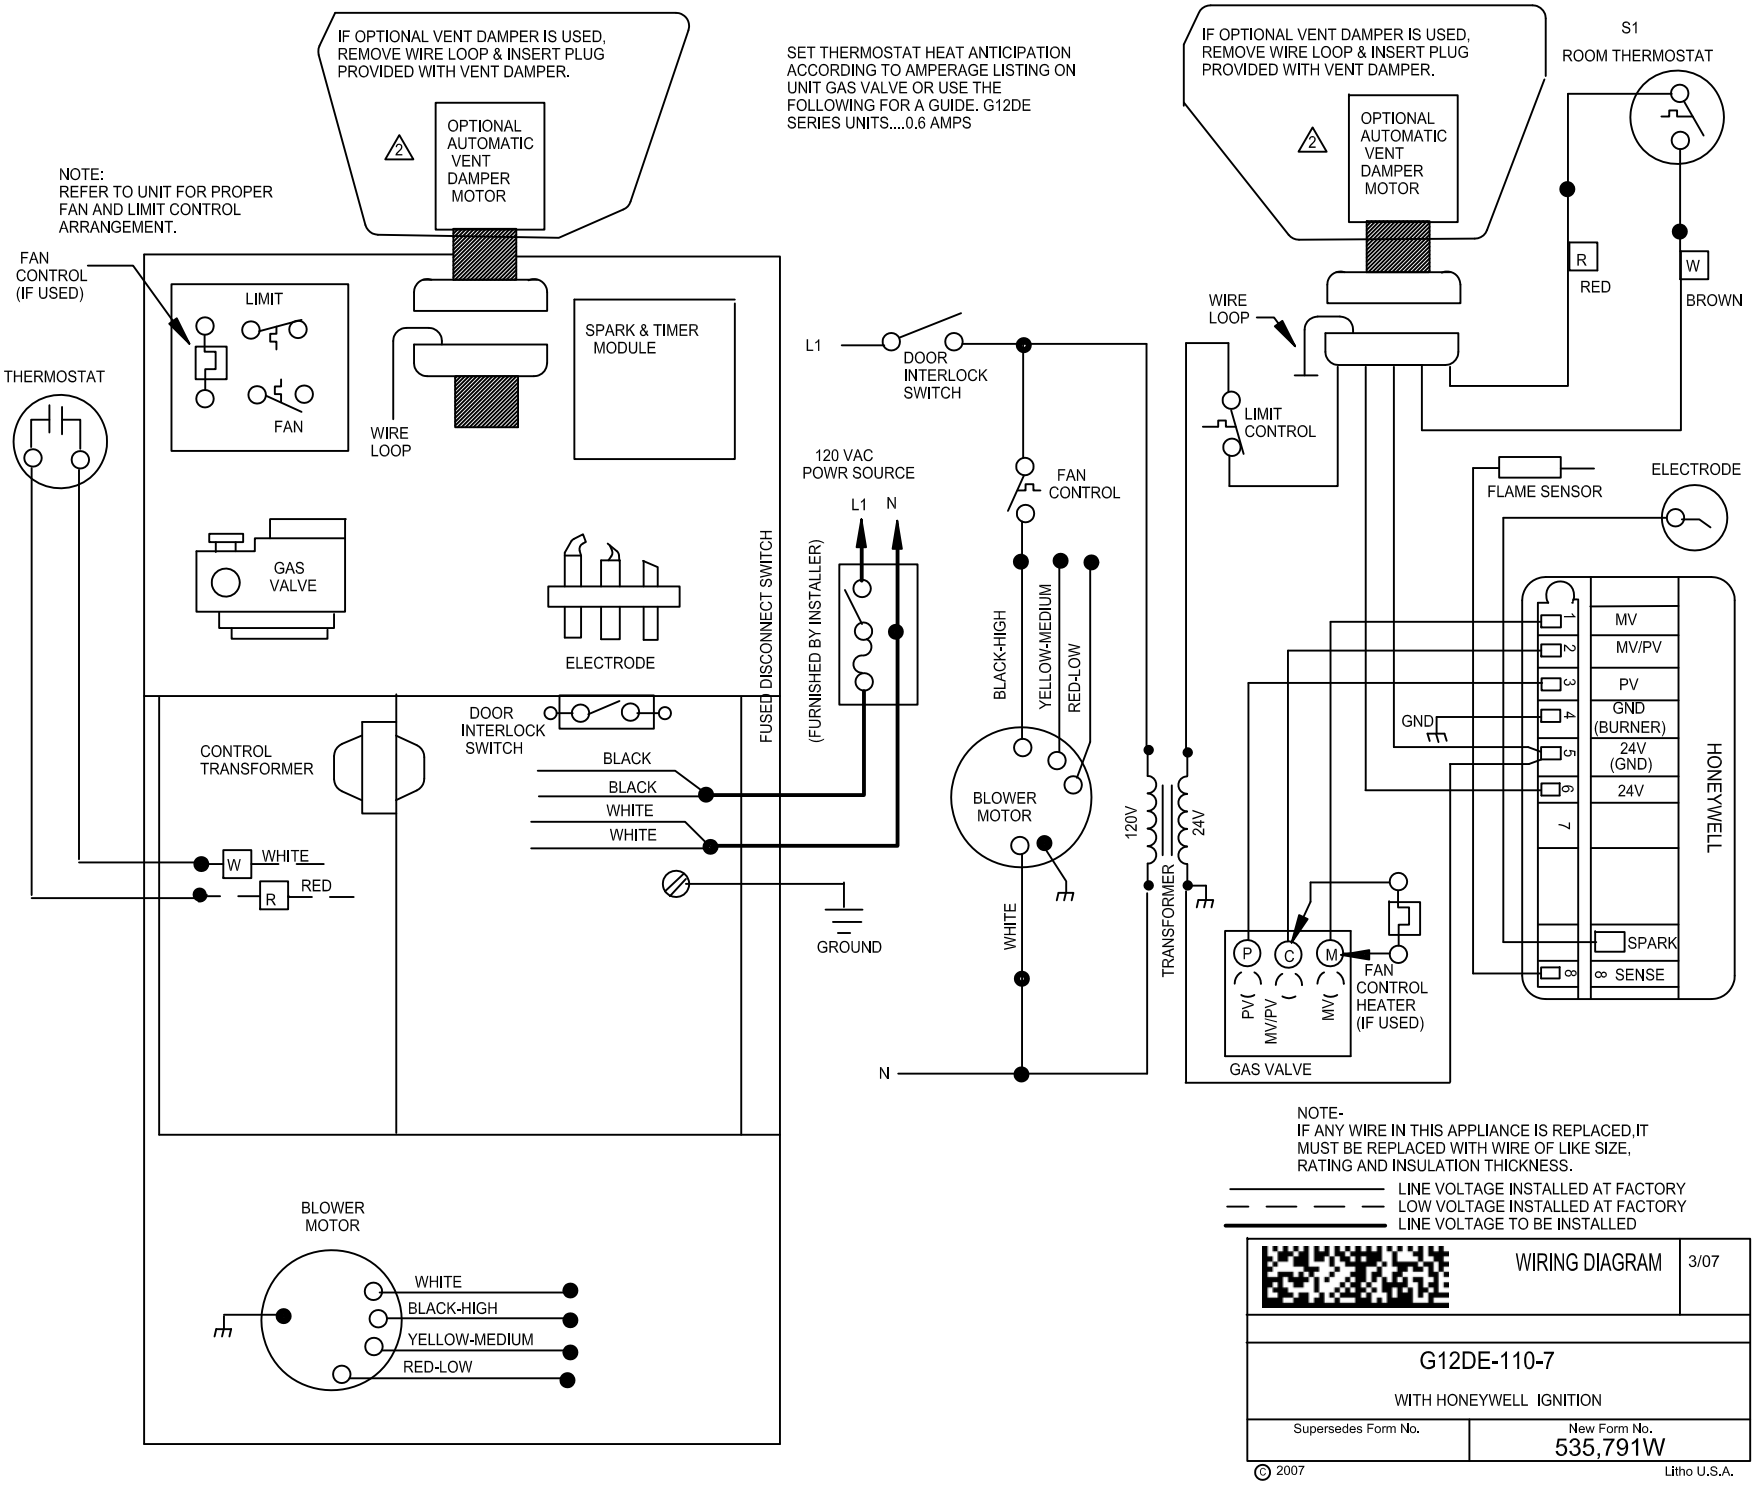

NOTE-
IF ANY WIRE IN THIS APPLIANCE IS REPLACED,IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING AND INSULATION THICKNESS.

LINE VOLTAGE INSTALLED AT FACTORY
LOW VOLTAGE INSTALLED AT FACTORY
LINE VOLTAGE TO BE INSTALLED

WIRING DIAGRAM	3/07
G12DE-110-7 WITH HONEYWELL IGNITION	
Supersedes Form No.	New Form No. 535,791W

© 2007
Litho U.S.A.