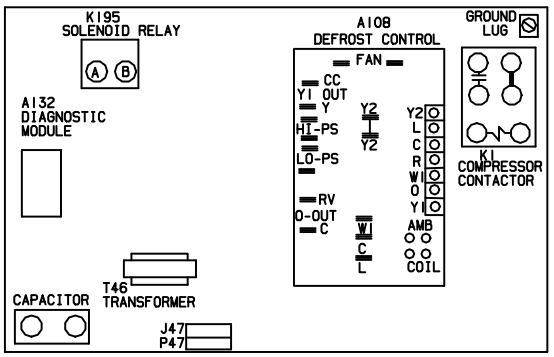



NOTE-

1. FOR USE WITH COPPER CONDUCTORS ONLY. REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVER-CURRENT PROTECTION SIZE
2. REFER TO COMPRESSOR IN UNIT FOR ACTUAL TERMINAL ARRANGEMENT.
3. WARNING- ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES.
4. REMOVE JUMPER FOR TWO STAGE COOL
5. RT14 SENSOR, OUTDOOR TEMP (OPTIONAL)
6. S23 CLOSES AT LOW AMBIENT TEMPERATURES TO OPERATE SECOND STAGE COMPRESSOR ON HEATING
7. L34 SOLENOID IS LOCATED IN COMPRESSOR, COIL IS 24VDC, DO NOT CONNECT 24VAC TO COIL TERMINALS
8. S11, K159 AND K58 ARE OPTIONAL LOW AMBIENT CONTROLS

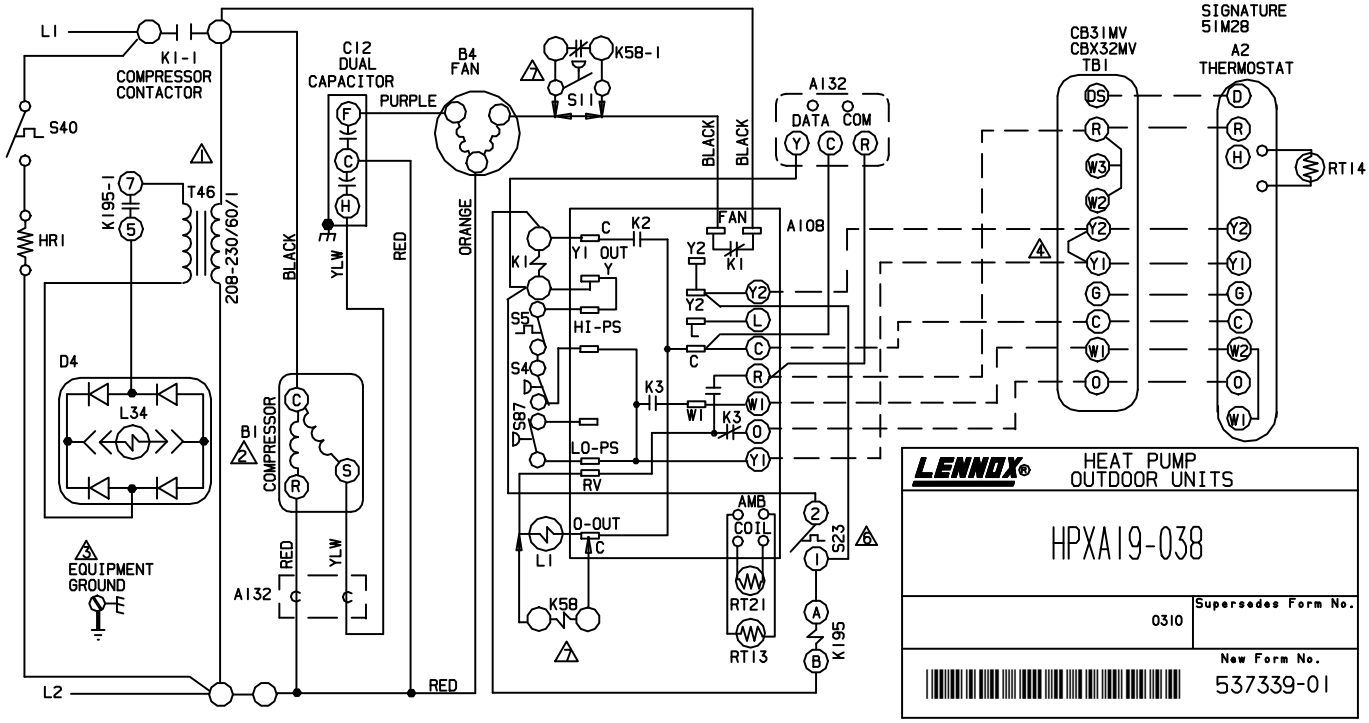

LENNOX®

HEAT PUMP
OUTDOOR UNITS

HPXA19-038

0310	Supersedes Form No.
	New Form No. 537339-01

©2010 Lennox Industries Inc.

Litho U.S.A.