


24 VAC POWER

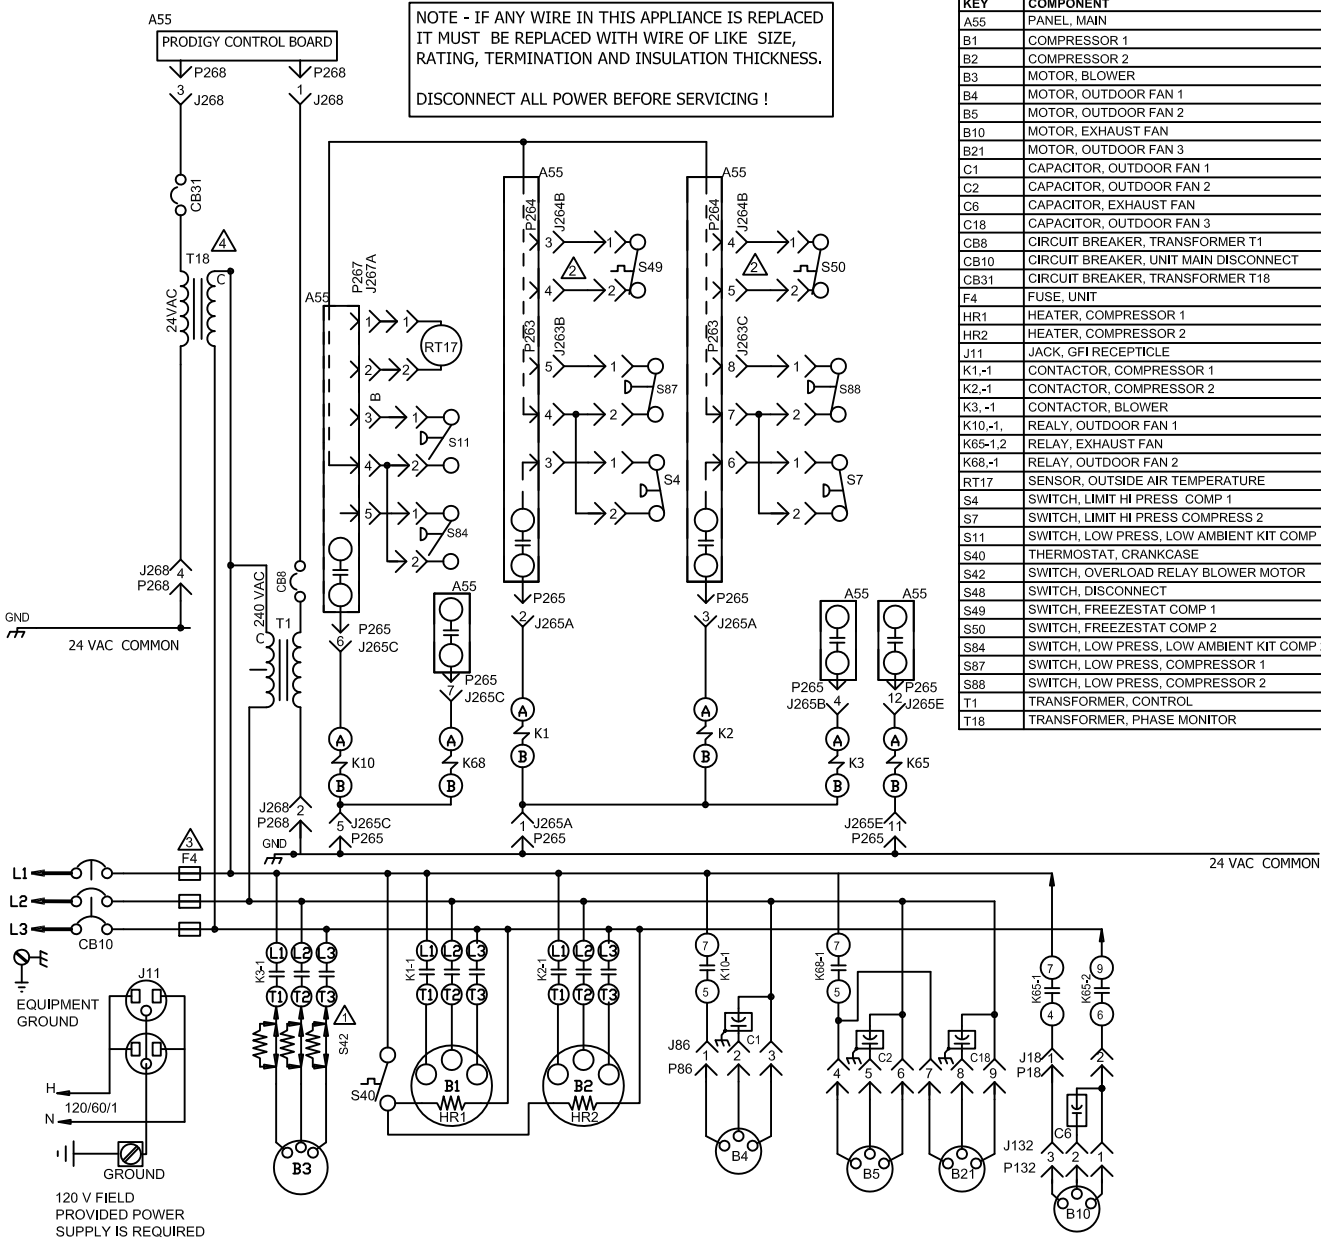

120 V FIELD PROVIDED POWER SUPPLY IS REQUIRED

NOTE: USE COPPER CONDUCTORS ONLY

J/P	JACK/PLUG DESCRIPTION
18	EXHAUST FAN
86	OUTDOOR FAN INTERFACE
132	EXHAUST FAN MOTOR
263	HIGH AND LOW PRESSURE SWITCHES
264	BLOWER DECK
265	CONTACTORS AND RELAYS
267	OUTDOOR FAN AREA
268	TRANSFORMER T1 POWER

- ▲ S42 USED ON UNITS WITH HIGH EFFICIENCY MOTORS
- ▲ S49 AND S50 ARE PART OF 5VDC CIRCUIT
- ▲ USED ON SCC UNITS WITH ELECTRIC HEAT ONLY
- ▲ MOVE WIRE FROM 240 TO 208 TAP ON T1 AND T18 TRANSFORMERS FOR 208 LINE VOLTAGE APPLICATIONS.

← DENOTES OPTIONAL COMPONENTS
 — LINE VOLTAGE FIELD INSTALLED

02/12		STRATEGOS B-BOX WIRING DIAGRAM 537457-01	02/12
COOLING - CAV			
SCC/SGC - 120 - G, J, M, Y			
SECTION B			REV 2
Supersedes		New Form No. 537457-01	
© 2012		Lennox Commercial	