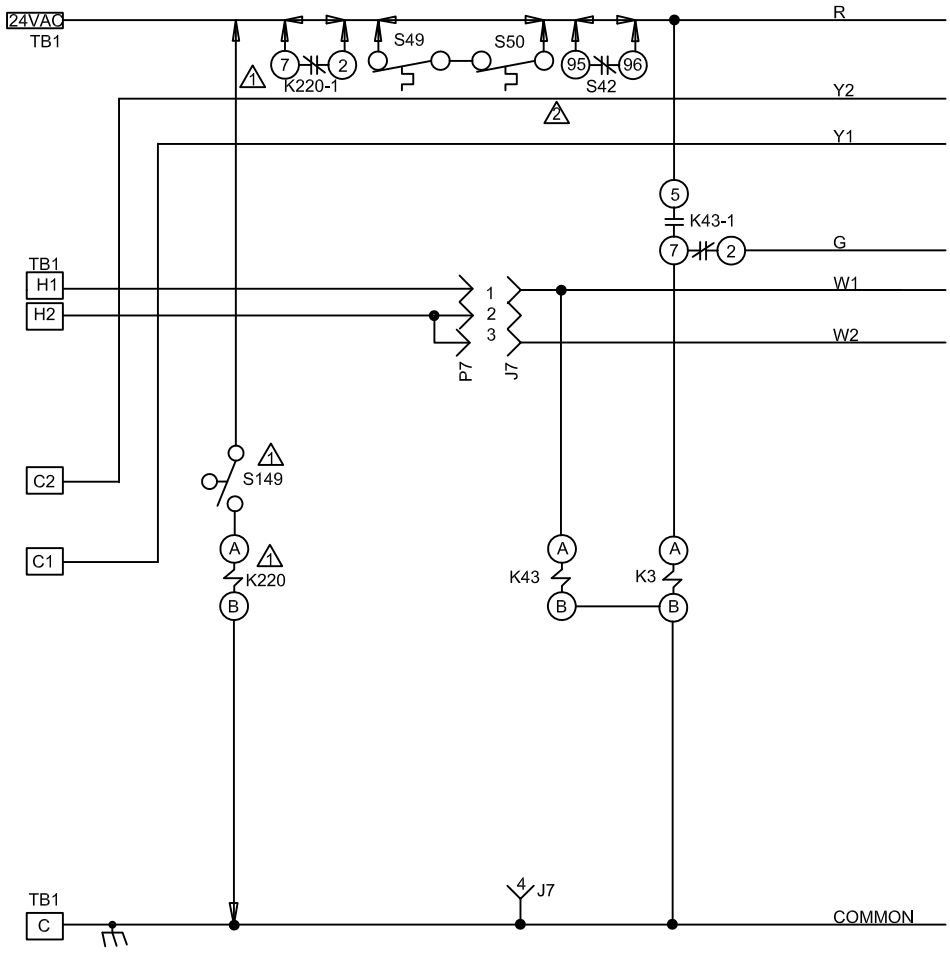

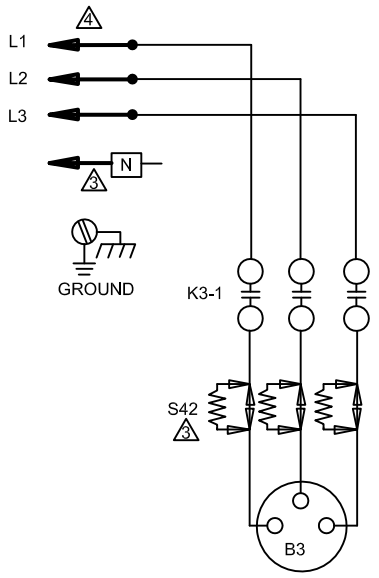

KEY	COMPONENT
B3	MOTOR-BLOWER
J7	JACK-ELECT HT SUB-BASE KIT
K3,-1	RELAY-BLOWER
K43,-1	RELAY-ECONOMIZER BLOWER
K220,-1	RELAY-OVERFLOW
P7	PLUG -ELECT HT SUB-BASE KIT
S42	RELAY-OVERLOAD,BLOWER MTR
S49	SWITCH-FREEZESTAT COMPRESSOR 1
S50	SWITCH-FREEZESTAT COMPRESSOR 2
S149	SWITCH-OVERFLOW
TB1	TERMINAL STRIP-CLASS II VOLT

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

DENOTES OPTIONAL COMPONENTS

1. S149 SWITCH AND K220 RELAY MAY BE FIELD SUPPLIED OR USE AVAILABLE KIT
2. S50 USED ON TWO STAGE UNITS
3. "M" VOLTAGE UNITS ONLY
4. FOR USE WITH COPPER CONDUCTORS ONLY

01/12	WIRING DIAGRAM 537529-01	01/12
BLOWER		
TAA 072 - 240 - G,J,M,Y		
SECTION B1		REV 0
Supersedes 535,769W	New Form No. 537529-01	

© 2012 Lennox Commercial