
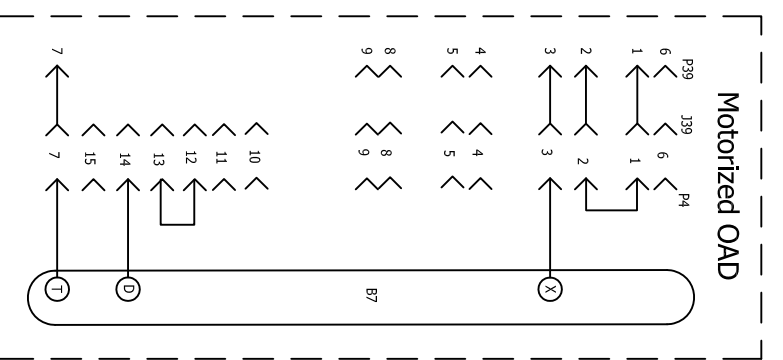


P VOLT	KW	HE1	HE2	HE3
048,060	5	5	5	5
936	7.5	7.5	7.5	7.5
10	15	15	15	15
22.5	7.5	7.5	7.5	7.5

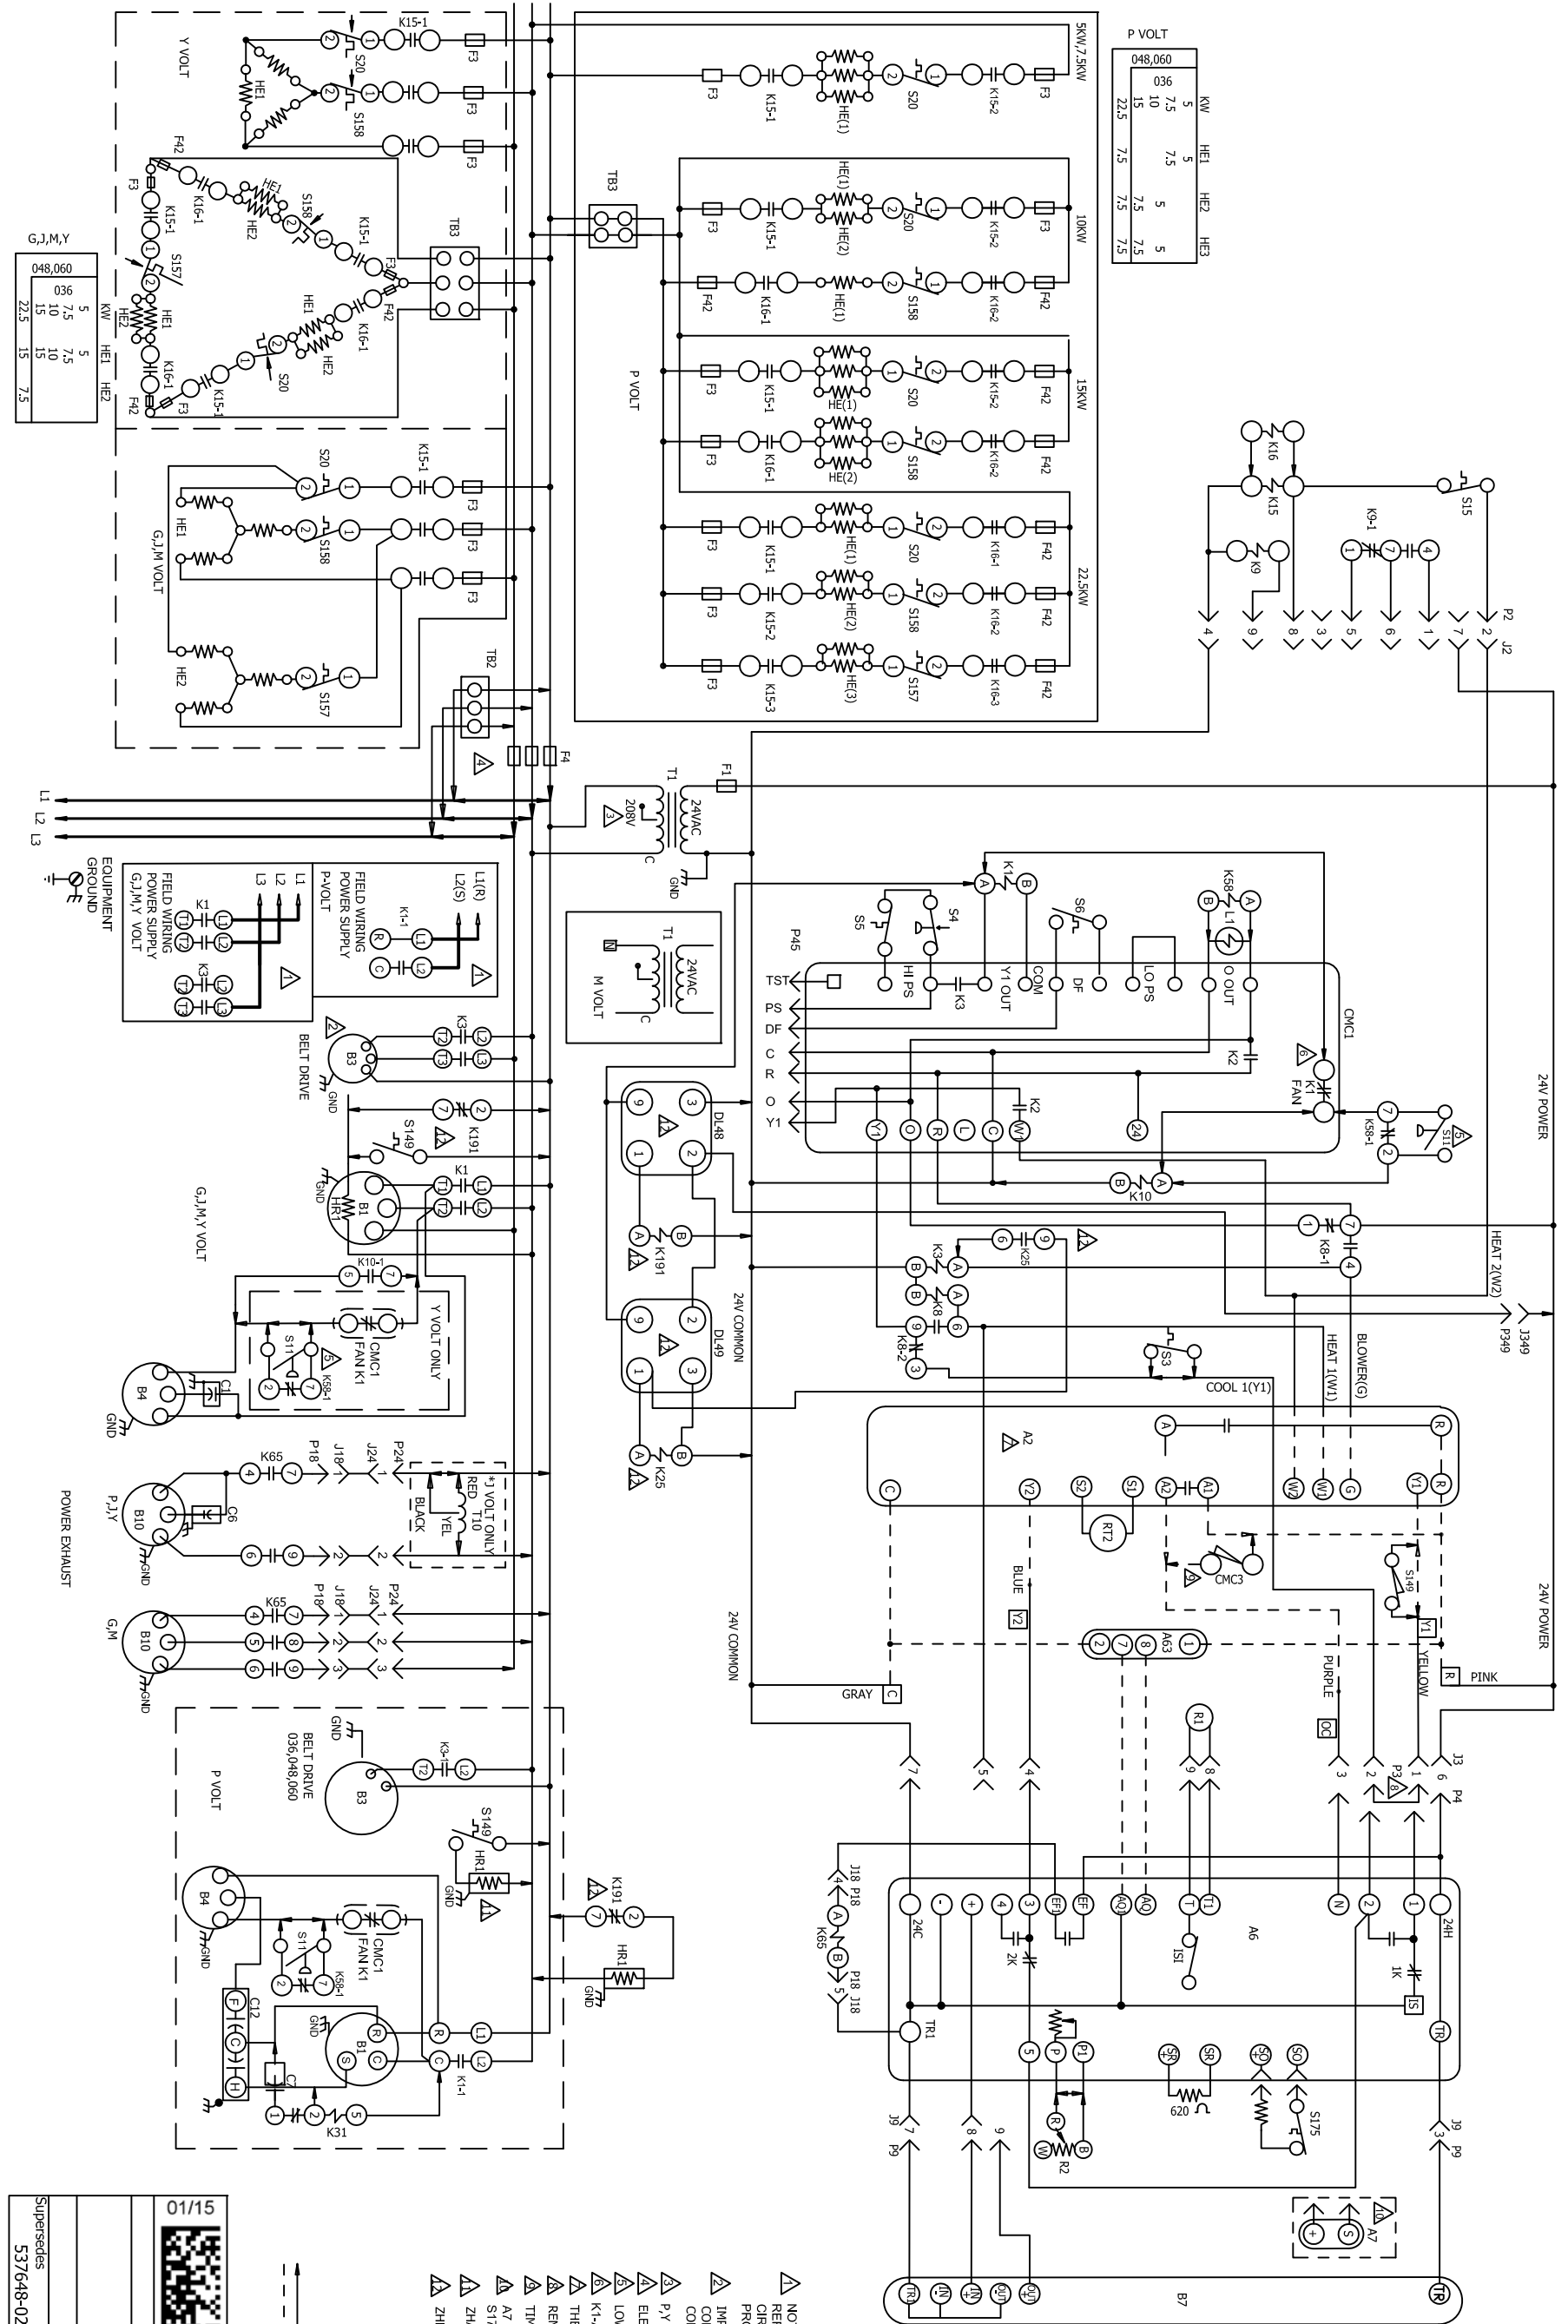

- ⚠ NOTE - FOR USE WITH COPPER CONDUCTORS ONLY REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- ⚠ IMPORTANT: TO PREVENT MOTOR BURNOUT, NEVER CONNECT MORE THAN ONE MOTOR LEAD TO ANY ONE CONNECTION. TAPE UNUSED MOTOR LEADS
- ⚠ P.Y VOLT T1 WITH 208V TAP
- ⚠ ELECTRIC HEAT FIELD OPTION
- ⚠ LOW AMBIENT KIT
- ⚠ K1-A TO K1-FAN JUMPER ON G.J.M UNITS ONLY
- ⚠ THERMOSTAT/SENSOR SUPPLIED BY USER
- ⚠ REMOVE P3 WHEN ECONOMIZER OR OADM IS USED
- ⚠ TIME CLOCK CONTACTS (OPT) CLOSED OCCUPIED
- ⚠ A7 ENTHALPY SENSOR MAY BE USED INSTEAD OF S175 TEMPERATURE SWITCH AND RESISTOR
- ⚠ ZHA MODELS ONLY
- ⚠ ZHB MODELS ONLY

--- DESIGNATES OPTIONAL WIRING
 - - - CLASS II FIELD WIRING

01/15	WIRING DIAGRAM	01/15
537648-03		
UNIT DIAGRAM		
ZH - 036, 048, 060		
SECTION ALL		
Supersedes	New Form No.	REV. 0
537648-02	537648-03	