

KEY	DESCRIPTION
CB1	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT 1
HE2	ELEMENT-ELECTRIC HEAT 2
HE3	ELEMENT-ELECTRIC HEAT 3
K1	CONTACTOR
P2	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT PRIMARY ELECT HEAT
S20	SWITCH-LIMIT SECONDARY ELECT HEAT



NOTE: USE COPPER CONDUCTORS ONLY

REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.

EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

NOTE-USE 50 AMP CIRCUIT BREAKER

LINE VOLTAGE FIELD INSTALLED

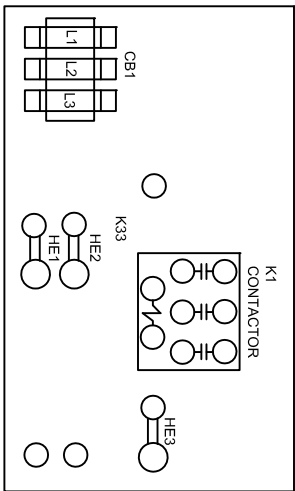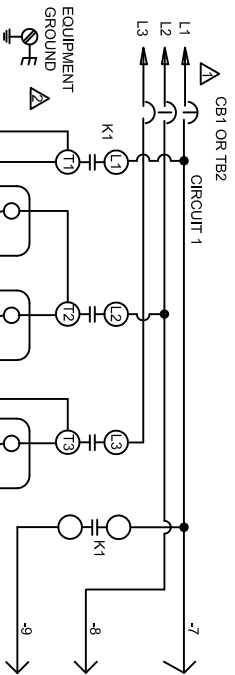

KEY	DESCRIPTION
CB1	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT 1
HE2	ELEMENT-ELECTRIC HEAT 2
HE3	ELEMENT-ELECTRIC HEAT 3
K1	CONTACTOR
P2	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT PRIMARY ELECT HEAT
S20	SWITCH-LIMIT SECONDARY ELECT HEAT


NOTE: USE COPPER CONDUCTORS ONLY

REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.

EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

NOTE-USE 50 AMP CIRCUIT BREAKER

LINE VOLTAGE FIELD INSTALLED

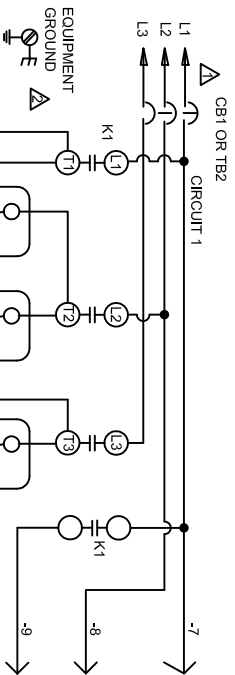

HEATING-ELECTRIC

ECB29-15CB-4-Y

Supersedes

0714



Form No. 537771-01

© 2011

Litho U.S.A.

HEATING-ELECTRIC

ECB29-15CB-4-Y

Supersedes

0714



Form No. 537771-01

© 2011

Litho U.S.A.

4" X 7-1/2"