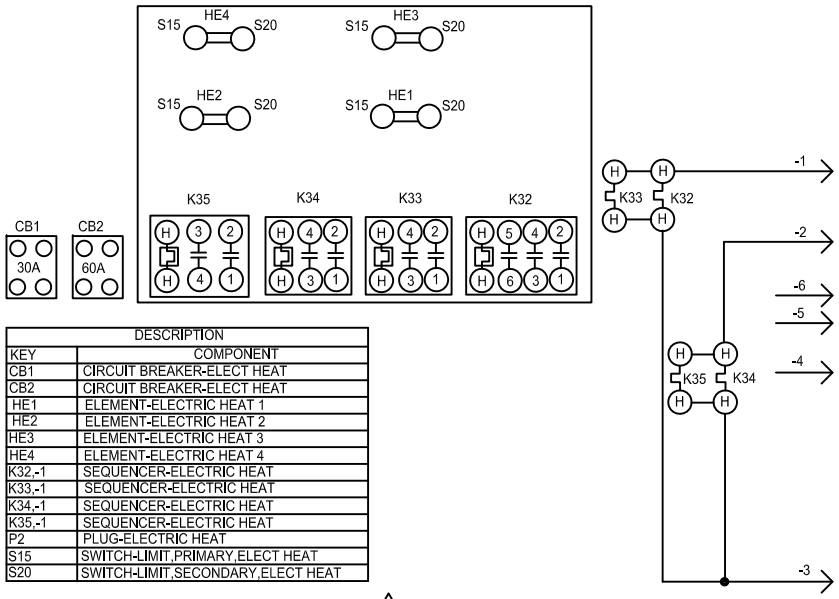

DESCRIPTION	
KEY	COMPONENT
CB1	CIRCUIT BREAKER-ELECT HEAT
CB2	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT 1
HE2	ELEMENT-ELECTRIC HEAT 2
HE3	ELEMENT-ELECTRIC HEAT 3
HE4	ELEMENT-ELECTRIC HEAT 4
K32,-1	SEQUENCER-ELECTRIC HEAT
K33,-1	SEQUENCER-ELECTRIC HEAT
K34,-1	SEQUENCER-ELECTRIC HEAT
K35,-1	SEQUENCER-ELECTRIC HEAT
P2	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT,PRIMARY,ELECT HEAT
S20	SWITCH-LIMIT,SECONDARY,ELECT HEAT

⚠1 REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.

NOTE: USE COPPER CONDUCTORS ONLY

LINE VOLTAGE FIELD INSTALLED

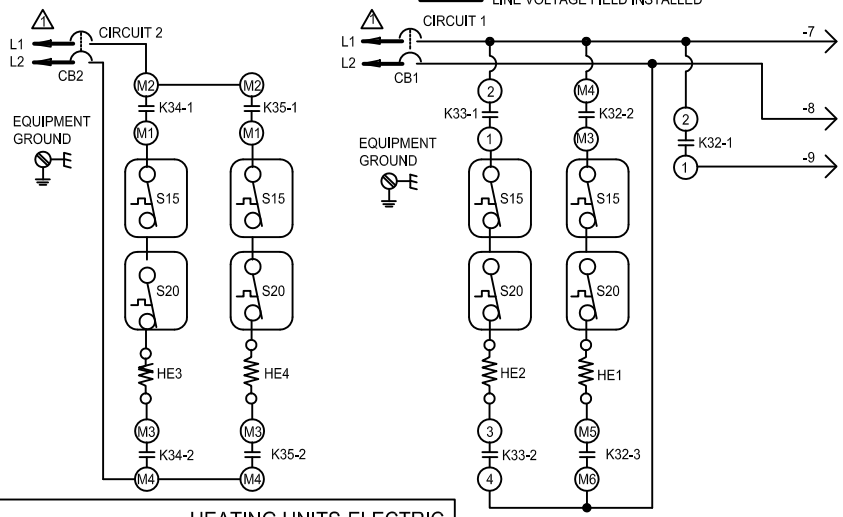

HEATING UNITS-ELECTRIC	
AEHK20CB-1	
2 HEAT 2 COOL	
	Supersedes
1114	Form No. 537804-01

© 2011 Litho U.S.A.

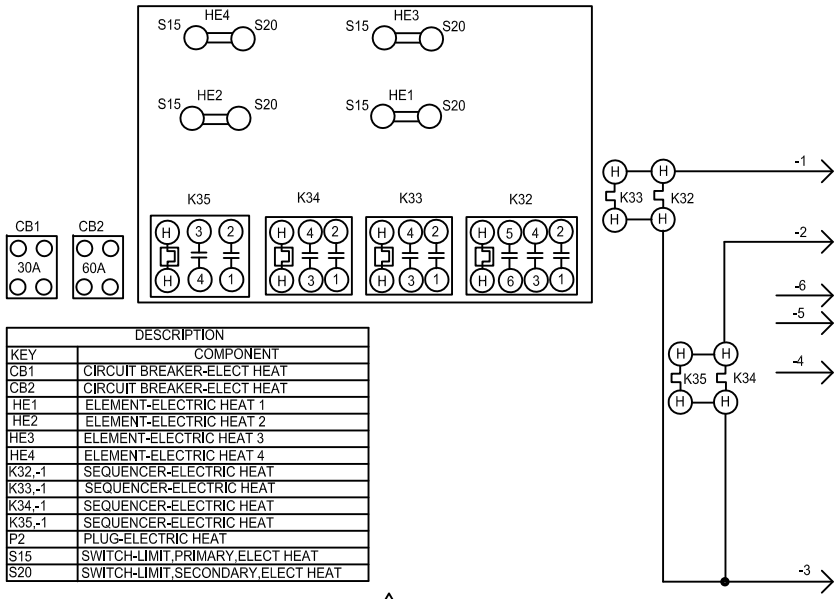

DESCRIPTION	
KEY	COMPONENT
CB1	CIRCUIT BREAKER-ELECT HEAT
CB2	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT 1
HE2	ELEMENT-ELECTRIC HEAT 2
HE3	ELEMENT-ELECTRIC HEAT 3
HE4	ELEMENT-ELECTRIC HEAT 4
K32,-1	SEQUENCER-ELECTRIC HEAT
K33,-1	SEQUENCER-ELECTRIC HEAT
K34,-1	SEQUENCER-ELECTRIC HEAT
K35,-1	SEQUENCER-ELECTRIC HEAT
P2	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT,PRIMARY,ELECT HEAT
S20	SWITCH-LIMIT,SECONDARY,ELECT HEAT

⚠1 REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.

NOTE: USE COPPER CONDUCTORS ONLY

LINE VOLTAGE FIELD INSTALLED

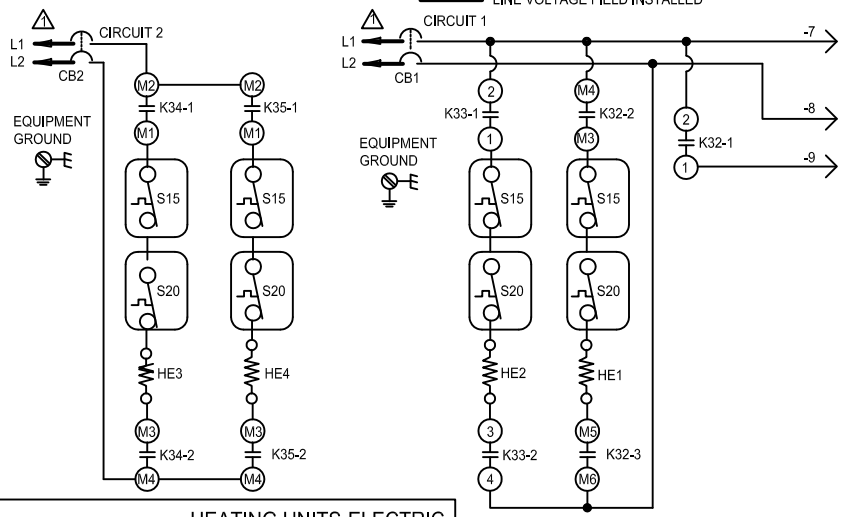

HEATING UNITS-ELECTRIC	
AEHK20CB-1	
2 HEAT 2 COOL	
	Supersedes
1114	Form No. 537804-01

© 2011 Litho U.S.A.