

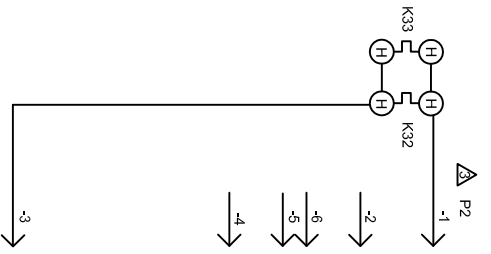


KEY	COMPONENT	DESCRIPTION
CB1	CIRCUIT BREAKER-ELECT HEAT	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT1	ELEMENT-ELECTRIC HEAT1
HE2	ELEMENT-ELECTRIC HEAT2	ELEMENT-ELECTRIC HEAT2
K33	RELAY-ELECTRIC HEAT	RELAY-ELECTRIC HEAT
K32	RELAY-ELECTRIC HEAT	RELAY-ELECTRIC HEAT
P2	PLUG-ELECTRIC HEAT	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT PRIMARY ELECT HEAT	SWITCH-LIMIT PRIMARY ELECT HEAT
S20	SWITCH-LIMIT SECONDARY ELECT HEAT	SWITCH-LIMIT SECONDARY ELECT HEAT
TB2	TERMINAL STRIP-UNIT	TERMINAL STRIP-UNIT

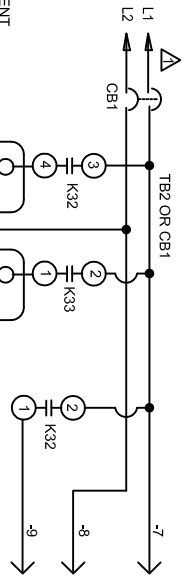


- NOTE: USE COPPER CONDUCTORS ONLY
- REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- CONNECT POWER WIRES FROM UNIT LABELED L1 AND L2 TO TB2 TERMINAL STRIP ON HEATER PLATE
- EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT




LINE VOLTAGE FIELD INSTALLED



HEATING UNITS-ELECTRIC	
ECB29- 8,8CB-6P	
2 HEAT 2 COOL	
Supersedes	
Form No.	537816-01
Q415	

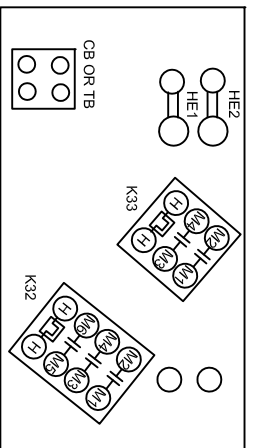

KEY	COMPONENT	DESCRIPTION
CB1	CIRCUIT BREAKER-ELECT HEAT	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT1	ELEMENT-ELECTRIC HEAT1
HE2	ELEMENT-ELECTRIC HEAT2	ELEMENT-ELECTRIC HEAT2
K33	RELAY-ELECTRIC HEAT	RELAY-ELECTRIC HEAT
K32	RELAY-ELECTRIC HEAT	RELAY-ELECTRIC HEAT
P2	PLUG-ELECTRIC HEAT	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT PRIMARY ELECT HEAT	SWITCH-LIMIT PRIMARY ELECT HEAT
S20	SWITCH-LIMIT SECONDARY ELECT HEAT	SWITCH-LIMIT SECONDARY ELECT HEAT
TB2	TERMINAL STRIP-UNIT	TERMINAL STRIP-UNIT

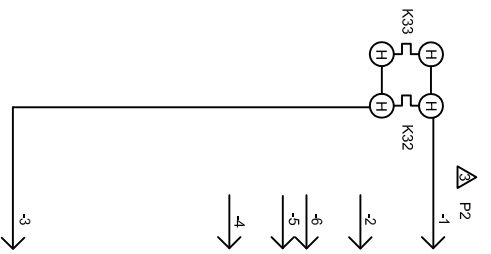

- NOTE: USE COPPER CONDUCTORS ONLY
- REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- CONNECT POWER WIRES FROM UNIT LABELED L1 AND L2 TO TB2 TERMINAL STRIP ON HEATER PLATE
- EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

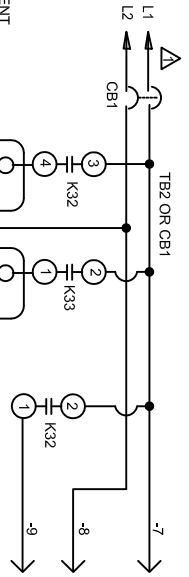

LINE VOLTAGE FIELD INSTALLED

HEATING UNITS-ELECTRIC	
ECB29- 8,8CB-6P	
2 HEAT 2 COOL	
Supersedes	
Form No.	537816-01
Q415	