

## ZHA036 Refrigerant Charge and Check

**WARNING-Do not exceed nameplate charge under any condition.**

This unit is factory charged and should require no further adjustment. If the system requires additional refrigerant, reclaim the charge, evacuate the system, and add required nameplate charge.

*NOTE - System charging is not recommended below 60°F (15°C). In temperatures below 60°F (15°C), the charge **must** be weighed into the system.*

If weighing facilities are not available, or to check the charge, use the following procedure:

1- Make sure outdoor coil is clean. Attach gauge manifolds and operate unit at full CFM in cooling mode with economizer disabled until system stabilizes (approximately five minutes). Make sure all outdoor air dampers are closed.

2- Compare the normal operating pressures to the pressures obtained from the gauges. Check unit components if there are significant differences.

3- Measure the outdoor ambient temperature and the suction pressure. Refer to the charging curve to determine a target liquid temperature.

*Note - Pressures are listed for sea level applications.*

4- Use the same thermometer to accurately measure the liquid temperature (in the outdoor section).


- If measured liquid temperature is higher than the target liquid temperature, add refrigerant to the system.
- If measured liquid temperature is lower than the target liquid temperature, recover some refrigerant from the system.

5- Add or remove charge in increments. Allow the system to stabilize each time refrigerant is added or removed.

6- Continue the process until measured liquid temperature agrees with the target liquid temperature. Do not go below the target liquid temperature when adjusting charge. Note that suction pressure can change as charge is adjusted.

7- Example: At 95°F outdoor ambient and a measured suction pressure of 130psig, the target liquid temperature is 105.5°F. For a measured liquid temperature of 106°F, add charge in increments until measured liquid temperature agrees with the target liquid temperature.

Normal Operating Pressures											
Outdoor Coil Entering Air Temperature											
65 °F		75 °F		85 °F		95 °F		105 °F		115 °F	
Suc psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig
119	235	122	272	124	314	126	359	129	409	132	461
128	241	130	279	132	319	136	364	146	421	140	470
139	245	146	285	151	331	155	377	155	428	159	482
145	248	154	290	163	335	170	384	174	438	179	498

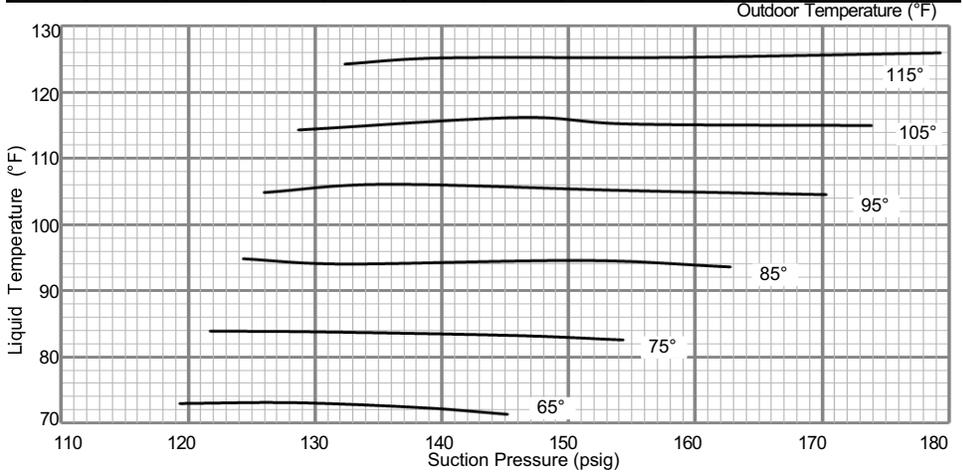

580548-01

## ZHA036 Refrigerant Charge and Check

**WARNING-Do not exceed nameplate charge under any condition.**

This unit is factory charged and should require no further adjustment. If the system requires additional refrigerant, reclaim the charge, evacuate the system, and add required nameplate charge.

*NOTE - System charging is not recommended below 60°F (15°C). In temperatures below 60°F (15°C), the charge **must** be weighed into the system.*

If weighing facilities are not available, or to check the charge, use the following procedure:

1- Make sure outdoor coil is clean. Attach gauge manifolds and operate unit at full CFM in cooling mode with economizer disabled until system stabilizes (approximately five minutes). Make sure all outdoor air dampers are closed.

2- Compare the normal operating pressures to the pressures obtained from the gauges. Check unit components if there are significant differences.

3- Measure the outdoor ambient temperature and the suction pressure. Refer to the charging curve to determine a target liquid temperature.

*Note - Pressures are listed for sea level applications.*

4- Use the same thermometer to accurately measure the liquid temperature (in the outdoor section).


- If measured liquid temperature is higher than the target liquid temperature, add refrigerant to the system.
- If measured liquid temperature is lower than the target liquid temperature, recover some refrigerant from the system.

5- Add or remove charge in increments. Allow the system to stabilize each time refrigerant is added or removed.

6- Continue the process until measured liquid temperature agrees with the target liquid temperature. Do not go below the target liquid temperature when adjusting charge. Note that suction pressure can change as charge is adjusted.

7- Example: At 95°F outdoor ambient and a measured suction pressure of 130psig, the target liquid temperature is 105.5°F. For a measured liquid temperature of 106°F, add charge in increments until measured liquid temperature agrees with the target liquid temperature.

Normal Operating Pressures											
Outdoor Coil Entering Air Temperature											
65 °F		75 °F		85 °F		95 °F		105 °F		115 °F	
Suc psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig	Suct psig	Disc psig
119	235	122	272	124	314	126	359	129	409	132	461
128	241	130	279	132	319	136	364	146	421	140	470
139	245	146	285	151	331	155	377	155	428	159	482
145	248	154	290	163	335	170	384	174	438	179	498

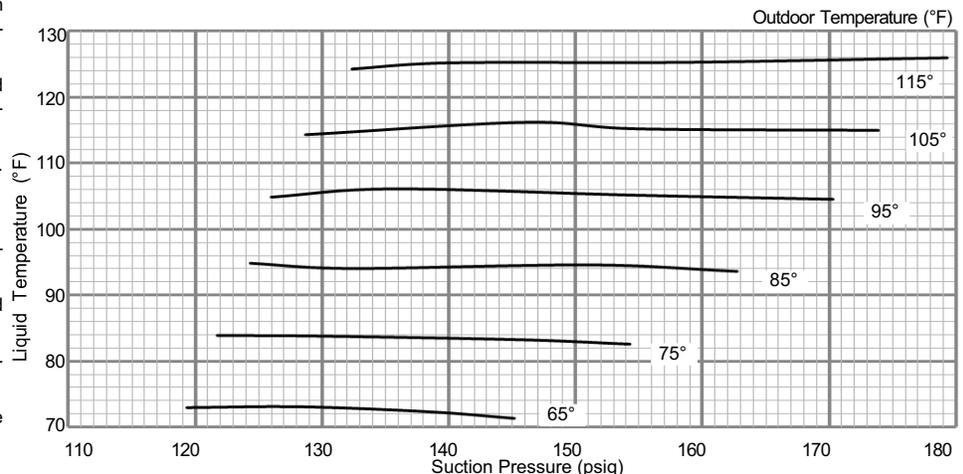

580548-01