

INSTALLATION INSTRUCTIONS FOR ECONOMIZERS USED WITH KG/KC/KH 092-150 B BOX UNITS

Note - When the economizer is factory-installed, refer to GED hood installation on Page 22 and outdoor air hood installation on Page 23.

Shipping and Packing List

Package 1 of 1 contains:

- 1 - Economizer damper assembly
- 1 - Gravity exhaust damper (GED) assembly
- 1 - Bag assembly containing:
 - #10 - 16 X 5/8" sheet metal screws
 - #12 - 14 X 5/8" self-drilling/self-tapping screws
 - #10 - 32 X 1/2" thread-forming screw
 - #4 - 40 X 3/8" thread-forming screws
 - #8 - 32 X 1/2" thread-forming screws
 - #6 - 32 X 7/8" thread-forming screws
 - 1 - Insertion wire tie
- 1 - Hood package (shipped inside economizer package) contains:**
 - 1 - Outdoor air hood top seal
 - 1 - Outdoor air hood top
 - 2 - Outdoor air hood sides (left and right)
 - 1 - Outdoor air hood bottom filter bracket
 - 1 - Top filter seal bracket
 - 1 - Filter spacer
 - 2 - Filters
 - 1 - Gravity exhaust hood top
 - 1 - Gravity exhaust hood top support
 - 2 - Gravity exhaust hood sides (left and right)
- 1 - Single sensible sensor (S175 or RT26)
- 1 - Wiring harnesses (P104)
- 1 - Resistor assembly
- 1 - Economizer control (A6) with harness
- 1 - Sensor (R1)

NOTE - For horizontal applications, order horizontal discharge kit separately.

NOTE - Gravity exhaust dampers are required for use with economizers and must be installed. For low profile horizontal applications, order LAGEDH separately. See table 1.

⚠ CAUTION

As with any mechanical equipment, contact with sharp sheet metal edges can result in personal injury. Take care while handling this equipment and wear gloves and protective clothing.

⚠ WARNING

Improper installation, adjustment, alteration, service or maintenance can cause property damage, personal injury or loss of life. Installation and service must be performed by a licensed professional HVAC installer or equivalent, service agency, or the gas supplier

Application

The economizer is used with KG/KC/KH units in downflow and horizontal air discharge applications. Economizer dampers will modulate to maintain 55°F (13°C) supply air when outdoor air is suitable. The mixed air temperature sensor (R1) measures the supply air sensible temperature.

The mixed air sensor is provided in field-installed kits and installed according to these instructions. The mixed air sensor is factory-installed when the unit is equipped with an economizer.

Two types of economizers are available. See table 1.

TABLE 1

Print No.	Cat. No.	Kit Description
603366-05	13U45	Standard Economizer
603366-12	23G23	High Performance Economizer
LB-68922F	53K04	Low Profile GED - Horizontal Applications

NOTICE

Install accessories in the following order:

- 1-Economizer dampers
- 2-Sensors (installation and wiring)
- 3-Gravity exhaust dampers
- 4-Gravity exhaust damper hoods
- 5-Outdoor air hoods

Table of Contents

- General Page 3
 - Standard Economizer Page 3
 - High Performance Economizer Page 3
 - Horizontal Applications Page 3
 - Gravity Exhaust Damper Page 3
 - Indoor Air Quality Page 3
- Standard Economizer - Installation Page 4
 - Dampers Page 4
 - Economizer Controller (A6) Page 4
 - Mixed Air Sensor (R1) Page 4
 - Outdoor Air Sensor (S175) Page 5
- Standard Economizer - Electrical Page 5
 - Economizer Control Harness (J10, J104) Page 5
 - Mixed Air Sensor Connection (R1) Page 5
 - Outdoor Air Sensor Connection (S175) Page 5
 - Optional Sensor Connections Page 5
 - Variable Frequency Drive (VFD) Page 6
- Standard Economizer - Settings Page 8
 - LEDS Page 8
 - Free Cooling Setpoints Page 8
 - Demand Controlled Ventilation (DCV) . Page 8
- Standard Economizer - Sequence of Operation Page 9
- Standard Economizer - Wiring Diagram Page 10

- Std. & Hi Performance Damper Min Position Page 11

- High Performance Economizer - Installation Page 13
 - Dampers Page 13
 - Economizer Control (A6) Page 13
 - Mixed Air Sensor (R1) Page 14
 - Outdoor Air Sensor (S175) Page 14
- High Performance Economizer - Electrical .. Page 15
 - Economizer Control Harness (J10, J104) Page 15
 - Mixed Air Sensor Connection (R1) Page 15
 - Outdoor Air Sensor connection (S175) Page 15
 - Optional Sensor Connections Page 15
- High Performance Economizer - POL224.00 .. Page 17
 - User Interface Page 17
 - Menu Structure Page 17
 - Free Cooling Setpoints Page 17
 - Setup and Configuration - Factory Page 18
 - Setup and Configuration - Field Page 18
 - Alarm Monitoring Page 18
 - Demand Controlled Ventilation (DCV) . Page 18
- High Performance Economizer -
 - Sequence of Operation Page 19
- High Performance Economizer -
 - Wiring Diagram Page 21
- Gravity Exhaust Damper Page 22
- Outdoor Air Hood Page 23
- Horizontal Applications Page 24

General

K1ECON20B-1 Standard Economizer

The standard economizer is equipped with a W7212 economizer control module A6. The default OA temperature sensor is the OA thermostat, S175, provided in this kit. See table 2 for outdoor and return air (OA and RA) sensor options. Refer to instructions provided with sensors for installation.

**TABLE 2
STANDARD ECONOMIZER SENSORS**

Sensors	Dampers will modulate to 55°F discharge air (RT6) when:
Single OA Sensible	OA temperature (S175) is lower than free cooling setpoint.
Single OA Enthalpy	OA temperature and humidity (A7) is lower than free cooling setpoint.
Differential Enthalpy - 1 in OA and 1 in RA	OA temperature and humidity (A7) is lower than RA temperature and humidity (A62).
IAQ Sensor	CO ₂ sensed (A63) is higher than CO ₂ setpoint.

High Performance Economizer

The high performance economizer is equipped with a POL224.00 control module A6. This application provides low leak, fault detection and diagnostic capabilities. The default OA temperature sensor or high limit sensor (RT26) is a CEC approved, California Title 24 fixed dry bulb device (provided in this kit). See table 3 for outdoor and return air (OA and RA) sensor options. Refer to manufacturer's instructions provided for more details.

**TABLE 3
HIGH PERFORMANCE ECONOMIZERS**

Sensors	Dampers modulate to maintain 55°F mixed air (R1) when:
Single OA Sensible DEFAULT - Approved for CA Title24	OA temperature (RT26) is lower than free cooling setpoint.
Single OA Enthalpy - Approved for CA Title 24	OA temperature and humidity (A7) is lower than free cooling setpoint.
Differential Enthalpy - 1 in OA & 1 in RA Not approved for CA Title 24	OA temperature and humidity (A7) is lower than RA temperature and humidity (A62).
IAQ Sensor	CO ₂ sensed (A63) is higher than CO ₂ setpoint.

Horizontal Applications

For horizontal applications, a separately ordered horizontal discharge kit is required. The horizontal, field-fabricated return air duct must be sized to accommodate the gravity exhaust damper and hood shipped with the economizer (if used). A separately ordered low profile gravity exhaust damper and hood kit is available for size restricted applications. Refer to *Gravity Exhaust Damper Installation* section for details.

Gravity Exhaust Damper

Gravity exhaust dampers allow exhaust air to be discharged from the system when an economizer and/or power exhaust is operating. Exhaust dampers are required unless other provisions are made to exhaust indoor air. Gravity exhaust dampers also prevent outdoor air infiltration during unit off cycle.

IAQ Sensing (A63)

An IAQ (CO₂) sensor is used when demand control ventilation (DCV) is specified. Damper minimum position can be set lower than traditional minimum air requirements resulting in cost savings. The IAQ sensor allows the A6 to open dampers to traditional ventilation requirements as room occupancy (CO₂) increases.

Connect sensor leads to AQ and AQ1 terminals on the A6 economizer control located in the filter section.

When a POL224.00 high performance economizer is installed, the 0-10VDC sensor must be set to a 6CO₂ Rng L of 400ppm and 6CO₂ Rng H of 1600ppm. Use the BASIC SETTINGS menu on the POL224.00 A6 economizer control module.

Standard Economizer - Installation

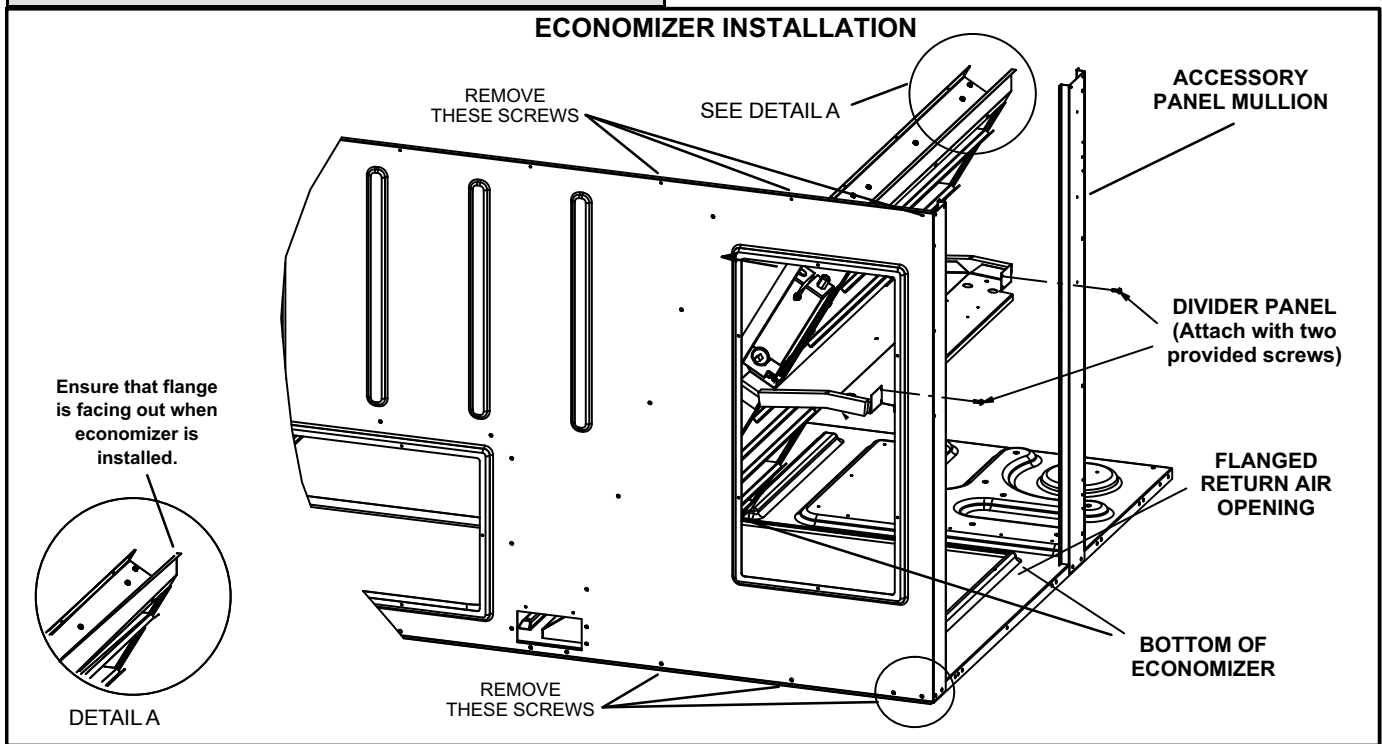


FIGURE 1

DAMPERS

- 1- Disconnect all power to unit.
- 2- Remove accessory compartment access panel.
- 3- Remove and retain screws from top and bottom of rear panel. Remove screws from accessory panel mullion and remove mullion. Lift the top of the unit as needed. See figure 1.
- 4- Slide the bottom of the economizer over the flanged return air opening in the base of the unit until it settles into place. See figure 1.
- 5- Use provided screws to secure economizer divider panel to unit end mullion and accessory compartment mullion as shown in figure 1.
- 6- Before securing unit top panel with retained screws, position the outdoor air hood top seal under the panel as shown in figures 23 and 24. The outdoor air hood top seal is shipped with the other outdoor air hood components.

ECONOMIZER CONTROL MODULE (A6) INSTALLATION

- 1- Install A6 economizer control below control panel as shown in figure 2. Secure with #6 - 32 X 7/8" TFS screws provided.

MIXED AIR SENSOR (R1) INSTALLATION

- 1- Remove blower access panel.
- 2- Install sensor in location shown in figure 3 and 4. Secure with single screw provided in kit.

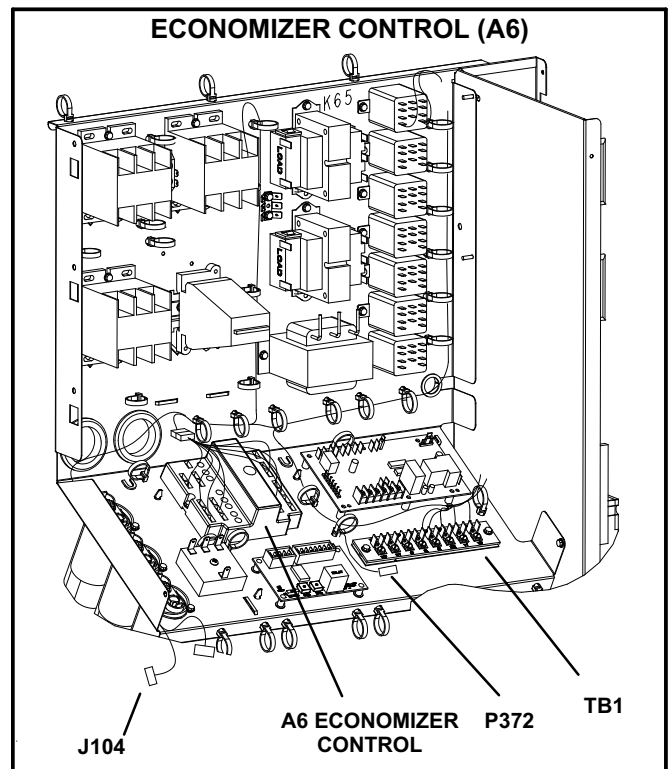


FIGURE 2

Standard Economizer-Installation (continued)

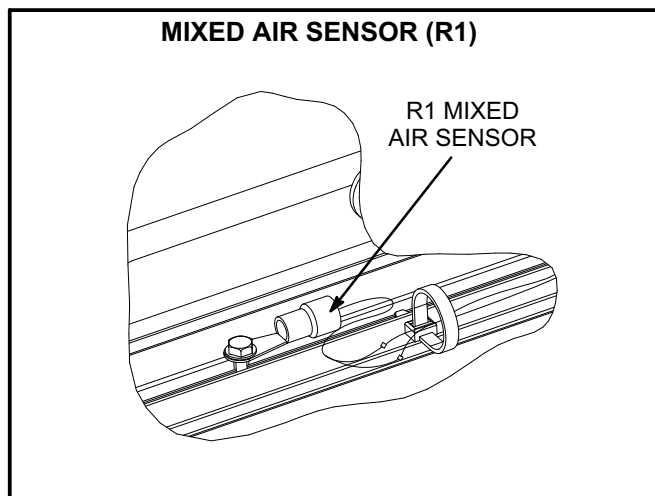


FIGURE 3

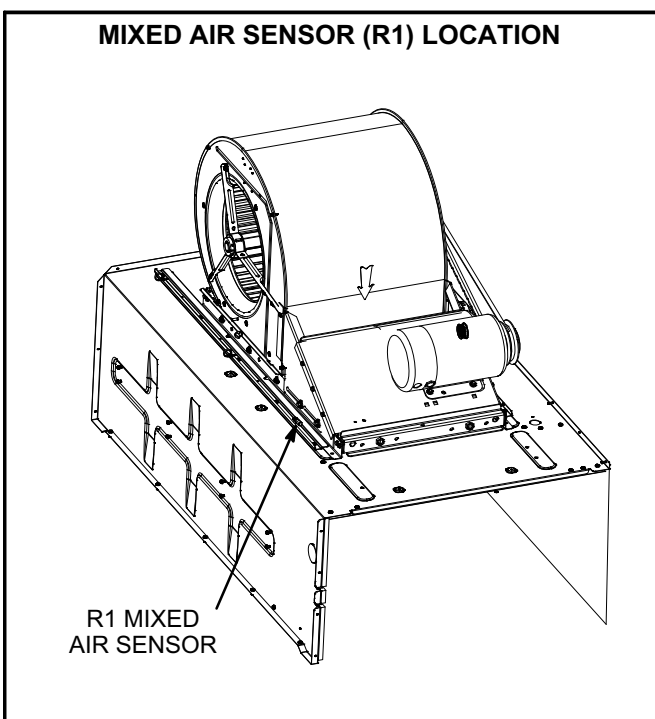


FIGURE 4

OUTDOOR AIR THERMOSTAT (S175)

- 1- Install S175 thermostat on mounting bracket using #6 - 32 X 7/8" screws.
- 2- Install mounting bracket on divider panel as shown in figure 5. Secure with #8 - 32 X 1/2" TFS screws.

MIXED AIR SENSOR (R1) CONNECTIONS

- 1- Connect J3 harness wires marked "R1" to sensor installed in blower section. See figure 10.

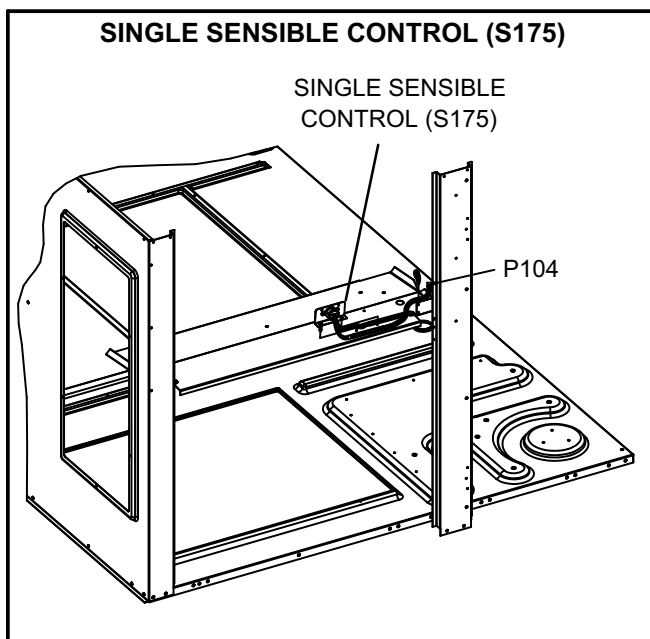


FIGURE 5

Standard Economizer - Electrical

ECONOMIZER CONTROLLER (A6) HARNESS CONNECTIONS

- 1- Disconnect and discard the 15-pin male plug attached to factory-installed J3.
- 2- Locate harness installed on economizer control (A6).
- 3- Connect the 15-pin male plug P4 to the 15-pin female jack J3 on the unit control harness.
- 4- Route harness as shown in figure 6 and use push-in wire tie to secure harness to side wall.
- 5- Push J10 and J104 from economizer control harness into openings in side wall. See figure 7.
- 6- Connect the 15-pin plug P3 from the damper motor to the economizer control J10 jack inserted into the wall in the previous step.

OUTDOOR AIR THERMOSTAT (S175)

- 1- Make wiring connections as shown in figures 8 and 10. Secure harness with wire tie provided in kit.
- 2- Insert P104 plug into J104, previously installed in the side of the economizer as shown in figure 5 and 7.

OPTIONAL SENSOR CONNECTIONS

An optional return air sensible sensor (RT27) can be added for differential sensible sensing. The sensible configuration can be replaced by temperature and humidity (enthalpy) sensor (A7/A62). See figure 10.

An optional CO2 sensor (A63) can be added for demand control ventilation (DCV).

Refer to installation instructions shipped with optional sensor for more details.

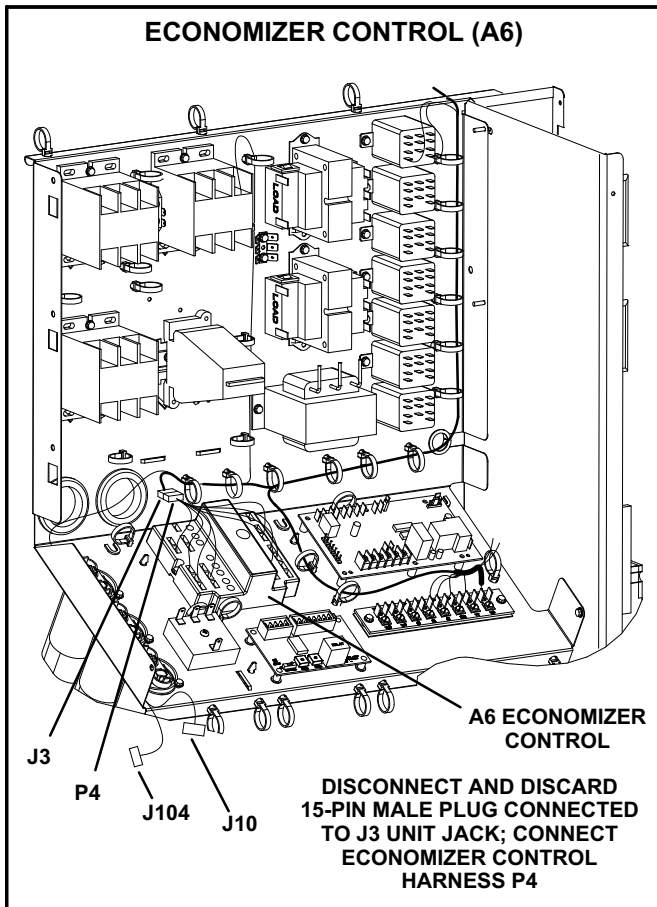


FIGURE 6

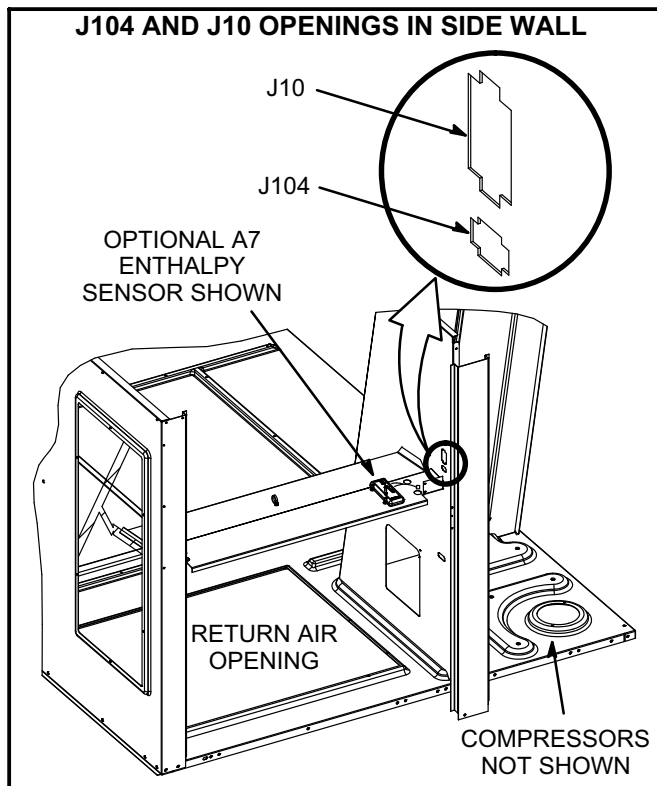


FIGURE 7

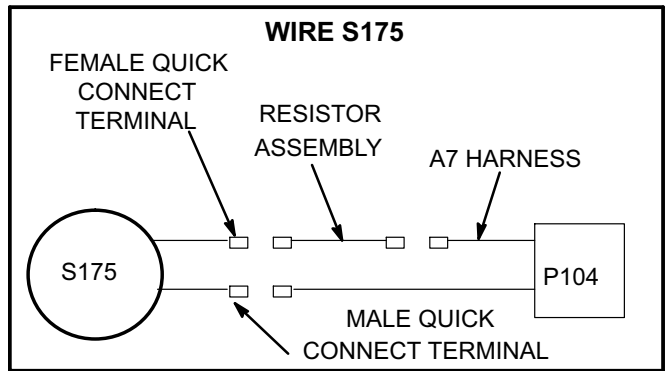


FIGURE 8

Standard Economizer - Electrical
(continued)

UNITS EQUIPPED WITH AN OPTIONAL VFD ONLY

- 1- Remove the jumper between P and P1 terminals on A6 economizer control. See figure 9.
- 2- Locate the wires marked P and P1 in the control compartment. Connect the P and P1 wires to P and P1 terminals on A6 respectively.
- 3- Adjust the minimum position potentiometer (MIN POS) on A6 fully open (completely clockwise).

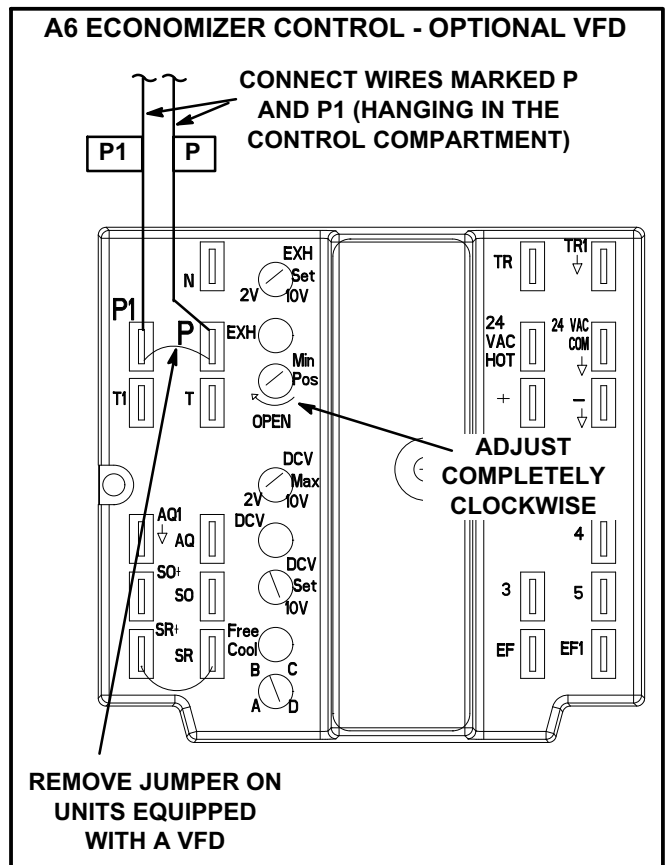


FIGURE 9


Standard Economizer - Electrical (continued)

SENSOR WIRING CONNECTIONS - STANDARD ECONOMIZERS

Field-Installed - - - -

SINGLE SENSING

**A6
ECONOMIZER
CONTROL**

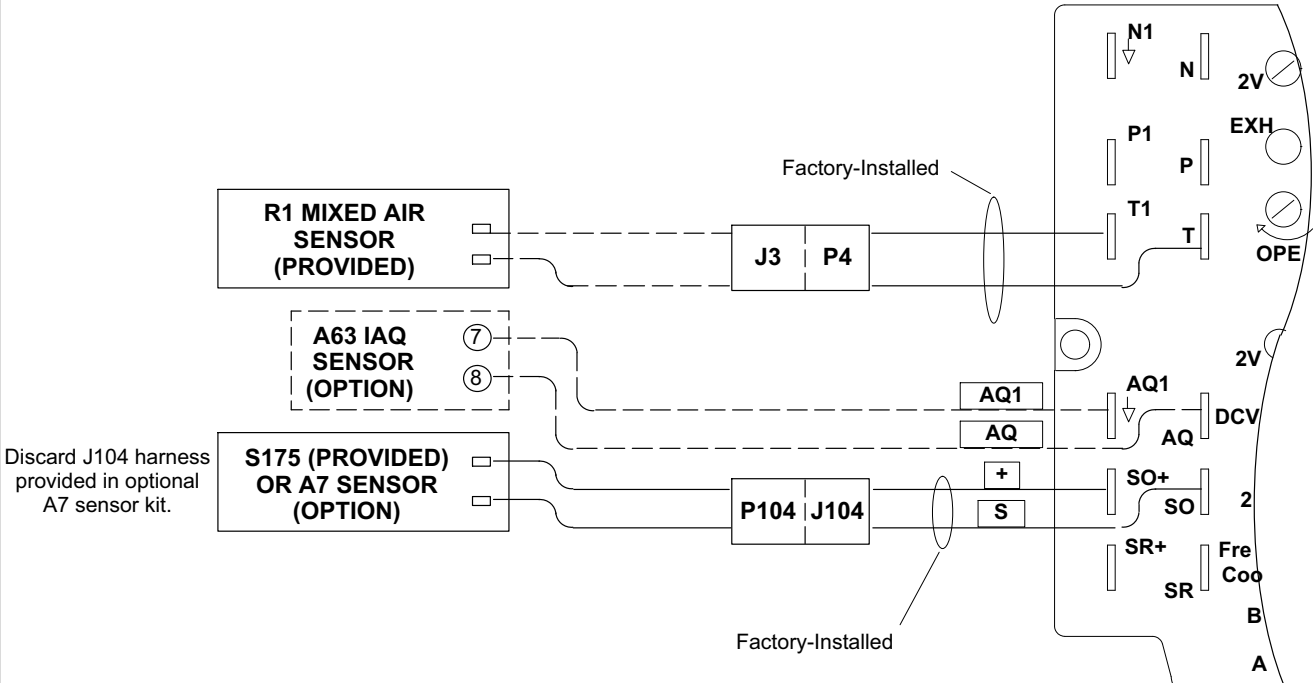

DIFFERENTIAL SENSING

**A6
ECONOMIZER
CONTROL**

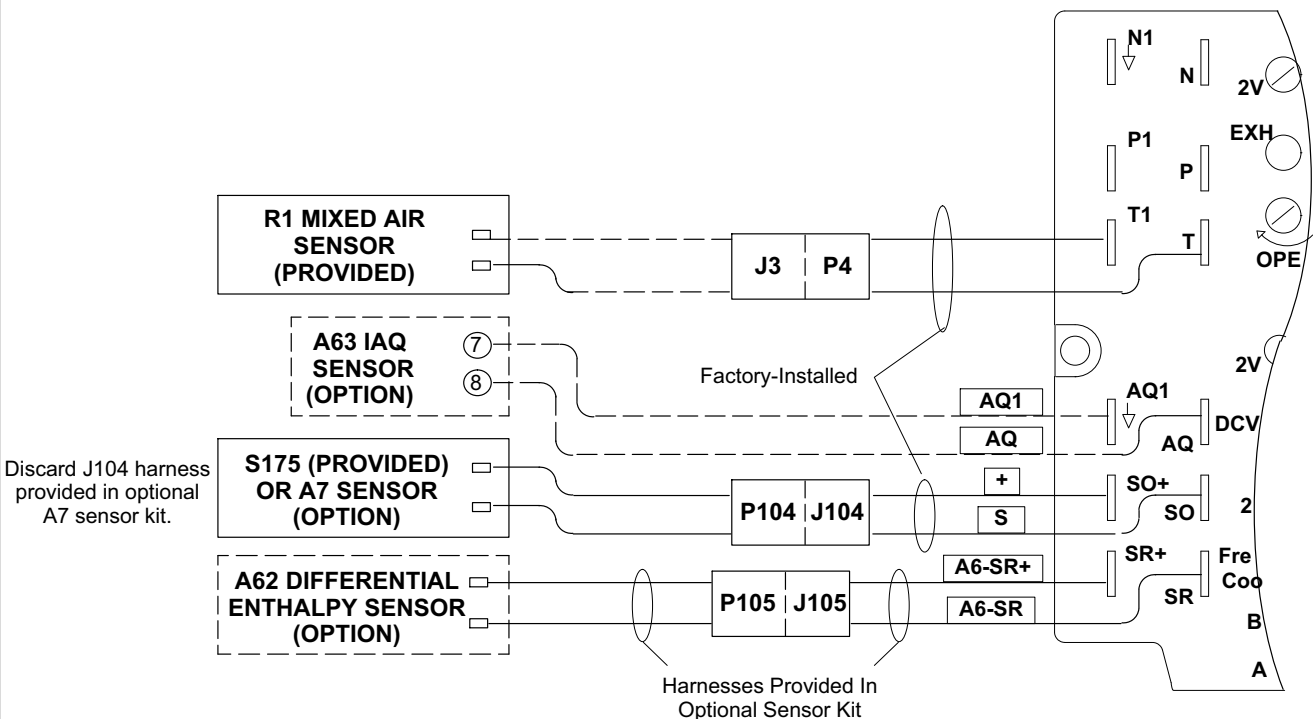


FIGURE 10

Standard Economizer - Settings

LEDs

A steady green Free Cool LED indicates that outdoor air is suitable for free cooling. A steady green DCV LED indicates that the IAQ reading is higher than setpoint requiring more fresh air. See figure 11.

FREE COOLING SETPOINT

Single Temperature or Enthalpy Sensing:

The economizer control (A6) setpoint may be adjusted when an enthalpy (A7) sensor is used to determine outdoor air suitability, See figure 11.

Free cooling will be enabled when outdoor air temperature or enthalpy are lower than the free cooling setpoint. The free cooling setpoints for sensible temperature sensors is 55°F. Table 4 shows the free cooling setpoints for enthalpy sensors. Use the recommended setpoint and adjust as necessary.

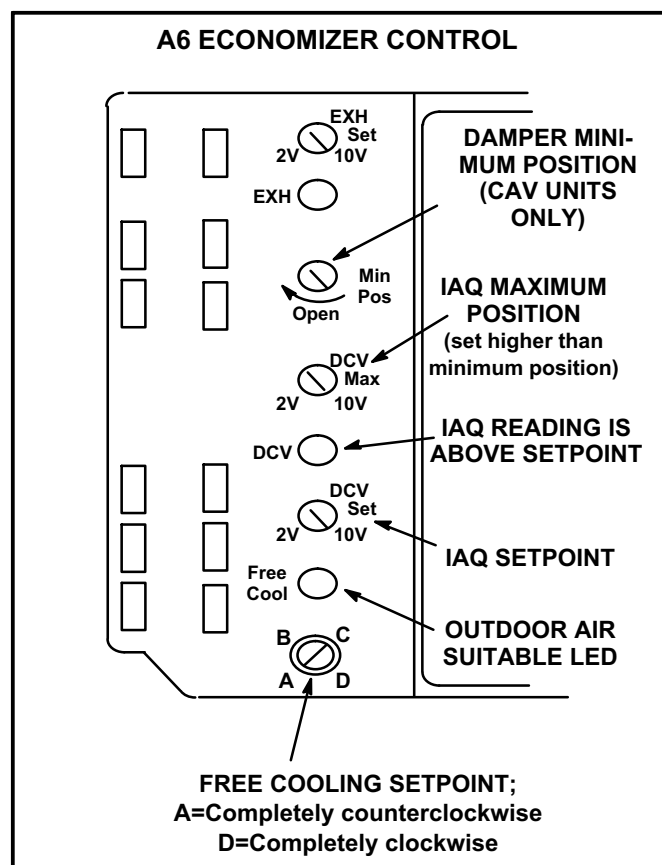


FIGURE 11

For example: At setting A (table 4), free cooling will be enabled when outdoor air enthalpy is lower than 73°F and 50% RH. If indoor air is too warm or humid, lower the setpoint to B. At setting B, free cooling will be enabled at 70°F and 50% RH.

**TABLE 4
ECONOMIZER FREE COOLING SETPOINTS**

Control Setting	Enthalpy Setpoint At 50% RH
A*	73° F (23° C)
B	70° F (21° C)
C	67° F (19° C)
D	63° F (17° C)

*Setting A is recommended.

Differential Sensing:

Two sensors can be used to compare outdoor air to return air. When outdoor air is cooler than return air, outdoor air is suitable for free cooling. Adjust the free cooling setpoint to "D" in this application.

When return air is cooler than outdoor air, the damper will modulate to the minimum position.

DCV SET AND DCV MAX SETTINGS

The DCV SET potentiometer is factory-set at approximately 50% of the potentiometer range. Using a standard 1-2000ppm CO₂ sensor, dampers will start to open when the IAQ sensor reads approximately 1000ppm. Adjust the DCV SET potentiometer to the approximate setting specified by the controls contractor. Refer to figure 11.

The DCV MAX potentiometer is factory-set at approximately 50% of the potentiometer range or 6VDC. Dampers will open approximately half way when CO₂ rises above setpoint. Adjust the DCV MAX potentiometer to the approximate setting specified by the controls contractor. Refer to figure 11.

NOTE - DCV Max must be set higher than economizer minimum position setting for proper demand control ventilation.

Standard Economizer - Sequence of Operation

ECONOMIZER

When the outdoor air is suitable, dampers will modulate between minimum position and full open to maintain 55°F (12.8°C) supply air.

See table 5 for economizer operation when outdoor air is suitable. See table 6 for economizer operation when outdoor air is NOT suitable.

IAQ SENSOR

During the occupied period, dampers will open to DCV MAX when IAQ reading is above setpoint (regardless of thermostat demand or outdoor air suitability). DCV MAX will NOT override damper full-open position. The DCV MAX setting may override damper free cooling position when occupancy is high and outdoor air temperatures are low.

Note - R1 senses mixed air temperature below 45°F (7°C), dampers will move to fully closed until mixed air temperature rises to 48°F (9°C).

TABLE 5

ECONOMIZER OPERATION-OUTDOOR AIR IS SUITABLE FOR FREE COOLING – FREE COOL LED “ON”

THERMOSTAT DEMAND	DAMPER POSITION		MECHANICAL COOLING
	UNOCCUPIED	OCCUPIED	
Off	Closed	Closed	No
G	Closed	Minimum	No
Y1	Modulating	Modulating	No
Y2	Modulating	Modulating	Stage 1
Y3	Modulating	Modulating	Stage 2

TABLE 6


ECONOMIZER OPERATION-OUTDOOR AIR IS NOT SUITABLE FOR FREE COOLING – FREE COOL LED “OFF”

THERMOSTAT DEMAND	DAMPER POSITION		MECHANICAL COOLING
	UNOCCUPIED	OCCUPIED	
Off	Closed	Closed	No
G	Closed	Minimum*	No
Y1	Closed	Minimum*	Stage 1
Y2	Closed	Minimum*	Stage 2

*IAQ sensor can open damper to DCV max.

Standard Economizer - Wiring Diagram

TYPICAL ECONOMIZER WIRING DIAGRAM - KG, KC & KH UNITS

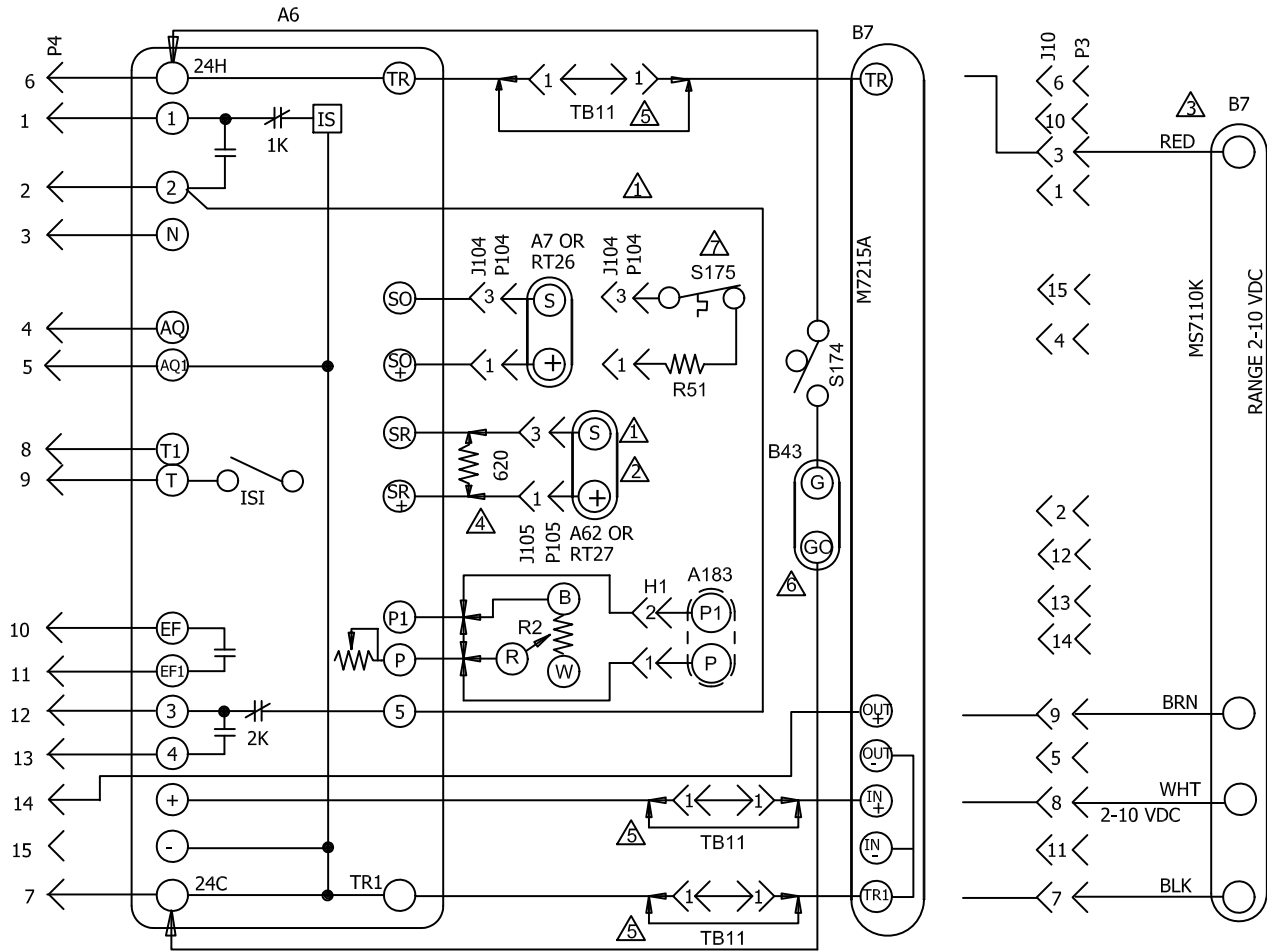

KEY	COMPONENT
A6	CONTROL-SOLID STATE ENTHALPY
A7	SENSOR-SOLID STATE ENTHALPY
A62	SENSOR-ENTHALPY, INDOOR
A183	CONTROL, VFD BOARD
B7	MOTOR-DAMPER, ECONOMIZER
B43	MOTOR-EXHAUST DAMPER
H1	HEADER 1 ON LANDMARK VFD BOARD
J10	JACK-ECONOMIZER
J104	JACK-SENSOR,OUTDOOR ENTHALPY
J105	JACK-SENSOR,RETURN AIR ENTHALPY
P3	PLUG-LESS ECONOMIZER
P4	PLUG-ECONOMIZER
P104	PLUG-SENSOR,OUTDOOR ENTHALPY
P105	PLUG-SENSOR,RETURN AIR ENTHALPY
R2	POT-MINIMUM POSITION
R51	RESISTOR-SENSIBLE 820 OHM
RT26	SENSOR-OUTDOOR AIR TEMP
RT27	SENSOR-INDOOR AIR TEMP
S175	THERMOSTAT-SENSIBLE TEMP 55-70F
S174	SWITCH-EXHAUST DAMPER
TB11	TERMINAL STRIP-CLASS II VOLT

DESIGNATES OPTIONAL WIRING
 CLASS II FIELD WIRING

- RT26 AND RT27, TEMPERATURE SENSORS MAY BE USED INSTEAD OF A7 AND A62 ENTHALPY SENSORS
- A62 ENTHALPY SENSOR OR RT27 USED FOR DIFFERENTIAL SENSING
- USED ON C BOX UNITS
- REPLACE A7 OR RT26 WITH 620 OHM RESISTOR FOR CONTROLS WITH GLOBAL ECON
- TB11 USED ON "C" BOX ONLY WITH MOTOR M7215A
- OPTIONAL EXHAUST DAMPER TO HOLD EXHAUST DAMPER CLOSED WHEN OUTSIDE AIR DAMPER IS CLOSED
- OPTIONAL OUTDOOR THERMOSTAT TO REPLACE RT26 SENSIBLE SENSOR

	LANDMARK WIRING DIAGRAM	11/11
	ACCESSORIES	
ECONOMIZER		
SECTION D		REV 0
Supersedes	New Form No. 537080-02	

© 2011

Lennox Commercial

Standard & High Performance Damper Minimum Position

NOTE - 24 volts must be provided at unit TB1 terminals **R** and **OC** to enable economizer operation (allowing minimum fresh air). Typically a separately ordered thermostat or energy management system with an occupied/unoccupied output is connected between TB1 **R** and **OC** terminals. The thermostat will provide 24 volts to the A6 economizer control during the occupied time period to enable economizer minimum position. If a device is not used to enable the economizer, install a jumper wire between TB1 terminals **R** and **OC** to maintain minimum position continuously.

Make wire connections to TB1 terminals **R** and **OC** as shown in literature provided with thermostat or energy management system.

- 1- Set thermostat to occupied mode if the feature is available. Make sure jumper is in place between TB1 terminals R and OCP if using a thermostat which does not have the feature.
- 2- Turn on the blower using the thermostat or a jumper between TB1 terminals R and G.
- 3- *Standard Economizers* - Rotate MIN POS SET potentiometer to approximate desired fresh air percentage.

High Performance Economizers-

On units with single-speed blowers, navigate to the "BASIC SETTINGS" menu and select "2FAN H ACT". Adjust value (2-10VDC) to the approximate desired fresh air percentage.

On units with two-speed blowers, once high speed minimum position is set (steps 4- through 11-), adjust "2FAN L ACT" in the same manner.

3.0 VDC	- 12% Open Damper
3.5 VDC	- 18% Open Damper
4.0 VDC	- 25% Open Damper
4.5 VDC	- 31% Open Damper
5.0 VDC	- 37% Open Damper
5.5 VDC	- 43% Open Damper
6.0 VDC	- 50% Open Damper

NOTE - Damper minimum position can be set lower than traditional minimum air requirements when an IAQ sensor is specified.

- 4- *High Performance Economizers* -
Navigate through the "BASIC SETTINGS" menu and select "7DAMPER MIN POS".
Damper will drive to the setpoint value stored in step 3-.
- 5- Measure outdoor air temperature. Mark the point on the bottom line of chart 1 and label the point "A" (40°F, 4°C shown).
- 6- Measure return air temperature. Mark that point on the top line of chart 1 and label the point "B" (74°F, 23°C shown).
- 7- Measure mixed air (outdoor and return air) temperature. Mark that point on the top line of chart 1 and label point "C" (70°F, 21°C shown).
- 8- Draw a straight line between points A and B.
- 9- Draw a vertical line through point C.
- 10- Draw a horizontal line where the two lines meet. Read the percent of fresh air intake on the side.

11- *Standard Economizers* -


If fresh air percentage is less than desired, adjust MIN POS SET potentiometer clockwise (further open). If fresh air percentage is more than desired, adjust MIN POS SET potentiometer counterclockwise (less open). Repeat steps 5- through 10- until calculation reads desired fresh air percentage.

High Performance Economizers -

If fresh air percentage is less than desired, use the A6 keypad to adjust "2FAN H ACT" values higher (further open). If fresh air percentage is more than desired, adjust "2FAN H ACT" values lower (less open). Repeat steps 4- through 10- until calculation reads desired fresh air percentage.

On units with two-speed blowers, after high speed is adjusted, use "2FAN L ACT" in the same manner.

CHART 1
CALCULATE MINIMUM FRESH AIR PERCENTAGE
 MIXED AND RETURN AIR TEMPERATURE

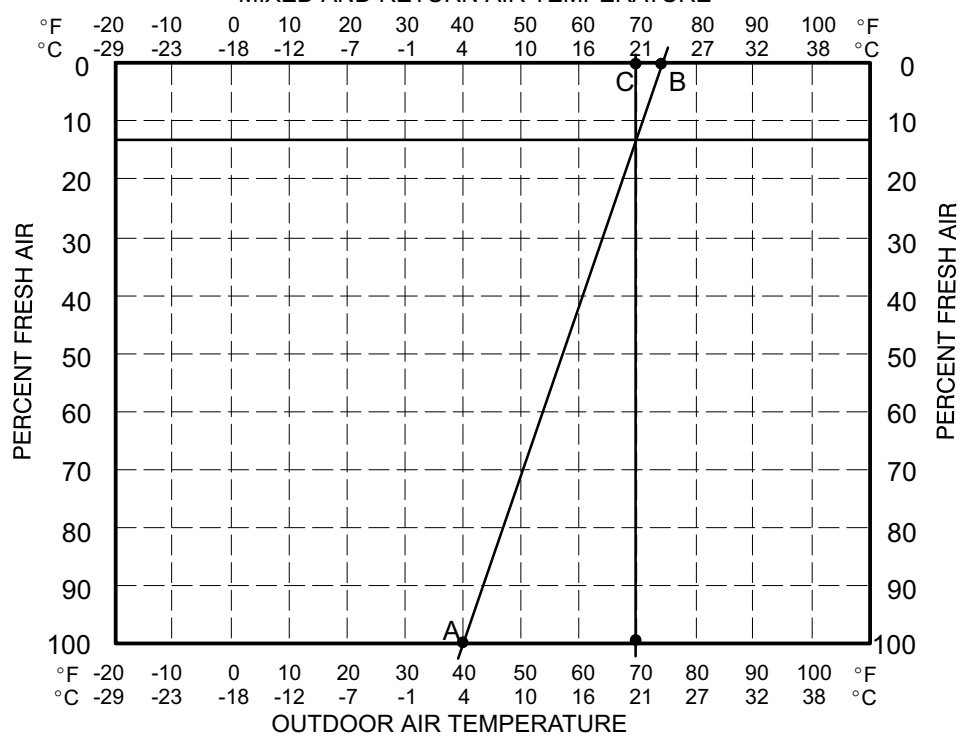

High Performance Economizer - Installation

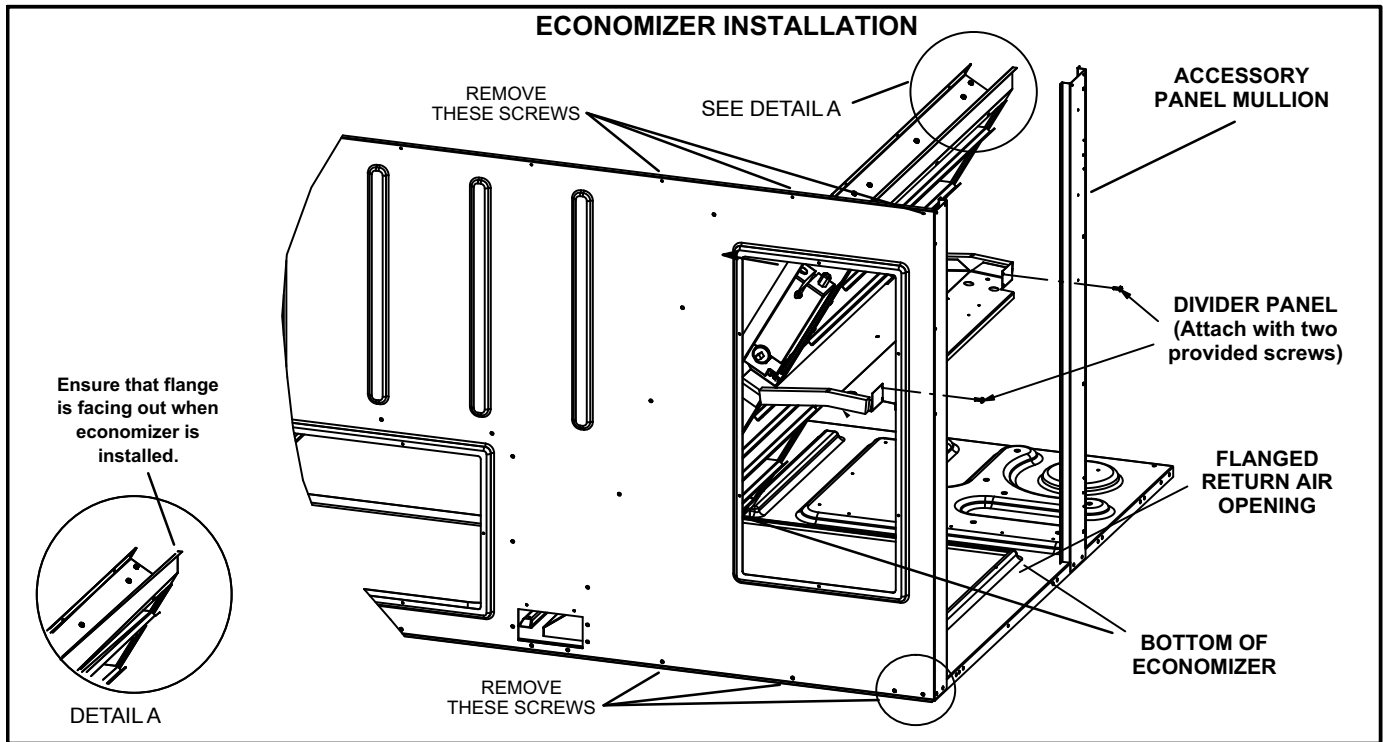


FIGURE 12

DAMPERS

- 1- Disconnect all power to unit.
- 2- Remove accessory compartment access panel.
- 3- Remove and retain screws from top and bottom of rear panel. Remove screws from accessory panel mullion and remove mullion. Lift the top of the unit as needed. See figure 12.
- 4- Slide the bottom of the economizer over the flanged return air opening in the base of the unit until it settles into place. See figure 12.
- 5- Use provided screws to secure economizer divider panel to unit end mullion and accessory compartment mullion as shown in figure 12.
- 6- Before securing unit top panel with retained screws, position the outdoor air hood top seal under the panel as shown in figures 23 and 24. The outdoor air hood top seal is shipped with the other outdoor air hood components.

ECONOMIZER CONTROL (A6) INSTALLATION

- 1- Install the economizer control bracket in the unit control area. See figure 13. Secure bracket with #10-16 x 5/8 screws provided in kit.

- 2- Install A6 economizer control on the bracket as shown in figure 13. Secure with #6 - 32 X 7/8 TFS screws provided.

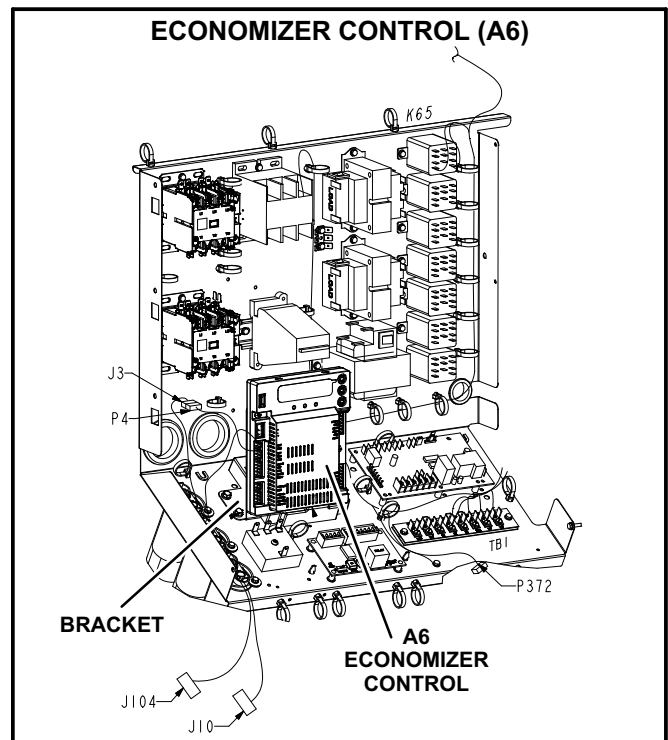


FIGURE 13

High Performance Economizer - Installation (continued)

MIXED AIR SENSOR (R1) INSTALLATION

- 1- Remove blower access panel.
- 2- Install sensor on the blower rail as shown in figure 3 and 4. Secure with #6 - 32 X 7/8" TFS screws provided in kit.

OUTDOOR AIR SENSOR (RT26) INSTALLATION

- 1- Mount sensor onto the economizer divider panel as shown in figure 14. Use #6 - 32 X 7/8" TFS screws provided.

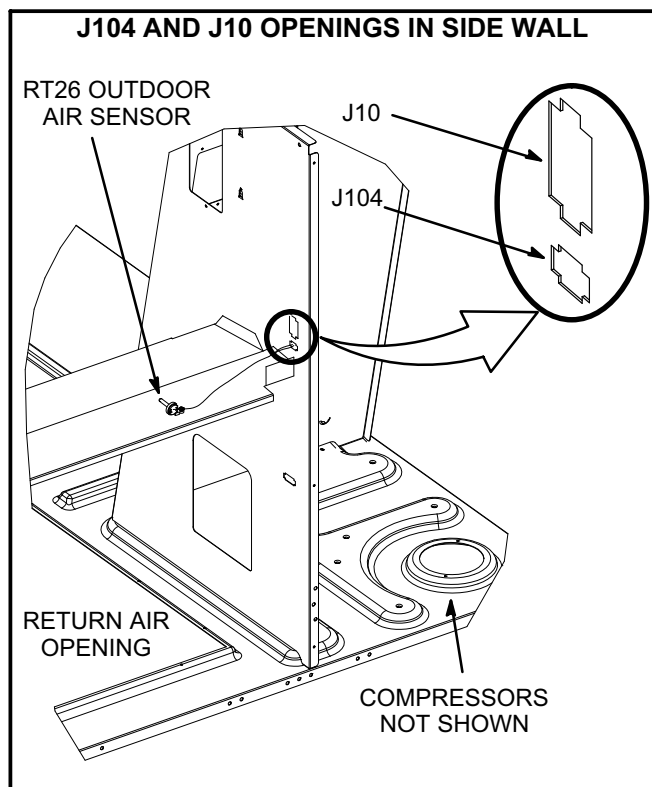


FIGURE 14

High Performance Economizer - Electrical

CONTROLLER HARNESS A6 CONNECTIONS

NOTE - Wires marked P and P1 are hanging in the control section. These wires are connected on units equipped with standard economizers AND a VFD only.

- 1- Disconnect and discard the 15-pin male plug attached to factory-installed J3.
- 2- Locate harness installed on economizer control (A6).
- 3- Connect the 15-pin male plug P4 to the 15-pin female jack J3 on the unit control harness.
- 4- Route harness as shown in figure 15 and use push-in wire tie to secure harness to side wall.
- 5- Push J10 and J104 from economizer control harness into openings in side wall. See figure 14.
- 6- Connect the 15-pin plug P3 from the damper motor to the economizer control J10 jack inserted into the wall in the previous step.

OUTDOOR AIR SENSOR CONNECTION (RT26)

- 1- Locate 2-wire harness marked P104--SENSOR.
- 2- Insert P104 plug into the side of the economizer as shown in 14 and connect the other end to the sensor.

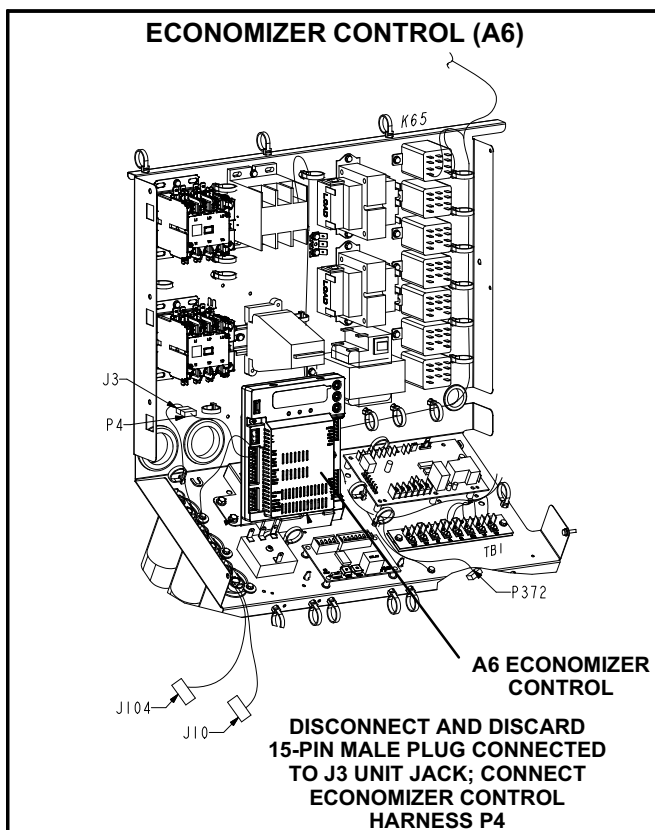


FIGURE 15

MIXED AIR SENSOR CONNECTION (R1)

- 1- Connect J3 harness wires marked "R1" to the 10" R1 adapter harness. Connect the other side of the R1 adapter harness into the mixed air sensor. See figure 16. Make sure to secure wires away from moving parts.

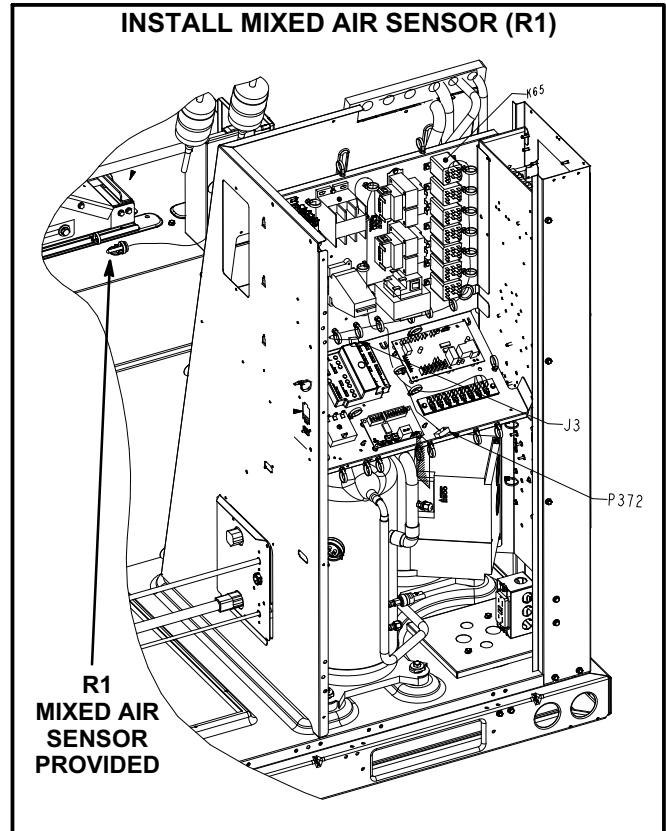


FIGURE 16

OPTIONAL SENSOR CONNECTIONS

The sensible configuration can be replaced by temperature and humidity (enthalpy) sensor A7 for single enthalpy sensing. RT26 can be replaced by temperature and humidity (enthalpy) sensors A7 / A62 for differential enthalpy sensing. See figure 17 for sensor wiring.

An optional CO₂ sensor (A63) can be added for demand control ventilation (DCV).

For proper operation, the IAQ sensor must provide a 0-10VDC signal. Connect sensor leads to A68-7 and A68-8 blue wires located in the controls compartment.

CO₂ Sensor Used With High Performance Economizers- When using any 0-10VDC sensor, set the ppm range using the POL224.00 economizer control A6 BASIC SETTINGS menu. Set the 6CO₂ Rng L to 400 ppm and the 6CO₂ Rng H to 1600 ppm.

Refer to installation instructions shipped with optional sensor for more details.

High Performance Economizer - Electrical (continued)

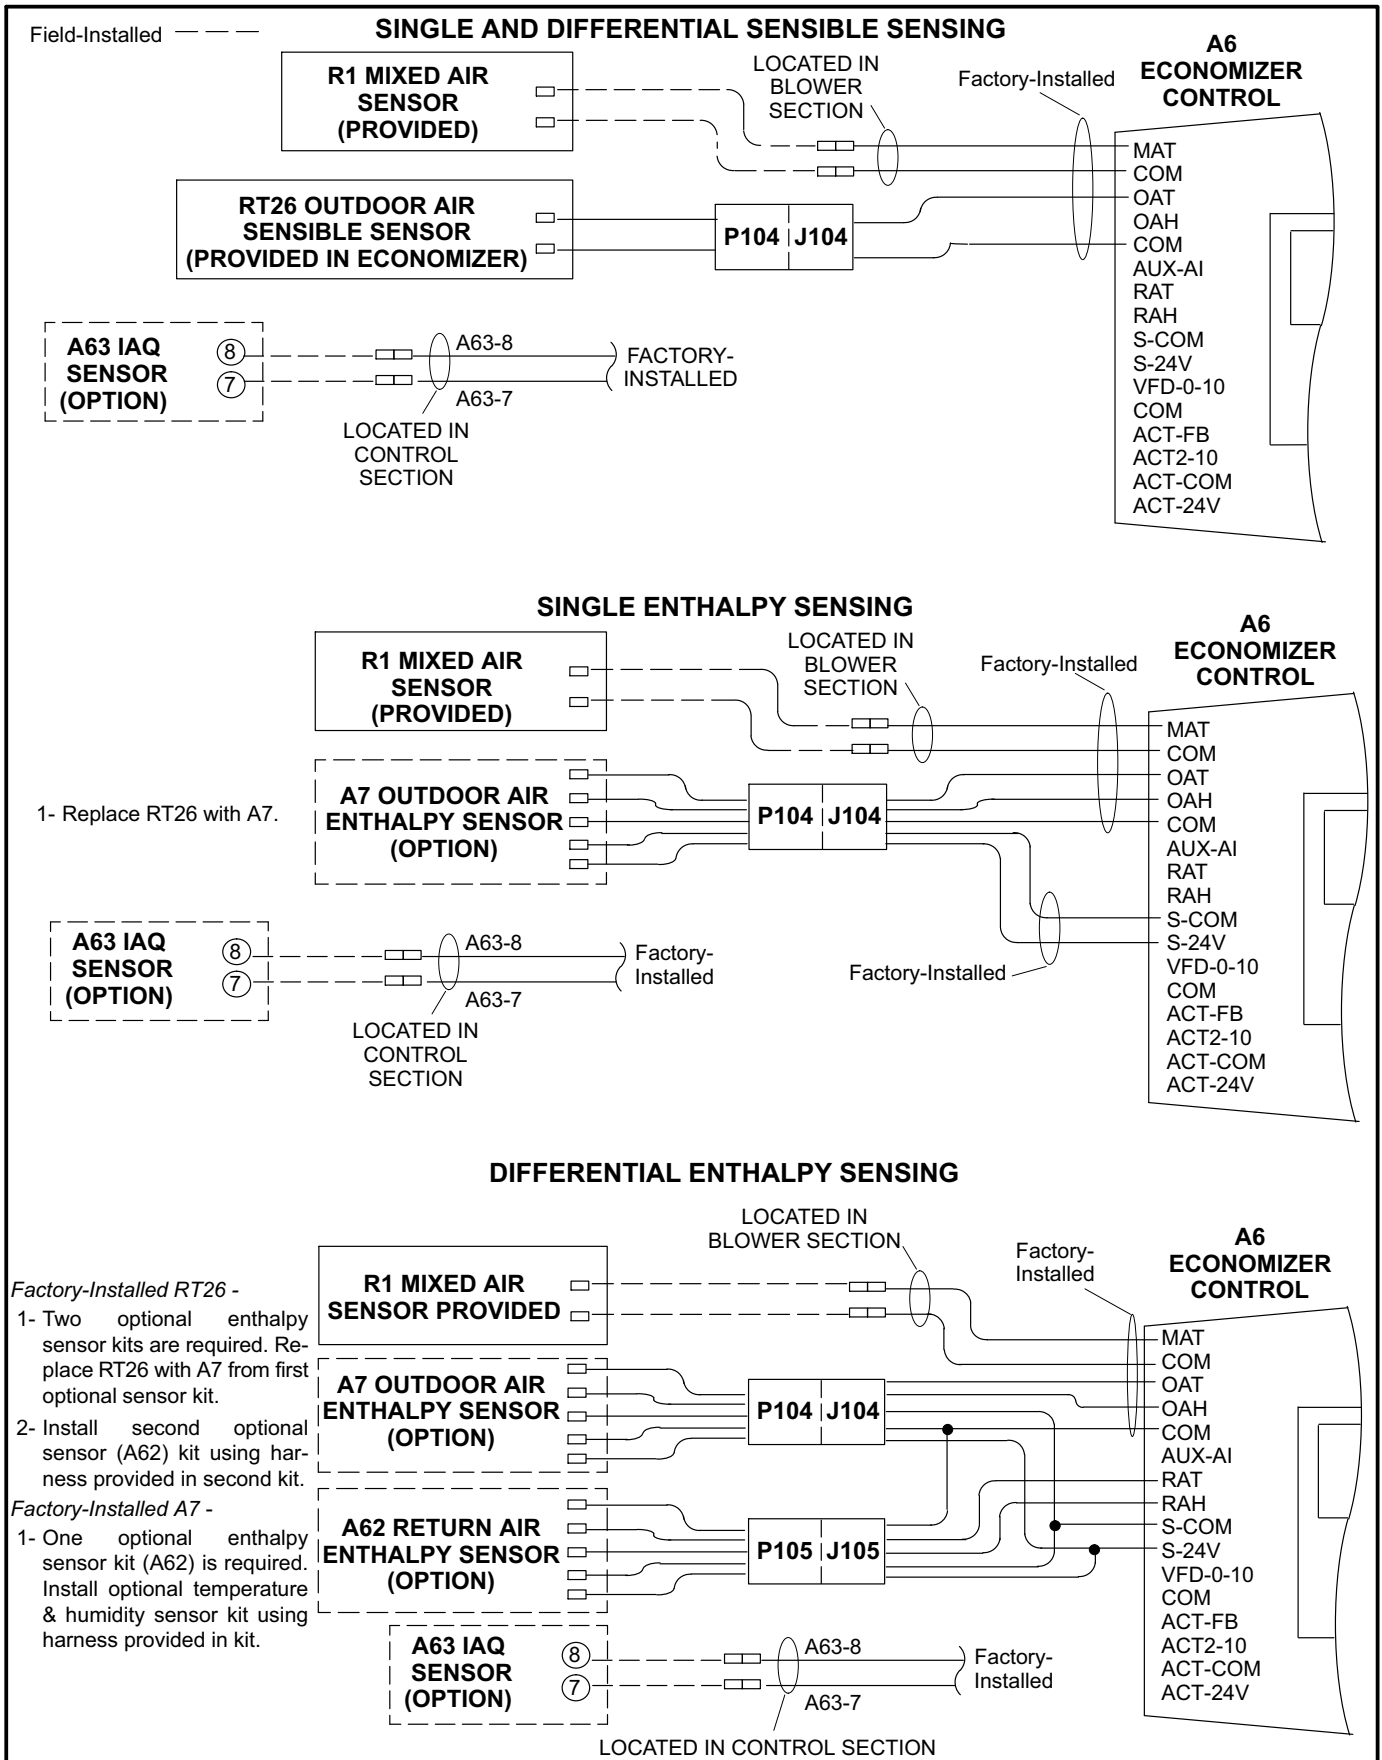


FIGURE 17

High Performance Economizer - A6 Control

USER INTERFACE

See figure 18.

- 1- One-line LCD. After a period of inactivity, the controller displays the default HMI screen (free cooling status: "1FREECOOL YES" or "1FREECOOL NO").
- 2- Operation button (Up button) - Move to the previous value, step or category.
- 3- Operation button (Down button)- Move to the next value, step or category.

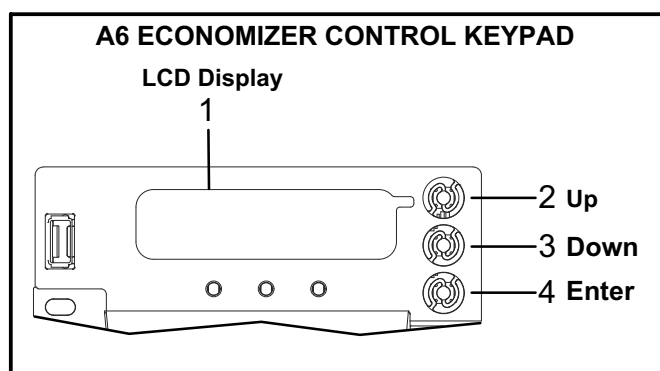


FIGURE 18

Operation button (Enter button):

- Press to edit the current value or option.
- Press to confirm a newly selected value or option.
- Press Enter + Up to jump up one entire category.
- Press Enter + Down to jump down one entire category.

MENU STRUCTURE

See figure 19.

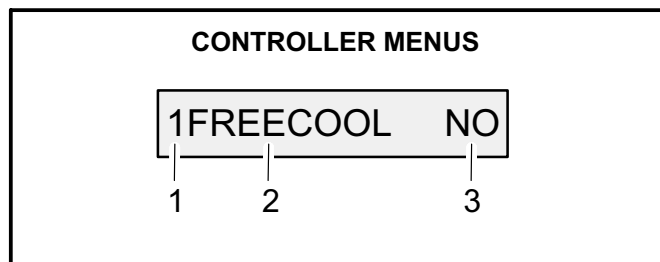


FIGURE 19

- 1- Menus are displayed in the Economizer Controller as per categories. There are eight first-level menus. Each menu is represented by a number at the beginning of the line on the LCD. Press Enter + Up or Down to toggle between different first-level menus.

- 1: Status Display
- 2: Basic Settings
- 3: Advanced Settings
- 4: Alarms
- 5: Enter Configuration State and Reset
- 6: I/O Config.
- 7: Testing
- 8: Enter Running State

- 2- Sub-menus follow the numbered first-level menus closely. Pressing Up or Down can toggle between different sub-menus.
- 3- At the end of the line, the LCD displays the value of the current sub-menu (if any). Enter the Edit mode by pressing Enter (if the value is editable). Press Up or Down to change the highlighted value. Press Enter to confirm the change and exit the Edit mode.

For a complete list of parameters refer to the Siemens installation manual provided in this kit.

FREE COOLING SETPOINT

Single OA Sensible Sensing (Default) -

The default free cooling setpoint or high limit setpoint is 63°F. This means that the outdoor air is suitable for free cooling at 62°F and below and not suitable at 64°F and above. This setpoint is adjustable.

For California Title 24 compliance, adjust the free cooling setpoint based on:

- The climate zone where the unit is installed. See table 7.
- The setpoint requirement published by the California Energy Commission. See Section 140.4 - Prescriptive Requirements for Space Conditioning Systems of the 2013 Building Energy Efficiency Standards.

NOTE - Values in the referenced standard will supersede values listed in table 7.

TABLE 7

FREE COOLING SETPOINT - SINGLE SENSIBLE

Climate Zone	Setpoint
1, 3, 5, 11-16	75°F
2, 4, 10	73°F
6, 8, 9	71°F
7	69°F

To adjust the setpoint, navigate to the "BASIC SETTINGS" menu and change the "2TEMP OFF" parameter accordingly.

Single OA Enthalpy Sensing (Optional) -

To adjust the enthalpy setpoint, navigate to the "BASIC SETTINGS" menu and change the "2ENTH OFF" parameter accordingly.

Differential Sensing (Optional) -

Two sensors can be used to compare outdoor air to return air. When outdoor air is cooler than return air, outdoor air is suitable for free cooling. When return air is cooler than outdoor air, the damper will modulate to the minimum position.

SETUP AND CONFIGURATION - FACTORY-INSTALLED ECONOMIZER

Program the following parameters into the controller. Navigate to the specific menus to make the changes required.

- 1INS (MM/DD/YY) enter installation date
- 2FAN L ACT* () adjust VDC value until desired fresh air setpoint is reached when fan runs at low speed. **Appears only if unit is configured as 2SPEED.*
- 2FAN H ACT () adjust VDC value until desired fresh air setpoint is reached

SETUP AND CONFIGURATION - FIELD-INSTALLED ECONOMIZER

Program the following parameters into the controller. Navigate to the specific menus to make the changes required.

IMPORTANT - Before setup and configuration, it is recommended to obtain some location-based values such as shutoff points or utilize the location services in the Climatix mobile application.

Menus are displayed in the Economizer Controller as per categories. There are eight first-level menus. Each of them is represented by a number at the beginning of the line on the LCD. Press Enter + Up or Down to toggle between different first-level menus.

Navigate to the applicable menus and set the following parameters based on the unit configuration:

- 1INS (MM/DD/YY) enter installation date
- 2FAN L ACT () adjust VDC value until desired fresh air set point is reached when fan runs at low speed (**Appears only if unit is configured as 2SPEED*)
- 2FAN H ACT () adjust VCD value until desired fresh air set point is reached
- 3DIF T LOC (LAT)
- 3STG3 DLY (120)
- 6Y2O (NONE) For single-stage units
(COOL 2) For 2-stage units
- 6FAN (1 SPEED) For CAV units
(2 SPEED) For MSAV units

ALARM MONITORING

The controller is equipped with a 24V output signal that can be configured for remote alarm monitoring. Field-wire to provided blue wire marked "Aux2-O" near the controller for remote alarm monitoring.

Note - Newer units are factory-wired to facilitate feedback wiring connections when a BACnet™ option is installed. Newer units can be identified by a P372 plug located near TB1 in the control box. One white and one gray wire are connected to P372. On older units, call 1-800-453-6669 for wiring assistance.

DEMAND CONTROL VENTILATION (DCV)

When a 0-10VDC CO₂ sensor is wired to the POL224.00 economizer control A6 (leads provided), the 2DCV, 2VENTMAX L, 2VENTMAX H, 2 VENTMIN L and 2VENTMIN H parameters will appear under "BASIC SETTINGS" menu. Navigate to the "BASIC SETTINGS" menu to adjust setpoints as desired. Refer to the Siemens manual provided for more details.

For proper operation, the IAQ sensor must provide a 0-10VDC signal. Connect sensor leads to the provided white wire marked "AUX-AI" located near the A6 economizer control located in the filter section.

CO₂ Sensor Used With High Performance Economizers-
When using any 0-10VDC sensor, set the ppm range using the POL224.00 economizer control A6 menu. Set the 6CO2 Rng L to 400 ppm and the 6CO2 Rng H to 1600 ppm.

High Performance Economizer - Sequence of Operation

Refer to tables 8, 9, 10 or 11.

When the outdoor air is suitable and a thermostat demand calls for 1st stage cooling (Y1), the economizer will modulate the dampers between the minimum and fully open positions to maintain a 55°F (12.8°C) mixed air temperature. When there is an increased thermostat demand for second stage cooling (Y2), the economizer damper opens 100% and the economizer controller (A6) will bring on the compressor. The damper will stay open 100% with the compressor running simultaneously until Y2 demand is met.

NOTE – If a two-speed fan is installed, the economizer controller (A6) will delay the compressor start for 5 minutes (default). To adjust the delay from 1 to 20 minutes, adjust the “2FAN DLY” setting.

NOTE – When there is a Y1 cooling demand, the economizer controller (A6) will display the mixed air temperature (R1). When there is a Y2 cooling demand and compressors are operating, the economizer controller (A6) will display the outdoor air temperature (RT26 or A7). In either case, the economizer controller (A6) will use the mixed air sensor for low temperature lock-out.

TROUBLESHOOTING, ALARMS AND CHECKOUT TESTS

Refer to the Siemens manual provided for details.

**TABLE 8
ECONOMIZER OPERATION - NO DCV (CO₂ SENSOR, 1-SPEED SUPPLY FAN)**

DCV	OA Good to Economize?	Y1-I	Y2-I	Y1-O	Y2-O	Occupied	Unoccupied
None	No	Off	Off	0-v/Off	0-v/Off	MIN POS	Closed
		On	Off	24-v/On	0-v/Off	MIN POS	Closed
		On	On	24-v/On	24-v/On	MIN POS	Closed
None	Yes	Off	Off	0-v/Off	0-v/Off	MIN POS	Closed
		On	Off	0-v/Off	0-v/Off	MIN POS to Full-Open	Closed to Full-Open
		On	On	24-v/On	0-v/Off	Full-Open	Full-Open

**TABLE 9
ECONOMIZER OPERATION - WITH DCV (CO₂ SENSOR, 1-SPEED SUPPLY FAN)**

DCV	OA Good to Economize?	Y1-I	Y2-I	Y1-O	Y2-O	Occupied	Unoccupied
Below set	No	Off	Off	0-v/Off	0-v/Off	VENTMIN	Closed
		On	Off	24-v/On	0-v/Off	VENTMIN	Closed
		On	On	24-v/On	24-v/On	VENTMIN	Closed
	Yes	Off	Off	0-v/Off	0-v/Off	VENTMIN	Closed
		On	Off	0-v/Off	0-v/Off	VENTMIN to Full-Open	Closed to Full-Open
		On	On	24-v/On	0-v/Off	Full-Open	Full-Open
Above set	No	Off	Off	0-v/Off	0-v/Off	VENTMIN to VENTMAX	Closed
		On	Off	24-v/On	0-v/Off	VENTMIN to VENTMAX	Closed
		On	On	24-v/On	24-v/On	VENTMIN to VENTMAX	Closed
	Yes	Off	Off	0-v/Off	0-v/Off	VENTMIN to VENTMAX	Closed
		On	Off	0-v/Off	0-v/Off	VENTMIN to Full-Open	Closed to Full-Open
		On	On	24-v/On	0-v/Off	Full-Open	Full-Open

High Performance Economizer - Sequence of Operation (continued)

**TABLE 10
ECONOMIZER OPERATION - NO DCV (CO₂ SENSOR, 2-SPEED SUPPLY FAN)**

DCV	OA Good to Economize?	Y1-I	Y2-I	Fan Speed	Y1-O	Y2-O	Occupied	Unoccupied
None	No	Off	Off	Low	0-v/Off	0-v/Off	MIN POS L	Closed
		On	Off	Low	24-v/On	0-v/Off	MIN POS L	Closed
		On	On	High	24-v/On	24-v/On	MIN POS H	Closed
None	Yes	Off	Off	Low	0-v/Off	0-v/Off	MIN POS L	Closed
		On	Off	High	0-v/Off	0-v/Off	MIN POS L to Full-Open	Closed to Full-Open
		On	On	High	Delay (b) 24-v/On	0-v/Off	Full-Open	Full-Open

(b) With 2FAN DLY (Basic Settings Menu), when in the economizing mode, there is a delay for the high speed fan to try to satisfy the call for second-stage cooling by turning on the fan to high and opening the OA dampers to 100% before the first-stage mechanical cooling is enabled.


**TABLE 11
ECONOMIZER OPERATION - WITH DCV (CO₂ SENSOR, 2-SPEED SUPPLY FAN)**

DCV	OA Good to Economize?	Y1-I	Y2-I	Fan Speed	Y1-O	Y2-O	Occupied	Unoccupied
Below set	No	Off	Off	Low	0-v/Off	0-v/Off	VENTMIN L	Closed
		On	Off	Low	24-v/On	0-v/Off	VENTMIN L	Closed
		On	On	High	24-v/On	24-v/On	VENTMIN H	Closed
	Yes	Off	Off	Low	0-v/Off	0-v/Off	VENTMIN L	Closed
		On	Off	High	0-v/Off	0-v/Off	VENTMIN L to Full-Open	Closed to Full-Open
		On	On	High	Delay (b) 24-v/On	0-v/Off	Full-Open	Full-Open
Above set	No	Off	Off	Low	0-v/Off	0-v/Off	VENTMIN L to VENTMAX L	Closed
		On	Off	Low	24-v/On	0-v/Off	VENTMIN L to VENTMAX L	Closed
		On	On	High	24-v/On	24-v/On	VENTMIN H to VENTMAX H	Closed
	Yes	Off	Off	Low	0-v/Off	0-v/Off	VENTMIN L to VENTMAX L	Closed
		On	Off	High	0-v/Off	0-v/Off	VENTMIN L to Full-Open	Closed to Full-Open
		On	On	High	Delay (b) 24-v/On	0-v/Off	Full-Open	Full-Open

(b) With 2FAN DLY (Basic Settings Menu), when in the economizing mode, there is a delay for the high speed fan to try to satisfy the call for second-stage cooling by turning on the fan to high and opening the OA dampers to 100% before the first-stage mechanical cooling is enabled.

High Performance Economizer - Wiring Diagram

TYPICAL ECONOMIZER WIRING DIAGRAM - KG, KC & KH UNITS

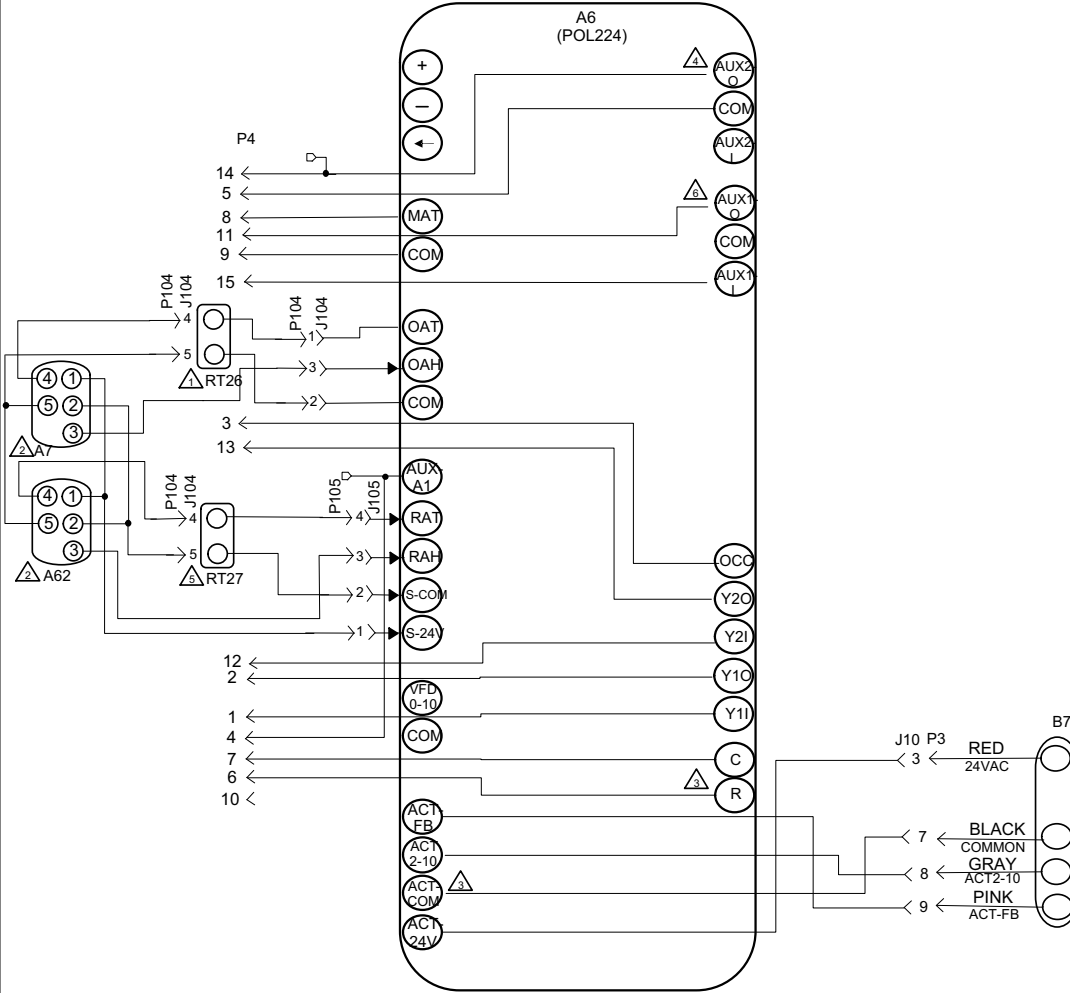

KEY	COMPONENT
A6	CONTROL - ECONOMIZER
A7	SENSOR - OUTDOOR ENTHALPY
A62	SENSOR - INDOOR ENTHALPY
B7	MOTOR - DAMPER ECONOMIZER
J10	JACK - ECONOMIZER MOTOR
J104	JACK - SENSOR OUTDOOR
J105	JACK - SENSOR RETURN AIR
P3	PLUG - ECONOMIZER MOTOR
P4	PLUG - ECONOMIZER
P104	PLUG - SENSOR OUTDOOR
P105	PLUG - SENSOR RETURN AIR
RT26	SENSOR - OUTDOOR AIR TEMP
RT27	SENSOR - RETURN AIR TEMP

← → DESIGNATES OPTIONAL WIRING
 - - - CLASS II FIELD V

- △ OUTDOOR AIR TEMP SENSOR RT26 OR OUTDOOR AIR ENTHALPY SENSOR A7 MAY BE USED.
- △2 FOR DIFFERENTIAL ENTHALPY SENSING USE OUTDOOR ENTHALPY SENSOR A7 AND RETURN AIR ENTHALPY SENSOR A62. REFER ALSO TO MAIN UNIT WIRING DIAGRAM SECTION C.
- △3 PROGRAMMABLE, USE FOR SYSTEM ALARM OUTPUT.
- △4 FOR DIFFERENTIAL TEMPERATURE SENSING USE RT26 & RT27 SENSORS.
- △6 PROGRAMMABLE, USE FOR POWER EXHAUST FAN 2 OUTPUT.

Gravity Exhaust Damper Installation

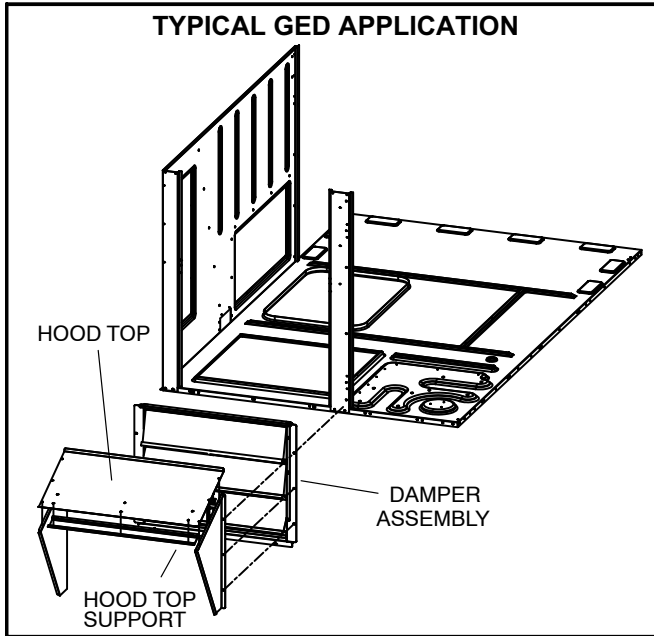


FIGURE 20

Downflow Application -- GED

- 1- Remove lower accessory compartment access panel (if necessary).
- 2- Apply foam insulating tape around the back of the flanged edges of the GED assembly.

NOTE - When GED is being used with the PEF power exhaust fans, gravity exhaust damper is installed over the outer side of the PEF assembly. See figure 21.

- 3- Align holes along the flanged edge of the GED with holes along the bottom of the unit.
- 4- Use provided screws to secure gravity exhaust damper assembly to unit.
- 5- Restore power to unit.

GED Hood Installation

- 1- Attach hood top to hood top support at the top of the damper assembly. See figure 20.

- 2- Remove screws from sides of economizer assembly (if installed). Remove paper backing from foam gaskets on hood sides. Secure left and right hood sides to the damper assembly as shown in figure 20.
- 3- Secure hood top to the hood sides.

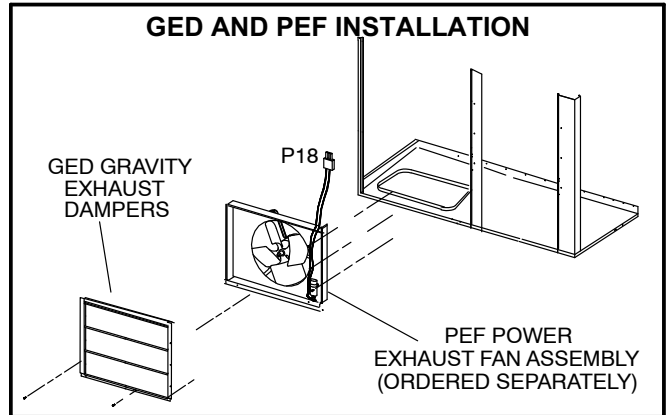


FIGURE 21
Horizontal Application

For horizontal applications, a separately ordered horizontal discharge kit is required. The horizontal, field-fabricated return air duct must be sized to accommodate the gravity exhaust damper and hood shipped with the economizer. A separately ordered low profile gravity exhaust damper (LAGEDH) and hood kit is available for size restricted applications. See figure 22.

- 1 - Cut one opening in return air plenum. Make sure opening is centered top to bottom in plenum.
- 2 - Secure hood sides to hood top as shown in figure 22.
- 3 - Apply foam insulating tape around the back of the flanged edges of the exhaust damper assembly.
- 4 - Align screw holes on top edges of hood and damper assembly.
- 5 - Slide combined exhaust damper assembly into plenum opening and secure using screws provided. See figure 22.
- 6 - Restore power to unit.

HORIZONTAL GRAVITY EXHAUST INSTALLATION - LOW PROFILE LAGEDH SHOWN - inches (mm)

RETURN AIR PLENUM

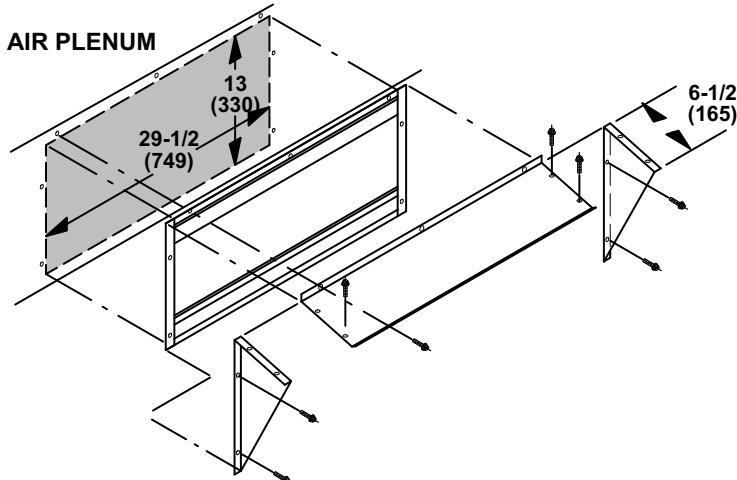


FIGURE 22

Install Outdoor Air Hood

The outdoor air hood is packaged separately and is attached to the economizer assembly crate. Use #10 self-drilling screws to assemble and install hood unless otherwise noted.

- 1- Remove screws which secure unit top panel to accessory compartment cabinet. Lift top panel to install hood top seal.
- 2 - Slide hood top seal under unit cabinet top and secure using three of the existing cabinet top panel screws. Install, but do not tighten, the screws on each end of the hood.
- 3 - Position the hood top edge V-channel under the corresponding V-channel on hood top seal and slide hood from right to left until it is properly positioned.
- 4 - Secure hood left side to the hood top and to the unit cabinet using the provided screws. See figure 23.
- 5 - Secure the hood right side to the hood top. Do NOT secure the hood right side to unit.
- 6 - Align the two holes on the left hood side with the two holes in the top filter seal bracket. Secure using provided screws.
- 7 - Secure top filter seal bracket to the right hood side in the same manner.
- 8 - Secure the right hood side to the unit.
- 9 - Slide two filters into slot of the bottom filter seal bracket. Insert a filter spacer between the two filters and secure it to the hood top panel. Use the provided threaded hex insert and a #10 - 32 X 1/2" thread forming screw to secure the hood top filter bracket. See figure 24.

NOTE - Slide the filters to the left side of the hood. Make sure there are no air gaps between either two filters or the filter and the hood right side.

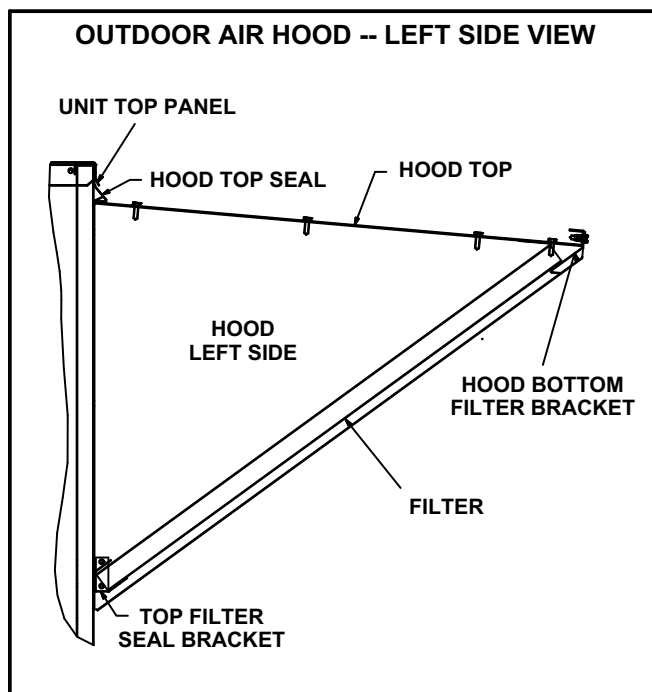


FIGURE 23

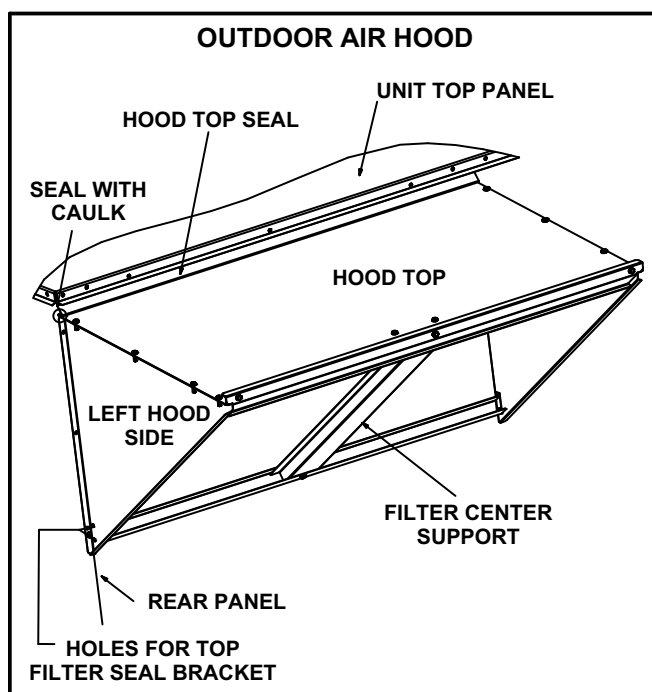


FIGURE 24

Install Economizer - Horizontal

A field-fabricated return air duct transition and duct inlet must be installed in horizontal applications. K1HECK, horizontal discharge kit, must be ordered separately.

- 1- Remove unit end panel. See figure 25.
- 2- Install the downflow return air cover in horizontal airflow applications. See instructions provided with K1HECK and figure 25.
- 3- Make sure the horizontal return air cover on the back side of the unit remains in place. The opening is used when an economizer is not installed. See figure 26.

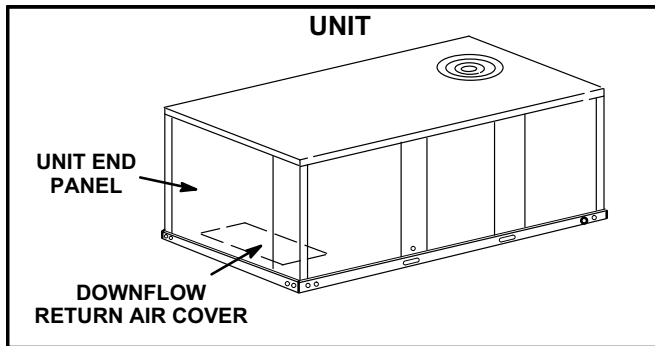


FIGURE 25

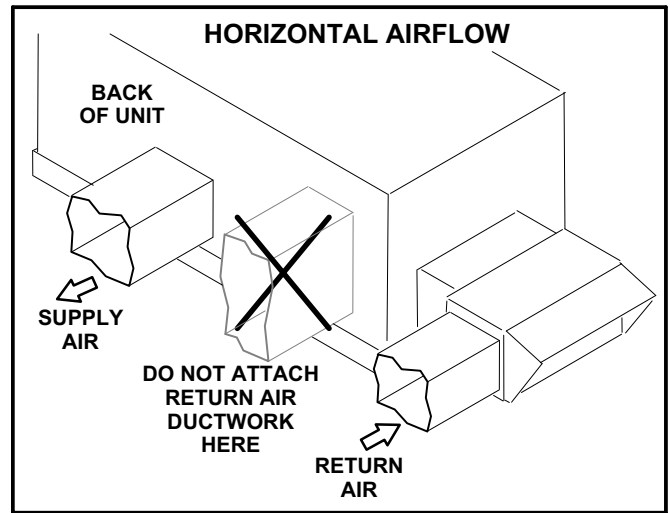


FIGURE 26

- 4- Install the economizer and R1 mixed air sensor and connect wiring as shown in appropriately named sections of this manual.
- 5- Install the field-fabricated return air duct transition and duct inlet on the unit end. See figure 27. Support the transition and duct inlet as needed.
- 6- Install the upper hood on the unit as shown in appropriate section of this manual.

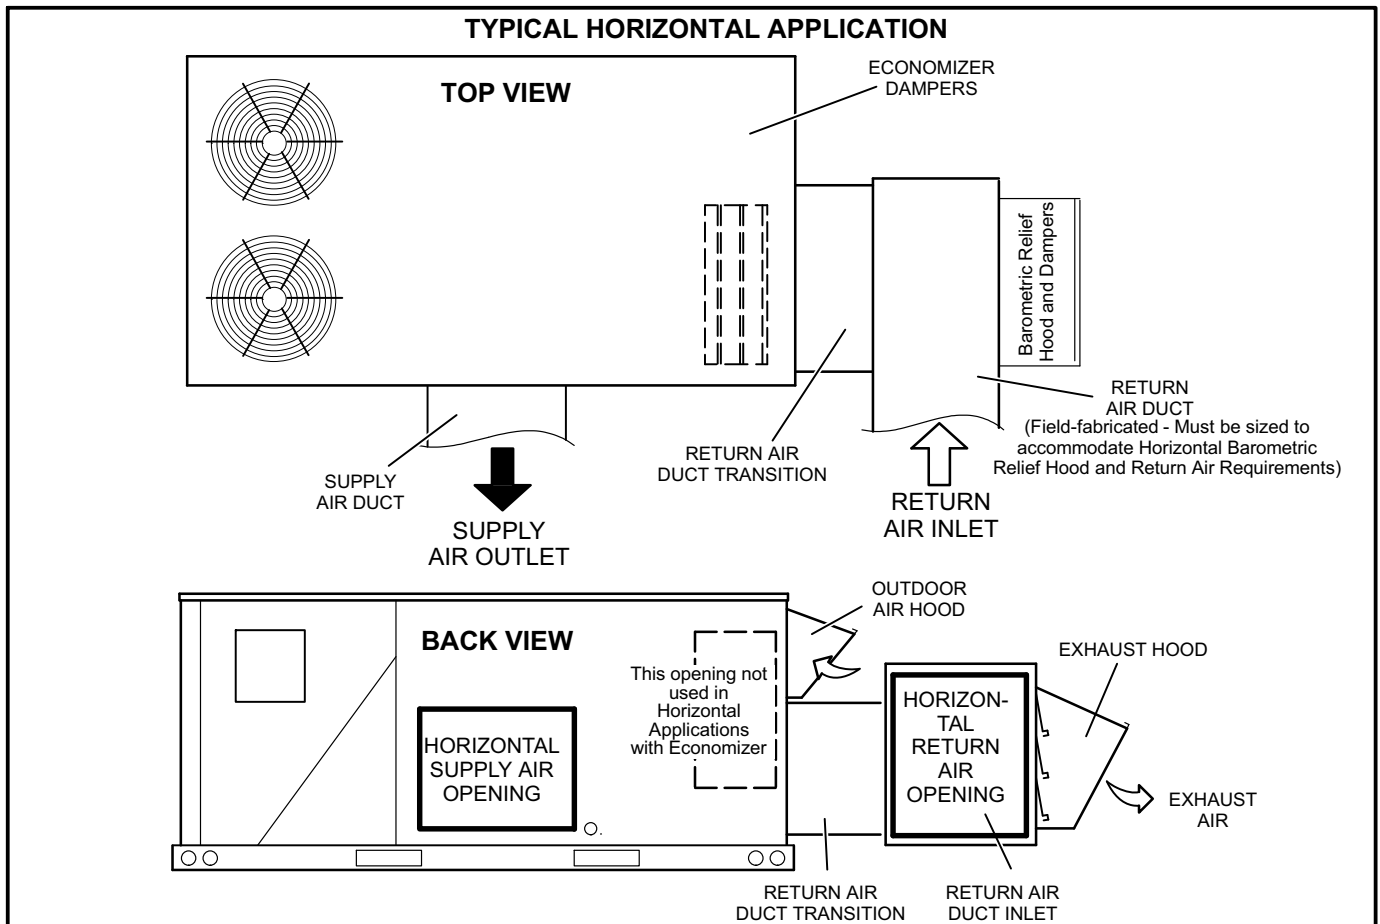


FIGURE 27