

SUBMITTAL DATA - OUTDOOR UNIT VPB264H4M-3G

VPB144H4M-3G + VPB120H4M-3G

VRF Heat Pump

Heat Pump Outdoor Unit	For: Beference	Approval	Poviow	Construction
System Designation:	Date:			
Schedule No.:	Location:			
Location:	Architect:			
Job:	Engineer:			

For: Reference Review Construction

FEATURES

- · Split coil heat exchanger
- · Dual hinged electrical boxes for ease of maintenance
- · High-efficiency vapor injection inverter
- compressors Each Module
- · Intelligent Duty Cycle operation
- · Night Silent operation

· Hinged service doors

Approval

- · Built-in service console
- · Built-in base pan heater
- · Low Ambient Cooling

- WARRANTY
- · Compressor 10-year limited warranty
- · All other components 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	264,000
······································	Rated ²	252000
EER	Ducted	11.1
	Non-Ducted	11.4
IEER	Ducted	21.7
	Non-Ducted	22.2
Heating Capacity ¹ (Btu/h)		282,000
COP47	Ducted	3.53
	Non-Ducted	3.64
COP17	Ducted	2.42
	Non-Ducted	2.4

ELECTRICAL DATA	
Power Supply (Volts/Phase/Hertz)	460/3/60
Minimum Circuit Ampacity (A)	37.4 + 29.5
Maximum Overcurrent Protection (A)	40 + 30
Compressor RLA (A)	15/14 + 21
Number of Compressors	2 + 1
Outdoor Fan Power Input (W)	1200/1200 + 820/930
Outdoor Fan FLA (A)	2.2/2.4 + 1.5/1.7
GENERAL DATA	
Connection Ratio	50% to 130%
Maximum Number of Indoor Units	49
Refrigerant Type	R-410A
Factory Refrigerant Charge (each unit)	23.8 lbs.

NOTES

- 1. Cooling and Heating capacity data is rated at the following conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor
 - Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor.
- 2. Complies with AHRI 1230-2014 testing standards
- Operating Voltage Range 410V to 525V 3.
- 4. To achieve cooling lower than 5°F a Low ambient hood must be installed. This is purchased as an accessory.
- A local 115V power outlet is available as an accessory to provide 5. local power for maintenance.



•		
	-	
		In the second se

DIMENSIONS		VPB144	VPB0120
DIMENSIONS		VF D 144	VFD0120
Unit	Height	72	64-3/8
Dimensions (in)	Width	68-1/2	52-3/4
	Depth	32-5/8	31-1/2
Main System Piping (in	n)		
Liquid Pipe Connection		3/4	5/8
Gas Pipe Connection		1-3/8	1-1/8
Balancing Pipework b	etween Module	es (in)	
L.P. Gas Balance Pipe (Connection	1-3/8	1-1/8
H.P. Gas Balance Pipe		3/4	3/4
Oil Balance Pipe Conne	ection	1/4	1/4
Unit Net Weight (lb)		1118	794



NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

Installation and service must be performed by a qualified installer and servicing agency.

495790 (201903)




SUBMITTAL DATA - OUTDOOR UNIT **VPB264H4M-3G** VPB144H4M-3G + VPB120H4M-3G **VRF Heat Pump**

DIMENSIONAL DRAWINGS - INCHES (MM)

VPB144

CORNER WEIGHTS							CENTER OF GRAVITY				
AA BB CC		С	DD		EE		FF				
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
172	78	264	120	330	150	321	146	37-3/4	953	12	305

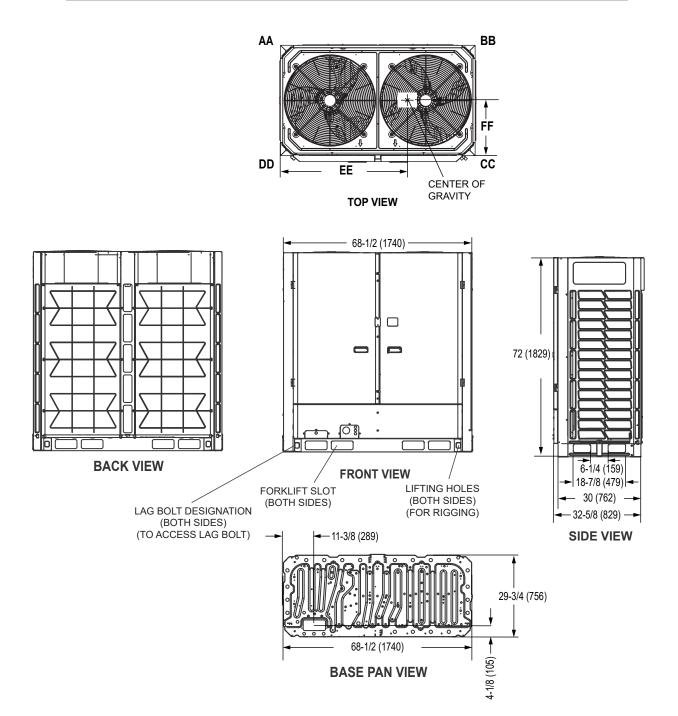

 NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

 Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

 Installation and service must be performed by a qualified installer and servicing agency.
 495790 (201903)
 ©2019 Lennox Inc.




SUBMITTAL DATA - OUTDOOR UNIT VPB264H4M-3G VPB144H4M-3G + VPB120H4M-3G **VRF Heat Pump**

DIMENSIONAL DRAWINGS - INCHES (MM)

VPB120

CORNER	CORNER WEIGHTS								CENTER OF GRAVITY			
A	А	A BB CC		С	DD		EE		FF			
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm	
121	55	203	92	211	96	251	114	27-3/4	705	12-1/4	311	

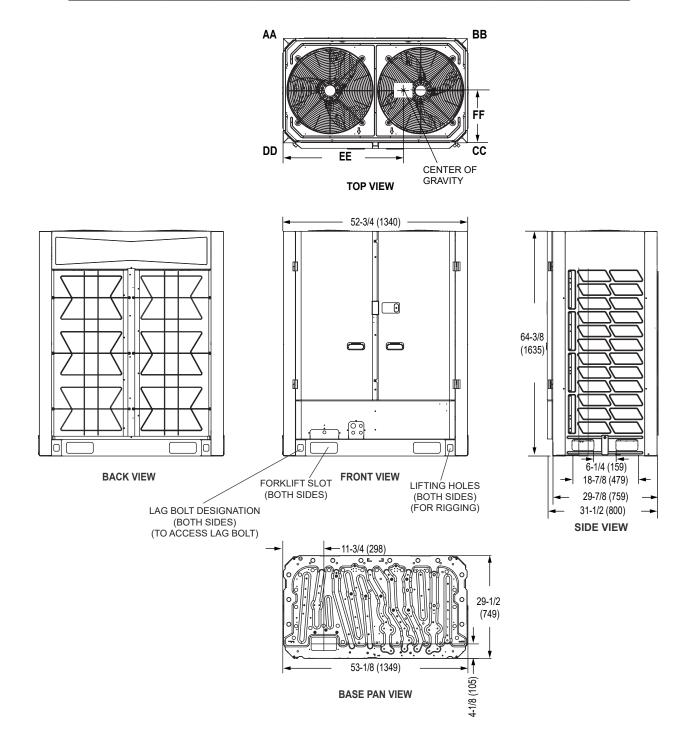


NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. 495790 (201903)

Installation and service must be performed by a qualified installer and servicing agency.




MULTI-MODULE INFORMATION



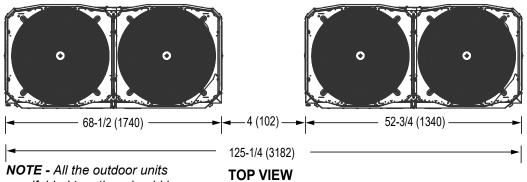

manifolded together should be installed at the same elevation.

Multi-Module Power

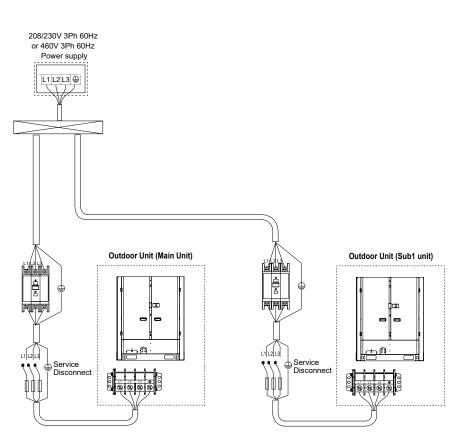

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.