

SUBMITTAL DATA - OUTDOOR UNIT VPB456H4M-3Y

VPB168H4M-3Y + VPB144H4M-3Y+ VPB144H4M-3Y VRF Heat Pump

Job:	Engineer:	
Location:	Architect:	
Schedule No.:	Location:	
System Designation:	Date:	

For:

DUMENIQUAN

Reference

Heat Pump Outdoor Unit

FEATURES

- · Split coil heat exchanger
- · High-efficiency vapor injection inverter compressors
- · Hinged service doors

Approval

· Built-in service console

Review

Construction

- · Built-in base pan heater
- · Low Ambient Cooling

- · Dual hinged electrical boxes for ease of maintenance
- · Intelligent Duty Cycle operation · Night Silent operation

- WARRANTY
- Compressor 10-year limited warranty
- All other components 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	456,000
······································	Rated ²	436000
EER	Ducted	9.5
	Non-Ducted	9.5
IEER	Ducted	17.4
	Non-Ducted	18.6
Heating Capacity ¹ (Btu/h)		490,000
COP47	Ducted	3.23
	Non-Ducted	3.2
COP17	Ducted	2.3
	Non-Ducted	23



ELECTRICAL DATA	
Power Supply (Volts/Phase/Hertz)	208-230/3/60
Minimum Circuit Ampacity (A)	(3) 69.5
Maximum Overcurrent Protection (A)	(3) 80
Compressor RLA (A)	(3) 27.2/27.2
Number of Compressors	(3) 2
Outdoor Fan Power Input (W)	(3) 1200/1200
Outdoor Fan FLA (A)	(3) 4.0/4.3
GENERAL DATA	
Connection Ratio	50% to 130%
Maximum Number of Indoor Units	64
Refrigerant Type	R-410A
Factory Refrigerant Charge (each unit)	23.8 lbs.

NOTES

- Cooling and Heating capacity data is rated at the following 1. conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor Complies with AHRI 1230-2014 testing standards 2.
- Operating Voltage Range 175V to 263V 3.
- To achieve cooling lower than 5°F a Low ambient hood must be 4. installed. This is purchased as an accessory.
- 5. A local 115V power outlet is available as an accessory to provide local power for maintenance.

DIMENSIONS		VPB168	VPB144	VPB144				
Unit	Height	72	72	72				
Dimensions (in)	Width	68-1/2	68-1/2	68-1/2				
	Depth	32-5/8	32-5/8	32-5/8				
Main System Piping (in)								
Liquid Pipe Connection	on	3/4	3/4	3/4				
Gas Pipe Connection		1-3/8	1-3/8	1-3/8				
Balancing Pipework between Modules (in)								
L.P. Gas Balance Pip Connection	e	1-3/8	1-3/8	1-3/8				
H.P. Gas Balance Pipe Connection		3/4	3/4	3/4				
Oil Balance Pipe Con	nection	1/4	1/4	1/4				
Unit Net Weight (lb)		1118	1118	1118				



NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495806 (202008)




SUBMITTAL DATA - OUTDOOR UNIT VPB456H4M-3Y VPB168H4M-3Y + VPB144H4M-3Y+ VPB144H4M-3Y

VRF Heat Pump

DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

CORNER WEIGHTS						CENTER OF GRAVITY					
A	A	В	BB CC		С	DD		EE		FF	
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
172	78	264	120	330	150	321	146	37-3/4	953	12	305

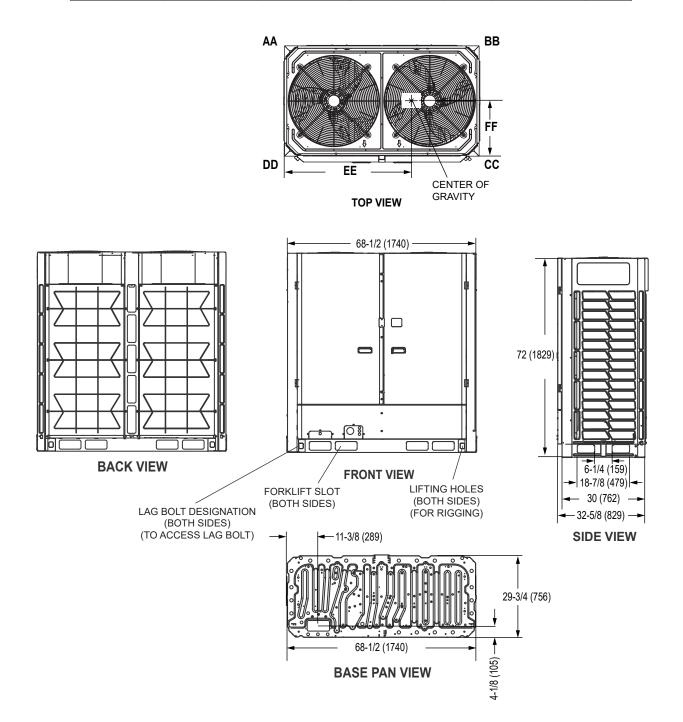

 NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

 Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

 Installation and service must be performed by a qualified installer and servicing agency.
 495806 (202008)
 ©2020 Lennox Inc.





SUBMITTAL DATA - OUTDOOR UNIT VPB456H4M-3Y VPB168H4M-3Y + VPB144H4M-3Y+ VPB144H4M-3Y

VRF Heat Pump

MULTI-MODULE INFORMATION



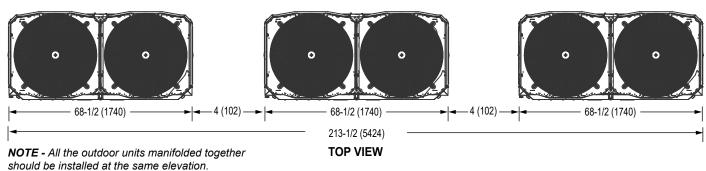

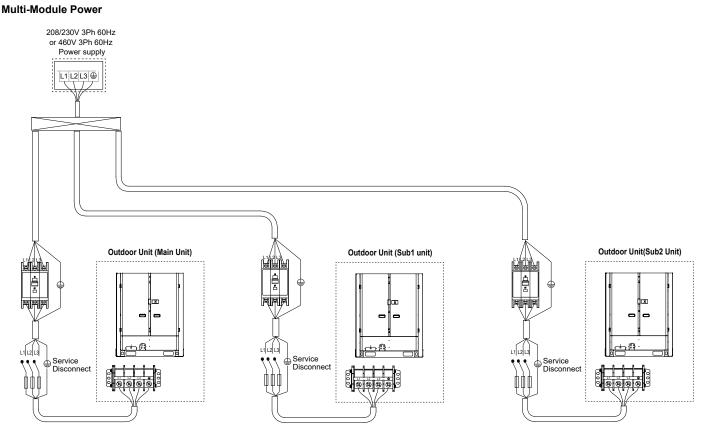

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.