

SUBMITTAL DATA - OUTDOOR UNIT VRA072H4M-2Y VRF HEAT RECOVERY

Job:	Engineer:	
Location:	Architect:	
Schedule No.:	Date:	
System Designation:	For: CReference CApproval Review Construction	

FEATURES

- Three-pipe heat recovery
- Split coil heat exchanger providing
 ontinuous heating during defrost
- Hinged electrical box for ease of maintenance
 - High efficiency DC Inverter scroll compressor
- Intelligent Duty Cycle operation
- Night Silent operation

SPECIFICATIONS	
PERFORMANCE	

PERFORMANCE			
Cooling Capacity ¹ (Btu/h)	Nominal	72,000	
	Rated ²	69,000	
EER	Ducted	12.00	
	Non-Ducted	13.80	
IEER	Ducted	22.70	
	Non-Ducted	23.60	
Simultaneous Heating and	Ducted	26.70	
Cooling Efficiency (SCHE)	Non-Ducted	30.00	
Heating Capacity ¹ (Btu/h)		77,000	
COP47	Ducted	3.69	
	Non-Ducted	4.25	
COP17	Ducted	2.41	
	Non-Ducted	2.65	
ELECTRICAL DATA			
Power Supply ³ (V/Hz/Ph)		460/60/3	
Minimum Circuit Ampacity (A)		18.7	
Maximum Overcurrent Protection (A)		30	
Compressor RLA (A)		14	
No. of Compressors		1	
Outdoor Fan Power Input (W)		260/260	
Outdoor Fan FLA (A)		0.6/0.6	
GENERAL DATA			
Connection Ratio		50% to 130%	
Max. # of Indoor Units		13 units	
Sound Pressure Level (dBA)		59	
Outdoor Fan Air Volume (cfm)		7215	
Refrigerant type		R-410A	
Factory refrigerant charge		28 lbs. 11 oz.	
DIMENSIONS			
Unit Dimensions (in)	Height	63-1/8	
	Width	49-1/2	
	Depth	30-1/8	
Liquid Pipe Connection (in)		1/2	
Gas Pipe Connection (in)		7/8	
Shipping/Net Weight (lb)		672/635	



WARRANTY

- Compressor 10 year limited warranty
- All other components 10 year limited warranty *See warranty for details

NOTES


- Cooling and Heating Capacity data is rated at the following conditions:
 Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Indoor
- 2. Complies with AHRI 1230-2014 testing standards
- 3. Operating Voltage Range: 191V to 247V





SUBMITTAL DATA - OUTDOOR UNIT VRA072H4M-2Y VRF HEAT RECOVERY



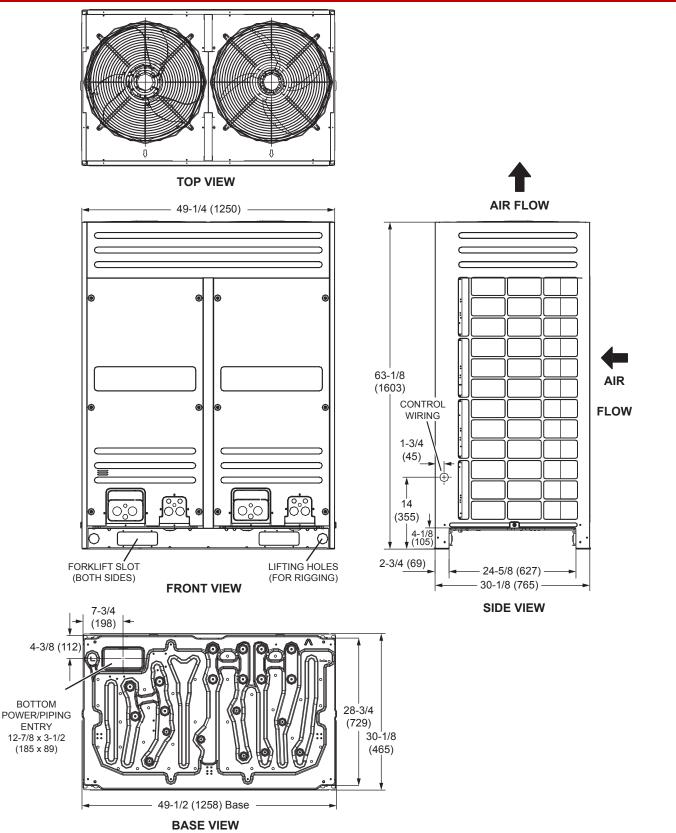

DISCLAIMER – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause properly damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495406 (201804) ©2018 Lenn