

SUBMITTAL DATA - OUTDOOR UNIT **VRB240H4M-3Y**

VRB120H4M-3Y + VRB120H4M-3Y

Review

VRF Heat Recovery

Construction

Job:	Engineer:	
Location:	Architect:	
Schedule No.:	Location:	
System Designation:	Date:	

Heat Recovery Outdoor Unit

<u> م</u>			ES
-/ -	νīυ	תע	EO

WARRANTY

EER

· Split coil heat exchanger

*See warranty for details

SPECIFICATIONS PERFORMANCE

Cooling Capacity¹ (Btu/h)

· High-efficiency vapor injection inverter

For:

Reference

- compressor Each Module
- · Hinged service doors

Approval

- · Built-in service console
- · Built-in base pan heater · Low Ambient Cooling

· Dual hinged electrical boxes for ease of maintenance

· Compressor - 10-year limited warranty

· All other components - 10-year limited warranty

Intelligent Duty Cycle operation

240.000

230000

11.1

10.8

· Night Silent operation

Nominal

Rated²

Ducted Non-Ducted



IEER	Ducted	20.3		
	Non-Ducted	22		
Simultaneous Heating and	Ducted	27.9		
Cooling Efficiency (SCHE)	Non-Ducted	30.4		
Heating Capacity ¹ (Btu/h)		258,000		
COP47	Ducted	3.37		
	Non-Ducted	3.4		
COP17	Ducted	2.27		
	Non-Ducted	2.16		
ELECTRICAL DATA				
Power Supply (Volts/Phase/Hertz)	20	208-230/3/60		
Minimum Circuit Ampacity (A)		(2) 54		

Power Supply (Volts/Phase/Hertz)	208-230/3/60
Minimum Circuit Ampacity (A)	(2) 54
Maximum Overcurrent Protection (A)	(2) 60
Compressor RLA (A)	(2) 38.3
Number of Compressors	(2) 1
Outdoor Fan Power Input (W)	(2) 780/890
Outdoor Fan FLA (A)	(2) 2.9/3.2
	· · · · · · · · · · · · · · · · · · ·
CENERAL DATA	

GENERAL DATA	
Connection Ratio	50% to 130%
Maximum Number of Indoor Units	44
Refrigerant Type	R-410A
Factory Refrigerant Charge (each unit)	23.8 lbs.

NOTES

1.	Cooling and Heating capacity data is rated at the following
	conditions:
	Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor
	Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor

- 2. Complies with AHRI 1230-2014 testing standards
- 3. Operating Voltage Range 175V to 263V
- 4. To achieve cooling lower than 5°F a Low ambient hood must be installed. This is purchased as an accessory.
- 5. A local 115V power outlet is available as an accessory to provide local power for maintenance.

DIMENSIONS (Each Mc	odule)						
Unit	Height	64-3/8					
Dimensions (in)	Width	52-3/4					
	Depth	31-1/2					
Main System Piping (in)							
Liquid Pipe Connection		5/8					
High Pressure Gas Pipe		1-1/8					
Low Pressure Gas Pipe		1-1/8					
Balancing Pipework between Modules (in)							
Gas Balance Pipe Connection	on	3/4					
Oil Balance Pipe Connection	1	1/4					
Unit Net Weight (lb)		794					

DIMENDIONO (Es ale Mastela)



NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495763 (202008)

©2020 Lennox Industries Inc.




SUBMITTAL DATA - OUTDOOR UNIT VRB240H4M-3Y VRB120H4M-3Y + VRB120H4M-3Y VRF Heat Recovery

DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

CORNER WEIGHTS						CENTER	OF GRAV	ΊΤΥ			
AA BB		CC		D	DD		E	FF	-		
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
121	55	203	92	211	96	251	114	27-3/4	705	12-1/4	311

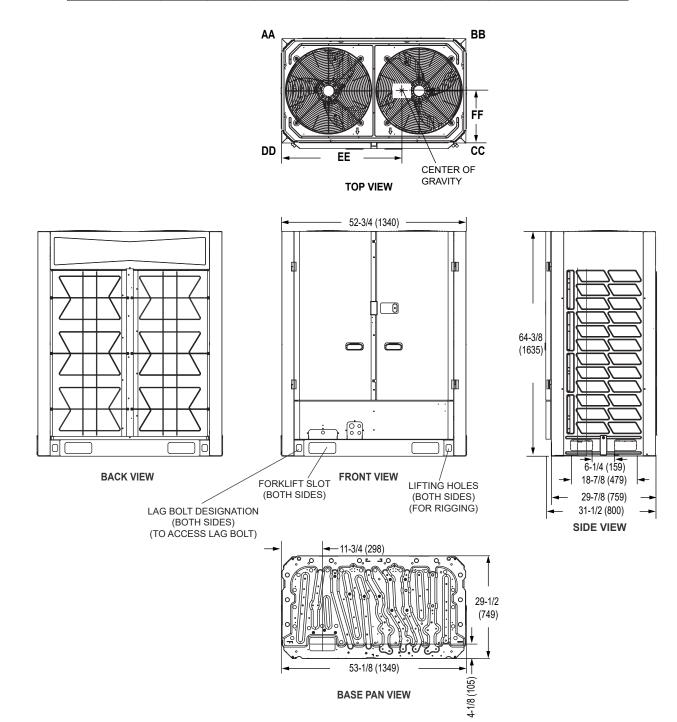


NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495763 (201903)




MULTI-MODULE INFORMATION

Multi-Module Dimensions

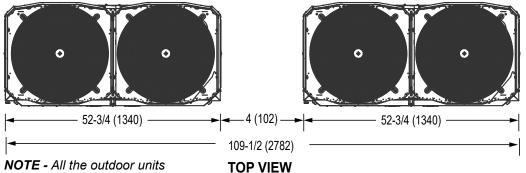

manifolded together should be installed at the same elevation.

Multi-Module Power

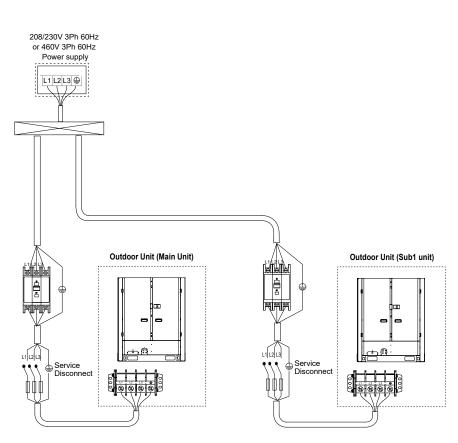

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.