

SUBMITTAL DATA - OUTDOOR UNIT VRB336H4M-3Y

VRB168H4M-3Y + VRB168H4M-3Y

Review

VRF Heat Recovery

Construction

Job:	Engineer:
Location:	Architect:
Schedule No.:	Location:
System Designation:	Date:

• High-efficiency vapor injection inverter

compressors - Each Module

· Intelligent Duty Cycle operation

· Night Silent operation

Heat Recovery Outdoor Unit

Date:					
	For:	Reference	Approval		

- · Hinged service doors
- · Built-in service console
- · Built-in base pan heater
- · Low Ambient Cooling

maintenance

· Split coil heat exchanger

WARRANTY

FEATURES

· Compressor - 10-year limited warranty

· Dual hinged electrical boxes for ease of

· All other components - 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	336,000
······································	Rated ²	320000
EER	Ducted	10.4
	Non-Ducted	10.6
IEER	Ducted	19.3
	Non-Ducted	20.6
Simultaneous Heating and	Ducted	24.9
Cooling Efficiency (SCHE)	Non-Ducted	28
Heating Capacity ¹ (Btu/h)		360,000
COP47	Ducted	3.39
	Non-Ducted	3.3
COP17	Ducted	2.38
	Non-Ducted	23



ELECTRICAL DATA			
Power Supply (Volts/Phase/Hertz)	208-230/3/60		
Minimum Circuit Ampacity (A)	(2) 69.5		
Maximum Overcurrent Protection (A)	(2) 80		
Compressor RLA (A)	(2) 27.2/27.2		
Number of Compressors	(2) 2		
Outdoor Fan Power Input (W)	(2) 1200/1200		
Outdoor Fan FLA (A)	(2) 4.0/4.3		
GENERAL DATA			
Connection Ratio	50% to 130%		
Maximum Number of Indoor Units	62		
Refrigerant Type	R-410A		
Factory Refrigerant Charge (each unit)	23.8 lbs.		

NOTES

- Cooling and Heating capacity data is rated at the following 1. conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor 2. Complies with AHRI 1230-2014 testing standards
- Operating Voltage Range 175V to 263V 3.
- To achieve cooling lower than 5°F a Low ambient hood must be 4. installed. This is purchased as an accessory.
- 5. A local 115V power outlet is available as an accessory to provide local power for maintenance.

DIMENSIONS (Each Module)

Unit	Height	72
Dimensions (in)	Width	68-1/2
	Depth	32-5/8
Main System Piping (in)		
Liquid Pipe Connection		3/4
High Pressure Gas Pipe		1-3/8
Low Pressure Gas Pipe		1-3/8
Balancing Pipework betwee	en Modu	les (in)
Gas Balance Pipe Connection	า	3/4
Oil Balance Pipe Connection		1/4
Unit Net Weight (lb)		1118




NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495760 (202008)



DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

CORNER WEIGHTS							CENTER OF GRAVITY				
A	AA BB		в	CC		D	D	E	E FF		F
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
172	78	264	120	330	150	321	146	37-3/4	953	12	305

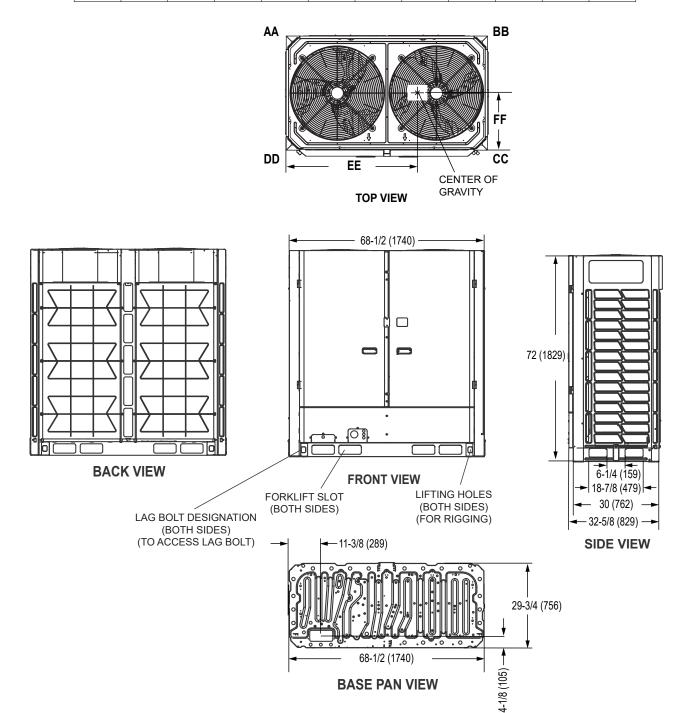


NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495760 (201903)




MULTI-MODULE INFORMATION

Multi-Module Dimensions

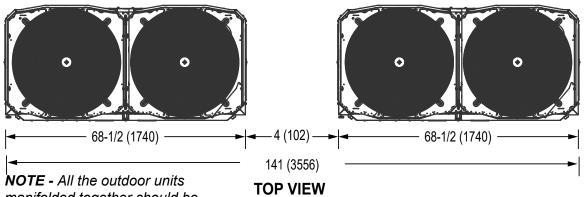

manifolded together should be installed at the same elevation.

Multi-Module Power

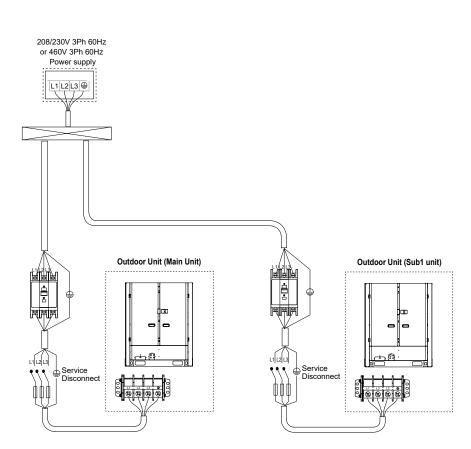

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.