

SUBMITTAL DATA - OUTDOOR UNIT VRB504H4M-3Y

VRB168H4M-3Y + VRB168H4M-3Y+ VRB168H4M-3Y VRF Heat Recovery

Job:	Engineer:	
Location:	Architect:	
Schedule No.:	Location:	
System Designation:	Date:	

For:

DIMENSIONS

Dimensions (in)

Main System Piping (in) Liquid Pipe Connection

High Pressure Gas Pipe

Low Pressure Gas Pipe

Unit Net Weight (lb)

Gas Balance Pipe Connection

Oil Balance Pipe Connection

Unit

Reference

Heat Recovery Outdoor Unit

FEATURES	
Split coil heat excha	anger

· High-efficiency vapor injection inverter compressors

· Intelligent Duty Cycle operation

· Night Silent operation

· Hinged service doors

Approval

· Built-in service console

Review

Construction

- · Built-in base pan heater
- · Low Ambient Cooling

- WARRANTY

maintenance

Compressor - 10-year limited warranty

Dual hinged electrical boxes for ease of

All other components - 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	492,000
()	Rated ²	470000
EER	Ducted	9.3
	Non-Ducted	9.3
IEER	Ducted	16.3
	Non-Ducted	17.6
Simultaneous Heating and	Ducted	20.7
Cooling Efficiency (SCHE)	Non-Ducted	20
Heating Capacity ¹ (Btu/h)		512,000
COP47	Ducted	3.2
	Non-Ducted	3.2
COP17	Ducted	2.23
	Non-Ducted	2.2



VRB168

72

68-1/2

32-5/8

3/4

1-3/8

1-3/8

3/4

1/4

1118

Height

Width

Depth

Balancing Pipework between Modules (in)

VRB168

72

68-1/2

32-5/8

3/4

1-3/8

1-3/8

3/4

1/4

1118

VRB168

72

68-1/2

32-5/8

3/4

1-3/8

1-3/8

3/4

1/4

1118

ELECTRICAL DATA			
Power Supply (Volts/Phase/Hertz)	208-230/3/60		
Minimum Circuit Ampacity (A)	(3) 69.5		
Maximum Overcurrent Protection (A)	(3) 80		
Compressor RLA (A)	(3) 27.2/27.2		
Number of Compressors	(3) 2		
Outdoor Fan Power Input (W)	(3) 1200/1200		
Outdoor Fan FLA (A)	(3) 4.0/4.3		
GENERAL DATA			
Connection Ratio	50% to 130%		
Maximum Number of Indoor Units	64		
Refrigerant Type	R-410A		
Factory Refrigerant Charge (each unit)	23.8 lbs.		

NOTES

- Cooling and Heating capacity data is rated at the following 1. conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor
- 2. Complies with AHRI 1230-2014 testing standards
- Operating Voltage Range 175V to 263V 3.
- To achieve cooling lower than 5°F a Low ambient hood must be 4 installed. This is purchased as an accessory.
- 5. A local 115V power outlet is available as an accessory to provide local power for maintenance.

CERTIFIED Intertek

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495784 (202008)




SUBMITTAL DATA - OUTDOOR UNIT VRB504H4M-3Y VRB168H4M-3Y + VRB168H4M-3Y+ VRB168H4M-3Y

VRF Heat Recovery

DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

CORNER WEIGHTS						CENTER OF GRAVITY					
A	AA BB		В	CC 1		D	D EE		E	FF	
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
172	78	264	120	330	150	321	146	37-3/4	953	12	305

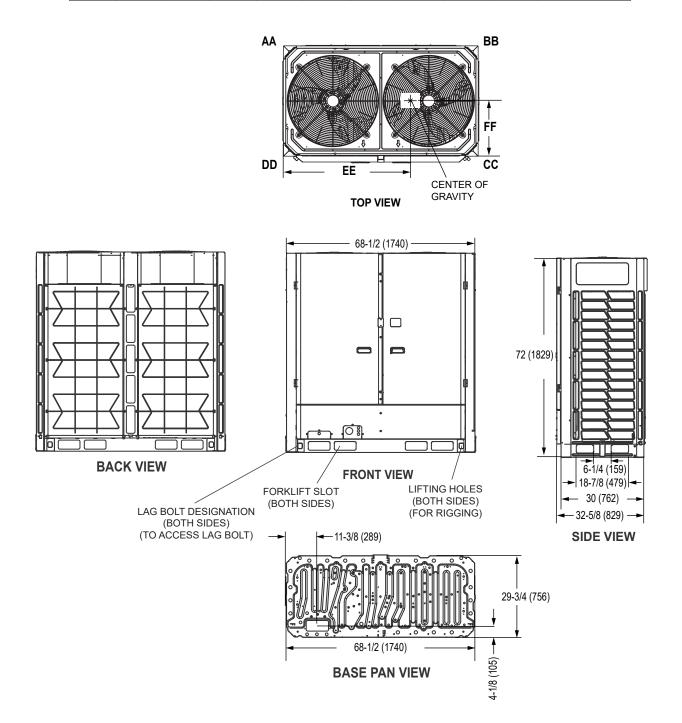

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495784 (201903)





SUBMITTAL DATA - OUTDOOR UNIT VRB504H4M-3Y VRB168H4M-3Y + VRB168H4M-3Y+ VRB168H4M-3Y

VRF Heat Recovery

MULTI-MODULE INFORMATION



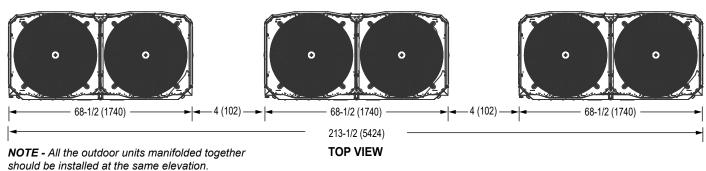

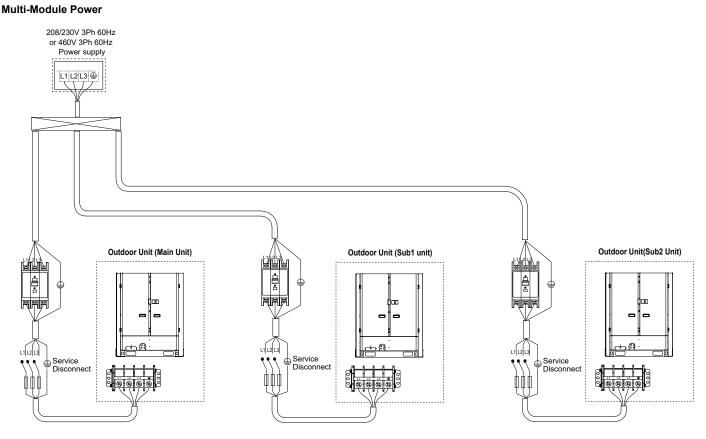

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.