

GCS11-2753 AND GCS11-3003 SINGLE PACKAGE UNITS


ALL SEASON - DX COOLING & GAS HEATING

*240,000 to 280,000 Btuh Cooling Capacity 290,000 to 450,000 Btuh Input Heating Capacity


*ARI Standard 360





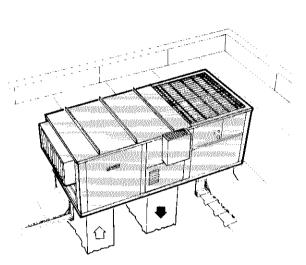

Rooftop Installation with Double Duct Air Distribution System

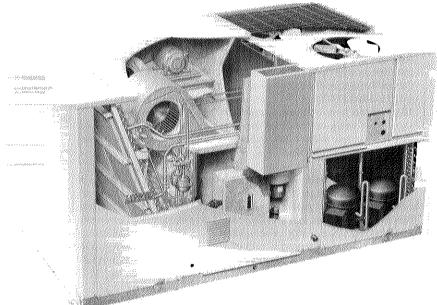

ENGINEERING DATA

COMBINATION


UNITS

ROOFTOP


Page 45

October 1989

Supersedes March 1988

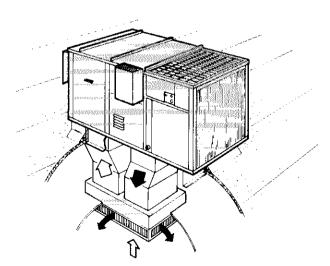

Rooftop Installation with Combination Ceiling Supply and Return Air System

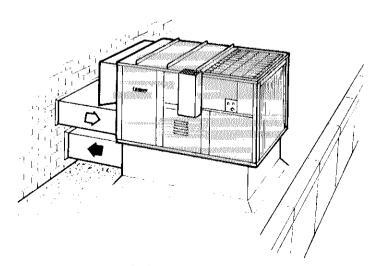

Rooftop Installation with Horizontal (End) Supply and Return Air System

FEATURES

Applications — The Lennox GCS11 combination DX cooling and gas fired heating units are designed for rooftop installation with bottom handling of supply and return air. A separate roof mounting frame (optional) mates to the bottom of the unit and when flashed into the roof permits weatherproof duct connections and entry into the conditioned area. Separate supply and return air double duct, combination ceiling supply and return air duct, or horizontal end duct systems are applicable to the units. A choice of RTD step-down or FD flush model diffusers are available for combination ceiling supply and return air distribution systems. Economizer dampers option will provide "free cooling" by using outdoor air in lieu of mechanical refrigeration. Thermostat and system controls are not furnished and must be ordered extra. Available as options are W973 control system, W7400 control system, electro-mechanical, Pro-stat or T7300 thermostat control systems. Units are shipped completely factory assembled, piped, and wired. Each unit is test operated at the factory before shipment, insuring unit dependability on the job site.

Approvals — Units are A.G.A. certified as combination heating-cooling units for outdoor installation. GCS11-2753 units have been rated in the Lennox Research Laboratory environmental test room in accordance with ARI Standard 360-86. GCS11-3003 units have been rated at ARI Standard 360 test conditions. Units and components within are bonded for grounding to meet safety standards for servicing required by U.L. and National Electrical Codes. Blower data is from tests conducted in the Lennox Laboratory air test chamber.

Refrigeration System — Factory sealed refrigeration system consists of compressors, condenser coils and direct drive fans, evaporator (dual circuits) coil and blower, expansion valves, sight glasses, high capacity driers, high pressure switches, loss of charge switches, refrigerant lines connected and a full operating charge of refrigerant. Dual independent refrigerant circuits provide staging control to fit varying cooling loads. Lennox augments its reliable operating components with a full complement of standard comfort and safety controls.

Rugged DURATUBE® Heat Exchanger — Aluminized steel cylindrical tube and drum heat exchanger construction permits normal expansion and contraction without metal fatigue. Design results in high input to heat surface ratio, low resistance to air travel reducing blower horsepower requirements and ease of cleaning. All heat exchanger surfaces are of aluminized steel for superior resistance to corrosion and oxidation. Round surfaces create minimum air resistance. Air wipes all surfaces for excellent heat transfer. Removable rear breeching provides complete service access. Heat exchanger has been laboratory life cycle tested.

Gas Power Burner - Provides efficient, trouble free operation and is unaffected by adverse wind or atmospheric conditions. Aluminized steel venturi mix air and gas in correct proportion for proper combustion. Stainless steel flame spreaders fit flame to combustion chamber resulting in uniform heat distribution. Burner is equipped with four venturi with two operating on low fire (1st stage) and all four firing on high fire (2nd stage). Burner has pilot spark ignition. Pilot flame burns continuously during main burner operation, spark occurs only for pilot ignition. Redundant combination control combines a manual main shut-off valve, pressure regulation and automatic electric valve (dual) into one compact control. Dual valve design provides double assurance of close off of gas supply during no heat cycle and in case of any abnormal operating conditions. A separate solenoid gas valve provides high fire (2nd stage) operation. Electronic flame sensor controls assure safe and reliable operation. Combustion air blower is equipped with air pressure switch which prepurges heat exchanger and proves blower operation before allowing main gas valve to open. Blower motor is resiliently mounted. Burner has inspection glass for flame viewing; easy combustion air adjustment and is easily removed for service.

Durable Cabinet — Rugged leaktight cabinet is constructed of heavy gauge galvanized steel. Cabinet is subject to a five station metal wash process resulting in a perfect bonding surface for a paint finish of powder enamel, electrostatically bonded to the metal. Base section and cabinet panels exposed to conditioned air are lined with thick fiberglass insulation. Insulation is sandwiched between the panel and a galvanized steel panel liner protecting the insulation indefinitely. Large removable panels allow complete service access. Electrical inlets are provided in the cabinet for wiring entry. Wiring junction box and control boxes with all controls factory installed are conveniently located for service access. Flue vent cap is constructed of durable, corrosion resistant aluminum. Lifting brackets are furnished for ease of handling and rigging. Drainage holes in base rails provide moisture removal. Evaporator coil and heat exchanger section drain connections are located on both sides of cabinet.

Dual Compressors — Two compressors in units provide staging control to fit varying cooling load requirements. Reliable compressors are hermetically sealed. Suction cooled, overload protected, and equipped with internal pressure relief valve. Internally protected from excessive current and temperature. Immersible self-regulating type crankcase heater is temperature actuated to operate only when required and ensures proper lubrication at all times. Conveniently located control box gives one spot servicing. The entire running gear is spring mounted within the sealed housing. In addition, the compressors are installed on resilient rubber mounts in the unit, assuring quiet and vibration free operation.

Copper Tube Evaporator and Condenser Coils — Extra large surface area and circuiting of coils provide maximum cooling efficiency, excellent heat transfer and low air resistance. Coils are constructed of precisely spaced ripple-edged aluminum fins fitted to durable copper tubes. Fins are equipped with collars that grip tubing for maximum contact area. Flared shoulder tubing connections and silver soldering provide tight, leakproof joints. Long life copper tubing is easy to field service. Coil is thoroughly factory tested under high pressure to insure leakproof construction. The evaporator coil is face split with two separate circuits. Each circuit has its separate expansion valve, compressor and refrigerant charge.

Efficient Condenser Fans — Two direct drive fans draw large air volumes uniformly through dual condenser coils and discharges it vertically, up and away from the building. Fan orifice design and low fan tip speed keeps operating sound level at a minimum. Uniform air flow through the coils results in high refrigerant cooling capacity. Permanently lubricated, overload protected fan motor is totally enclosed for maximum protection from rain, dust and corrosion. A rain shield on the motor provides additional protection from moisture. Motor is resiliently mounted. Corrosion resistant PVC coated steel wire fan guards are furnished.

Powerful Dual Supply Air Blowers — Twin belt drive centrifugal blowers deliver large air volume efficiently and with minimum power consumption. Blower assembly is mounted to rugged angle iron frame with the entire blower and frame assembly vibration isolated on rubber mounts. Ball bearings are permanently sealed and lubricated. Blower wheel is statically and dynamically balanced. Design of motor mounting base permits quick and simple motor changeover, belt tension adjustment or belt changing. A choice of motor outputs and drives is available. Adjustable motor pulley allows for variable speed adjustments. Motor is overload protected.

Air Filters — One inch thick frame type throwaway filters are furnished as standard. Fiberglass media is oil impregnated for increased efficiency. Filters are readily accessible for quick and simple replacement. Filter rack is designed to accept two inch thick filters.

Fan and Limit Controls — Factory installed and accurately located. Fan time delays allows blower operation approximately three minutes after burner shut-off. Dual limit controls (primary and secondary) have fixed temperature setting and protect heating system from abnormal operating conditions.

FEATURES

Optional Timed-Off Control — Timed-off control is available for field installation. Prevents compressor short-cycling. Automatic reset control will shut the compressor off and hold it off for 5 minutes. Kit (40G20) includes two controls and must be ordered extra.

Optional Low Ambient Control Kit — System will operate satisfactorily down to $50\,^{\circ}\text{F}$ outdoor air temperature without additional controls. If air conditioning operation is required at low ambients a field installed Low Ambient Kit (LB-57113BB) can be added enabling the unit to operate down to $0\,^{\circ}\text{F}$.

Optional REMD11M-275 Economizer Dampers — Available factory or field installed. Lennox economizer system consists of: mechanically linked outdoor air and recirculated air dampers. Damper blades are gasketed for tight seal and quiet operation. Formed damper blades rotate smoothly in nylon bearings. The positioning of these dampers is accomplished by a 24 volt fully modulating spring return damper motor with adjustable minimum position switch and controlled by the room thermostat, electronic discharge air sensor and solid-state adjustable outdoor air enthalpy control. An outdoor air hood with rain eliminator vanes is furnished and field installs over the outdoor air dampers external to the unit. For field installation the two damper sections slide in cavities provided in the unit cabinet. Economizer is shipped factory wired and only requires plug-in field connection. The enthalpy control allows for 0 to 100% outdoor air (first stage of cooling) to be used for "free cooling" when outdoor humidity and temperature are acceptable. Additionally, an integrated economizer cycle can be accomplished by allowing the outside air dampers to remain open, continuing to admit outside air, and cycling the compressors to provide dehumidification and additional cooling as needed. The integrated economizer cycle uses only the amount of mechanical cooling necessary.

Optional Differential Enthalpy Control — A solid-state return air enthalpy sensor is available to be used in conjunction with the outdoor air enthalpy control to determine which air has the lowest enthalpy. The air with the lowest enthalpy will be selected. Return air enthalpy sensor (54G44) field installs in the economizer damper section and must be ordered extra.

Optional GED11-275 Gravity Exhaust Air Dampers — Dampers field install in space provided in the unit, Pressure operated extruded aluminum dampers rotate smoothly in nylon bearings. Damper blades are equipped with gaskets for tight seal and quiet operation.

Optional PED11-275 Power Exhaust Dampers — Field installs in space provided in the unit cabinet. Fans provide system pressure relief and are interlocked to run when return air dampers are closed and supply air blowers are operating. Motors are overload protected. Pressure operated extruded aluminum dampers ride in nylon bearings and are equipped with seal gaskets resulting in tight seal and quiet operation. Dampers prevent blow-back and outdoor air infiltration during off cycle.

Optional OAD11-275 Minimum Fresh Air Dampers — Damper section complete with cleanable polyurethane air filter field installs external to the unit cabinet. Available for manual or automatic operation. Damper assembly allows a fixed amount of outdoor air into the system and can be adjusted for air quantities up to 25%. Automatic damper operation is available with the addition of a spring return 3 position damper actuator. Actuator only requires plug-in connection for operation. Order Automatic Fresh Air Damper Kit 88G13.

Optional RMF11-275 Standard Roof Mounting Frame — Sturdy mounting frame mates to the single package unit and provides an automatic weather sealed rooftop installation. Shipped knocked down for ease of shipping and handling it is easily field assembled. A nailer strip is secured to the frame sides to facilitate flashing. Approved by National Roofing Contractors Association.

Optional RMFH11-275 Horizontal Roof Mounting Frame — Frame mates to GCS11 unit and provides horizontal end supply and air return (over/under) duct connection. Supply air connection is in end of frame. Return air connection is made at evaporator section end of unit. Shipped knocked down for ease of shipping and handling; it is easily field assembled. See dimension drawing.

Optional RMFA11-275 Adapter Roof Mounting Frame — Retrofit adapter frame is available for GCS11 model replacement of existing GCS3 unit installation. The frame adapts to the existing RMF3 frame and provides a weather sealed connection with minimum installation cost. Frame is shipped knocked down for ease of shipping and handling, it is easily field assembled. A nailer strip is secured to the frame sides to facilitate flashing. See dimension drawing and installation detail sketch.

Optional RTD11-275 Combination Ceiling Supply and Return Diffuser Assembly — Step down mount diffuser extends slightly below ceiling level and discharges conditioned air out through grilles on all four sides. Aluminum grilles are fitted with double deflection louvers for precise directional control of air flow. Return air enters through the large center grille. Assembly also includes insulated diffuser box with flanges for ease of duct connection, hanging rings for suspending and interior transition to insure low static and even air flow on all four sides. Transition is sealed internally to prevent recirculation. Diffuser assembly is completely factory assembled. Diffuser readily adapts to T-bar ceiling grids and plaster ceilings.

Optional FD11-275 Combination Ceiling Supply and Return Diffuser Assembly — Flush mount diffuser installs almost flush with the ceiling level and discharges conditioned air out through fixed blade louvers on all four sides. Fixed blade louvers insure that air flow will be evenly distributed. Return air enters through large center grille. Assembly also includes insulated diffuser box with flanges for ease of duct connections, support hanger eyelets at the top corners for secure installation and interior transition to insure low static and even air flow on all four sides. Transition is sealed internally to prevent recirculation. Diffuser assembly is completely factory assembled. Diffuser readily adapts to T-bar ceiling grids and plaster ceilings.

Optional SRT11-275 Supply and Return Transitions — Transitions field install in the RMF11-275 roof mounting frame and provide segregated and simple duct connections to supply and return diffuser. Completely insulated galvanized steel transitions have flanges for ease of duct connection. Duct from the transitions to the diffuser is not furnished and must be provided by installer. Transitions are completely factory assembled and easily field installed in the roof mounting frame with minimum costs and labor requirements.

Optional SP11 Remote Status Panel — The operation of the unit can be checked at a glance on the Remote Status Panel (12F83) conveniently located within the conditioned area. Signal lights on the panel indicate "Cool Mode", "Heat Mode", "Compressor 1", "Compressor 2", "No Heat" and "Filter". The Cool Mode signal light is green when lit and indicates economizer damper operation or DX cooling operation for units without the economizer. Heat Mode light is green and reflects heating operation. Compressor 1 and Compressor 2 lights are green when operating and will turn red if there is an operational malfunction. The No Heat and Filter lights will show red and indicate a requirement for service. The following field installed controls are required for use with the status panel and must be ordered extra. Filter Switch Kit (97C85) is required for operation of the filter light. Status Panel Readout Relay Kit (88G27) is required to interface status panel with unit operation.

Optional SSP11 Remote Switching Status Panel — The operation of the unit can be controlled and observed on the Switching Status Panel (12F84) conveniently located within the conditioned area, Signal lights on the panel indicate "Cool Mode", "Heat Mode", "Compressor 1", "Compressor 2", "No Heat" and "Filter". The Cool Mode signal light is green when lit and indicates economizer damper operation or DX cooling operation for units without the economizer. Heat Mode light is green and reflects heating operation. Compressor 1 and Compressor 2 lights are green when operating and will turn red if there is an operational malfunction. The No Heat and Filter lights will show red and indicate a requirement for service. Additionally, panel is equipped with a system selector switch (Off — Heat - Auto - Cool - Emergency Heat) (Heat Pump Only), fan switch (Auto On) and after hours timer. Fan switch provides a choice of intermittent (Auto) or continuous (On) blower operation. Manually operated after hours timer (0 to 12 hours) overrides night setback controls providing normal operation for time period set. A momentary push button switch is used to initiate the timer period. The following field installed controls are required for use with the status panel and must be ordered extra. Filter Switch Kit (97C85) is required for operation of the filter light. Status Panel Readout Relay Kit (88G27) is required to interface status panel with unit operation.

CONTROL SYSTEM OPTIONS

Optional Electro-Mechanical Thermostat and Controls System -

The thermostat and related controls of this system must be ordered extra for field installation. Two stage heat and two stage cool thermostat (13F06) with dual temperature selector levers. Uses subbase (13F17) with manual system switch (Off-Heat-Auto-Cool) and fan switch (Auto-On) or nonswitching subbase (13F16), SP11 Remote Status Panel (12F83) or SSP11 Remote Switching Status Panel (12F84) is available for observing and controlling unit operation from the conditioned area. A SSP11 Relay Kit (41G39) is required for switching functions of the Switching Status Panel, Kit must be ordered extra and field installed. For nite operation the following are available. Single stage heating thermostat (13F12) and non-switching subbase (13F16). For applications without the economizer a Nite Kit (39G74), containing a plug-in relay, is required to override the operation of day thermostat. Two time clocks are available for the system. Automatic 7 day time clock (43G98) programs a weekly schedule. Any day or days can be omitted. Each day of the week is clearly separated from every other day. Day and nite periods are distinctly marked. When the settings have been made the clock will turn the system on and off. Spaced in 2 hour increments and equipped with battery back-up in case of power outage. 24 hour nite setback time clock (43G99) automatically programs the system to keep conditioned area at a more conservative temperature level (nite setback thermostat setting) during a period of vacancy. Spaced in 15 minute increments and equipped with battery back-up in case of power outage. Also available is a Warm Up Kit (39G77) which holds the economizer outdoor air dampers closed during nite heat operation and morning warm up. See Flow Chart on page 50.

Optional PRO-STAT Thermostat and Controls System — The thermostat and related controls of this system must be ordered extra and field installed. Pro-stat Thermostat (36G67) has touch sensitive keyboard, automatic switching from heat to cool, no anticipator, zero droop, indicator lights, hour/day programming, override capabilities, time readout, stage status indicators, operational mode symbols and battery back-up. A Remote Temperature Sensor (36G68) can be adapted to thermostat for applications where it is desirable to locate the thermostat out of the conditioned area. SP11 Remote Status Panel (12F83) is available for checking unit operation from within the conditioned area. Also available is a Warm Up Kit (39G77) which holds the economizer outside air dampers closed during nite heat operation and morning warm up. See Flow Chart on page 50.


Optional W973 Control System — Control system must be ordered extra for field installation. Logic Panel (39G76) controls the operation of the economizer dampers and the stages of cooling and heating in response to a signal from the thermostat. To maintain stable temperatures the logic panel balances the conditioned space thermostat demand against the system output. System output is measured by a discharge sensor (furnished with the logic panel) located in the discharge air duct of the unit. The combined demand and output signals from the sensor determines economizer damper position and number of cooling or heating stages energized. The logic panel field installs in the unit or in a remote panel located within the conditioned space. W973 Plug-In Relay (furnished with the logic panel) is required to adapt the control system to the unit. Two thermostats are available for the system. Dual set point room thermostat (25C52) or transmitter (25C51) with a choice of remote sensors. Both have separate heating-cooling locking set points concealed under the cover and do not have indicating thermometer. The room thermostat has integral sensor and installs in the conditioned space. The transmitter installs outside the conditioned space with a Room Temperature Sensor (58C92) in the conditioned area or a Return Air Temperature Sensor (27C40) in the return air duct of the unit. Thermostat and transmitter are furnished with a wiring wallplate. Also available is a switching subbase (58C93) with system selector switch (Heat-AutoCool-Off) and fan switch (Auto-On). SP11 Remote Status Panel (12F83) or SSP11 Remote Switching Status Panel (12F84) is available for observing and controlling unit operation from the conditioned area. Two time clocks are available for the system. Automatic 7 day time clock (43G98) programs a weekly schedule. Any day or days can be omitted. Each day of the week is clearly separated from every other day. Day and nite periods are distinctly marked. When the settings have been made the clock will turn the system on and off. Spaced in 2 hour increments and equipped with battery back-up in case of power outage. 24 hour nite setback time clock (43G99) automatically programs the system to keep the conditioned area at a more conservative temperature level (nite set back thermostat setting) during a period of vacancy. Spaced in 15 minute increments and equipped with battery back-up in case of power outage. Also available is a Warm Up Kit (39G77) which holds the economizer outdoor air dampers closed during nite heat operation and warm up. See Flow Chart on page 49.

Optional W7400 Control System — Control system must be ordered extra for field installation. Control Module (74G11) controls the operation of the economizer dampers and the stages of heating and cooling. Controlling input signals are setpoint, space temperature sensor and time-ofday scheduling from the thermostat. The control module balances the space temperature signal against the number of stages operating for system output. System output is measured and updated by monitoring the actual space temperature deviation from set point, and the rate of change of the space temperature. The control module field installs in the unit or in a remote panel located within the conditioned area. Two thermostats are available for the system. A room thermostat (36G62) with integral sensor that installs in the conditioned space or a remote thermostat (36G64) that installs outside the conditioned space with a Room Temperature Sensor (58C92) in the conditioned area or a Return Air Temperature Sensor (27C40) in the return air duct of the unit. Both thermostats are equipped with touch sensitive keyboard, automatic switching from heat to cool, no anticipator, zero droop, indicator lights, hour/day programming, override capabilities, time readout, stage status indicators, battery back-up and wiring wallplate. W7400 Plug-In Relay (furnished with the control module) provides separate set points for the economizer dampers and DX cooling. SP11 Remote Status Panel (12F83) is available for checking unit operation within the conditioned area. See Flow Chart on page 49.


Optional T7300 Thermostat and Control System - The thermostat and related controls of this system must be ordered extra for field installation. T7300 programmable thermostat (81G59) has internal or optional remote temperature sensing, touch sensitive keyboard, automatic switching from heat to cool, oF or oC temperature readout, no anticipator, droop/ no droop selection, indicator LED's, hour/day programming, override capabilities, time readout, stage status indicators, operational mode readout and battery back-up. T7300 thermostat has a choice of subbases. Switching subbase (81G60) features selectable output staging up to two heat and two cool, indicator LED's, manual system switch (Heat-Off-Auto-Cool) and fan switch (Auto-On). Switching subbase (13H76) features selectable output staging up to three heat and two cool, indicator LED's, manual system switch (Auto-Cool-Off-Heat-Emergency Heat) (Heat Pump Only) and fan switch (Auto-On). Both subbases also features an auxiliary relay output which controls economizer operation during occupied and unoccupied periods. Also available is a Room Temperature Sensor (58C92) or Room Temperature Sensor with 3-hour override and setpoint adjustment (86G67) for installation in the conditioned area and a Return Air Temperature Sensor (27C40) for installation in the return air duct of the unit, SP11 Status Panel (12F83) is available for checking unit operation from within the conditioned area. See Flow Chart on page 50.

TEMPERATURE CONTROL SELECTION FLOW CHART


OPTIONAL W973 CONTROL SYSTEM

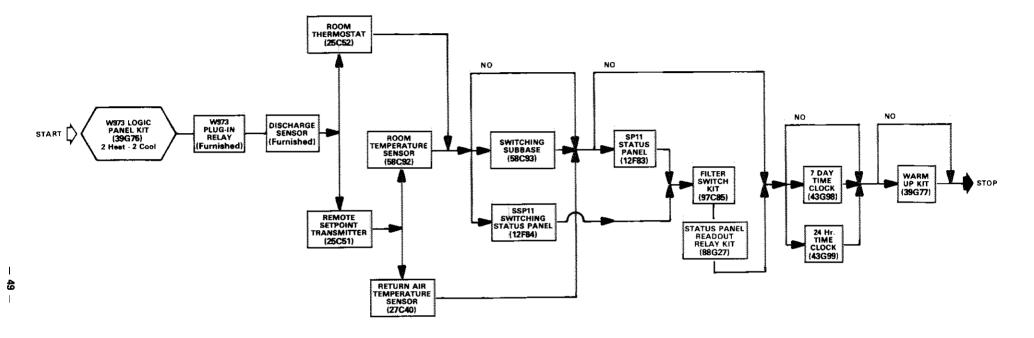


OPTIONAL W7400 CONTROL SYSTEM

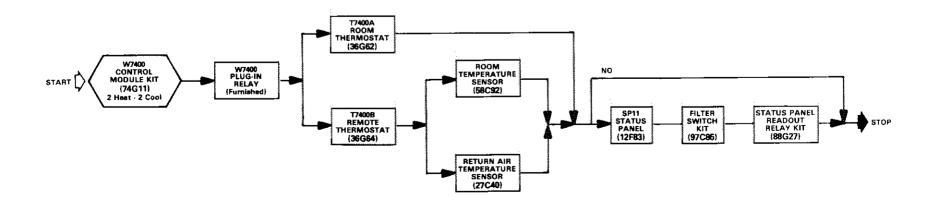


TEMPERATURE CONTROL SELECTION FLOW CHART OPTIONAL ELECTRO-MECHANICAL THERMOSTAT CONTROL SYSTEM

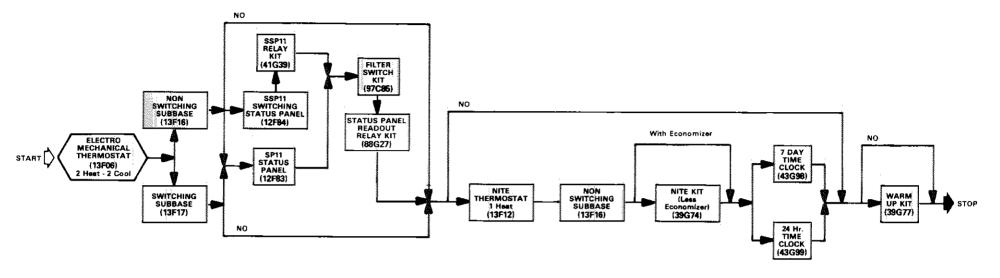

OPTIONAL PRO-STAT THERMOSTAT CONTROL SYSTEM



OPTIONAL T7300 THERMOSTAT CONTROL SYSTEM

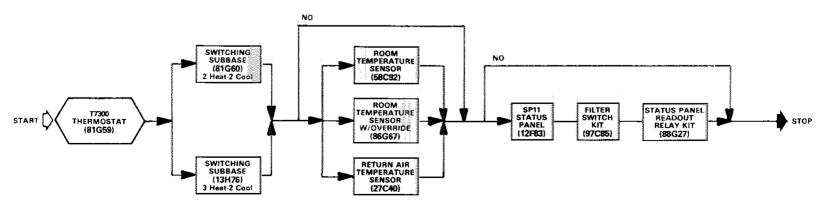

SPECIFICATIONS

**************************************		M	odel No.	GCS11-2753-350	GCS11-2753-450	GCS11-3003-450
Single S	tage	Btuh	Input	350,000		
Heating Ca	apacity	Btuh	Output	290,500		
Natural Ga	s Only	A.G.	A. Thermal Efficiency	83.0%		
\$60X		Btuh	Input (low)		290,000	290,000
Two Sta	age	Btuh	Output (low)		237,800	237,800
Heating Ca		Btuh	Input (high)		450,000	450,000
Natural &	**LPG	Btuh	Output (high)		369,000	369,000
		A.G.	A. Thermal Efficiency		82 .0%	82.0%
A D I		Total	cooling capacity (Btuh)	*240	,000	★280,000
ARI		Total	unit watts	28,	800	34,200
Standard		EER (Btuh/Watts)	8.	30	8.20
Rating	gs	Integ	rated Part Load Value	8.	30	
D 4: /0/	O	Sta	age 1	19 lbs	. 0 oz.	19 lbs. 0 oz.
Refrigerant (2	2) charge	Sta	age 2	20 lbs	. 8 oz.	20 lbs. 8 oz.
	Blower w	heel no	ominal diameter x width (in.)	(2) 15	x 15	(2) 15 x 15
<u> </u>			Nominal motor horsepower		3	7-1/2
Evaporator	Facto	•	Maximum usable horsepower	3.	45	8.625
Blower	Instal		Voltage & Phase	208/230/	460∨-3ph	208/230/460v-3ph
and	†Drive	es	RPM range		- 760	940 — 1090
Drive	Optio	nal	Nominal motor horsepower		5	
Selection	Facto		Maximum usable horsepower		75	
Colociion	Instal	•	Voltage & Phase	~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~	460v-3ph	~~~-
	†Drive		RPM range		- 965	
	L		ace area (sq. ft.)		3.5	23.5
Evapora	ator	******	dia. (in.) & No. of rows		– 3	1/2 - 4
Coil	I	******	per inch		5	15
			ace area (sq. ft.)		3.9	38.9
Conder	nser	***************************************	dia. (in.) & No. of rows		_ 4	3/8 — 4
Coil	1		per inch		8	18
			eter (in.) & No. of blades		6 – 5	(2) 26 - 5
Conder	0001	Salasid-deservoires	olume (cfm)		7000	(2) 7000
Fans			r horsepower	~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~) 1	(2) 1
Fans	S		r watts		1100	(2) 1100
C C				3/4	1	1
Gas Su		Natur **LP	****	3/4	1	1
Connection	***************************************	*****			7	7
Recommer			tural _PG		/ 	11
Supply Pressi	ANADAMAN AND TO BE A STATE OF THE STATE OF T				& (2) 3/8	(2) 1-1/4 & (2) 3/8
Condensate d	***************************************)		x 20 x 1	(11) 16 x 20 x 1
No. & size of	****	directorismos services or			X 20 X 1	3100
Net weight of	**************	with the second second second	(************************************	. C	~~~~	3100
Optiona			andard		RMF11-275 (315 lbs.)	
Mounting	•	**********	rizontal		RMFH11-275 (440 lbs.)	***************************************
(Net w		*******	apter		RMFA11-275 (510 lbs.)	
			ls – (Net Weight)	annan mili na manan man sangan pangan menjada kanjan kanjan kanjan kanda dan kanjan kanjan kanjan manan menjan	REMD11M-275 (290 lbs.)	**************************************
Optional Grav	famen management and the fame of the fame	*************	pers — (Net Weight)		GED11-275 (30 lbs.)	
Optional	Model No	o. — (N	let weight))	PED11-275 (150 lbs.)	<u></u>
Power	•		Diameter (in.) & No. of blades		(3) 18 — 5	
Exhaust	Exha		Total air volume (cfm)		7050	
Dampers	Fan	S	Motor horsepower		(3) 1/4	
		****	Watts input (total)		1100	
elektrigeti elektronteti elektrigeti interesteti elektrigeti.		,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	iffuser — (Net weight)		RTD11-275 (403 lbs.)	»»,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
Optional Ceilir	ng Flush [Diffuser	— (Net weight)		FD11-275 (363 lbs.)	
Optional Ceilir	ng Diffuse	r Trans	sitions — (Net weight)		SRT11-275 (80 lbs.)	
Optional Fresl	h Air Dam	per &	Filter Size (in.) — (Net Weight)	U OAD1	1-275 (115 lbs.) — (1) 26 ɔ	c 31 x 1
		D11 D:	amper Kit — (Net weight)		88G13 (15 lbs.)	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
Optional Auto	omatic OA	D11 D0	2111por 1110 (1101 1101g1.1.)			
Optional Auto	00000000+360000000000000000	elekud elekularikarian anyalisyila ayily	00+xx11b2+66+6+32+6+1456+3+6+4+1+1+1+1+1+1+1+1+1+1+1+1+1+1+1+1+1+1		LB-48737CB	·/>

^{*}Rated at ARI Standard 360; 95°F outdoor air temperature and 80°F db/67°F wb entering evaporator air; minimum external duct static pressure.

**For LPG models a field conversion kit is required and must be ordered extra.

**Using total air volume and system static pressure requirements determine from blower performance tables rpm and bhp required. Maximum usable hp of motors furnished by Lennox are shown. If motors of comparable hp are used be sure to keep within the service factor limitations outlined on the motor nameplate.

**Rated at ARI Standard 360 test conditions.

HIGH ALTITUDE DERATE (All Models)

If the heating value of the gas does not exceed values listed in the table, derating of the unit is not required. Should the heating value of the gas exceed the table values, or if the elevation is greater than 6,000 feet above sea level it will be necessary to derate the unit. Lennox requires that derate conditions be 4% per thousand feet above sea level. Thus at an altitude of 4000 feet, if the heating value of the gas exceeds 1000 Btu/ft³, unit will require a 16% derate.

Elevation Sea Level (Feet)	Maximum Heating Value (Btu/ft³)
5001 — 6000	900
4001 — 5000	950
3001 — 4000	1000
2001 — 3000	1050
Sea Level — 2000	1100

ELECTRICAL DATA


M	odel No.			GCS1	1-2753				GCS11-3003	
Line voltage data — 60 H:	z — 3 phase	20	0V	23	0V	46	0V	200V	230∨	4 60∨
	Rated load amps (total)	36.0	/36.0	36.0	/36.0	17.8	/17.8	50.2/50.2	50.2/50.2	25.1/25.1
Compressors (2)	Trated load arrips (total)	(72	2.0)	(72	2.0)	(35	5.6)	(100.4)	(100.4)	(50.2)
Compressors (2)	Locked rotor amps (total)	229	/229	229	/229	116.	/116	220/220	220/220	110/110
	Locked Total unips (total)	(45	8.0)	(45	8.0)	(23:	2.0)	(440)	(440)	(220)
Condenser	Full load amps (total)	12	2.8	10).4	5	.6	12.8	10.4	5.6
Fan Motors (2)	Locked rotor amps (total)	30	0.0	28	3.0	13	3.2	30.0	28.0	13.2
Evaporator	Horsepower	3	5	3	5	3	5	7-1/2	7-1/2	7-1/2
Blower Motor	Full load amps (total)	11.4	16.2	10.0	14.6	5.0	7.3	25.3	22.0	11.0
	Locked rotor amps (total)	65	100	56	90	28	45	160	127	64
Optional	(No.) Horsepower	(3) –	- 1/4	(3) –	- 1/4	(3) –	- 1/4	(3) — 1/4	(3) — 1/4	(3) — 1/4
Exhaust Fans	Full load amps (total)	4	.2	4	.2	2	.1	4.2	4.2	2.1
Motors	Locked rotor amps (total)	9.	75	9.	75	4.	.9	9.75	9.75	4.9
Recommended Maximum	Less Exhaust Fans	125	125	125	125	60	70	200	175	90
Fuse Size (Amps)	With Exhaust Fan	125	150	125	125	70	70	200	175	100
Unit	Less Exhaust Fans	.88	.88	.88	.88	.88	.88	.84	.84	.84
Power Factor	With Exhaust Fans	.89	.89	.89	.89	.89	.89	.85	.85	.85
*Minimum	Less Exhaust Fans	106.0	110.0	102,0	106.0	51.0	53.0	152.0	146.0	74.0
Circuit Ampacity	With Exhaust Fans	110.0	115.0	106.0	111.0	53.0	56.0	156.0	150.0	76.0

^{*}Refer to National Electric Code manual to determine wire, fuse and disconnect size requirements.

NOTE - Extremes of operating range are plus and minus 10% of line voltage.

FIELD WIRING

ELECTRO-MECHANICAL THERMOSTAT CONTROL SYSTEM

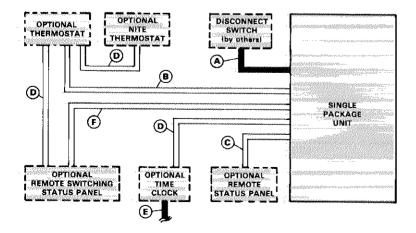


- A Three wire power (See Electrical Data Table)
- B Six wire low voltage
- Five wire low voltage with SSP11 Switching Status Panel
- C Nine wire low voltage
- D Two wire low voltage
- E Two wire low voltage
- F Fifteen wire low voltage

- Field wiring not furnished -

NOTE - All wiring must conform to NEC and local electrical codes.


FIELD WIRING

W973 CONTROL SYSTEM

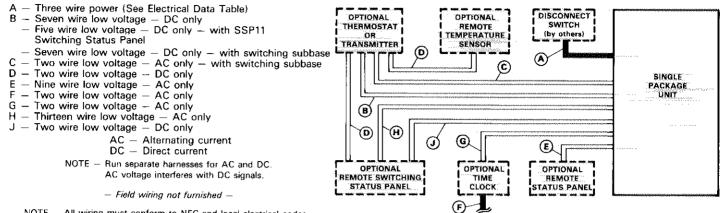

NOTE - All wiring must conform to NEC and local electrical codes.

W7400 CONTROL SYSTEM

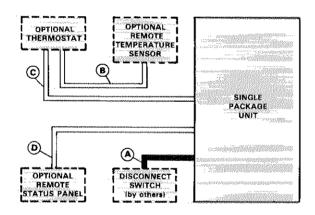

- A Three wire power (See Electrical Data Table)
- B Two wire low voltage
- C Four wire low voltage
- D Nine wire low voltage


- Field wiring not furnished -

NOTE All wiring must conform to NEC and local electrical codes.

PRO-STAT OR T7300 THERMOSTAT CONTROL SYSTEM

- A Three wire power (See Electrical Data Table)
- B Seven wire low voltage (Pro-Stat)
 - Nine wire low voltage (T7300)
- C Two wire low voltage
- D Nine wire low voltage
 - Field wiring not furnished -

NOTE - All wiring must conform to NEC and local electrical codes.

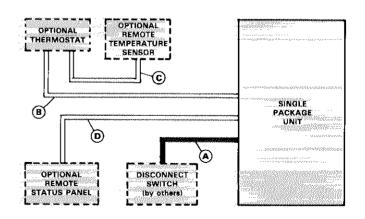

COOLING RATINGS

NOTE – To determine sensible capacity, leaving wet bulb and dry bulb temperatures not shown in the tables, see Miscellaneous Engineering Data section, Page 9.

GCS11-2753 COOLING CAPACITY (With One Compressor Only Operating)

p	<u> </u>		***************************************	***********	*****************************	*******	Outd	oor Air	Temj	perat	ure E	ntering (Condens	ser Co	oil (°I	-)	****		***************************************	*********	***************************************
F4	ار حمیرا		65	,				75	5				85	5				95	,		
Enter. Wet Bulb (°F)	Total Air Vol. (cfm)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat	ensib o Tot tio (S Bulb 80	al /T)	Cool	Comp. Motor Watts Input	To Rat	ensib Tot tio (S Bulb 80	al /T)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To	nsib Tot io (S Bulb 80	al /T)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat	ensible Totatio (S Bulb 80	al /T)
	7000	130,700	9060	.72	.82	.92	125,800	9890	.73	.84	.94	120,400	10,680	75	.85	96	115,100	11,400	.76	.87	.98
63	8500	135,300	9240	.76	.87	.98	130,100	10,070	.77	.89	1.00	124,500	10,860	.78	.91	1.00	118,700	11,590	.80	.93	1.00
	10,000	139,400	9390	.79	.92	1.00	133,900	10,220	.81	.94	1.00	128,100	11,020	.83	.96	1.00	122,200	11,750	.85	.99	1.00
	7000	141,500	9460	.57	.67	.76	136,000	10,300	.58	.68	.78	130,000	11,100	.59	69	.79	123,900	11,830	.60	.70	.81
67	8500	146,000	9620	.59	.70	.80	139,900	10,470	.60	.71	.82	133,600	11,260	.61	.73	.84	127,100	11,980	.62	.74	.86
	10,000	149,600	9750	.62	.73	.85	143,200	10,600	.62	.75	.87	136,500	11,390	.64	.77	.89	129,700	12,100	.65	.79	.92
	7000	152,500	9860	.44	.53	.62	146,300	10,720	.45	.54	.63	139,700	11,520	.45	.54	.64	133,000	12,250	.45	.55	.65
71	8500	156,900	10,010	.45	.55	.65	150,200	10,870	.45	.56	.66	143,300	11,670	46	.57	.67	136,200	12,390	.46	.58	.69
	10,000	160,400	10,140	.46	.57	.68	153,500	10,990	.46	.58	.69	146,200	11,790	.47	.59	.71	138,800	12,510	.48	.60	.73

GCS11-2753 TOTAL COOLING CAPACITY (With Both Compressors Operating)

***************************************	······			*******	wiedkiedzia	-	Outd	oor Air	Tem	perat	ure E	ntering (Condens	er Co	oil (°F	=)	HANDON STERNANDORS TO		************		-
			85	i	,,(,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,		95					10					11!	5		
Enter. Wet Bulb (°F)	Total Air Vol. (cfm)	Cool	Comp. Motor Watts Input	To Rat	ensib Tot tio (S Bulb 80	al /T)	Cool	Comp. Motor Watts Input	To Rat	ensib o Tot tio (S Bulb 80	al /T)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Ret	nsib Tot io (S Bulb 80	al /T)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat	ensible Totatio (S Bulb	al /T)
***************************************	7000	241.000	21,360	.75	.85	Assessment of the Control of the Con	230,000	22 820	.76	.87	***********	218,400	24 150	78	.90	************	206.500	25.290	.80	.92	1.00
63		249.000	21,720	79	.91	described delications	237,300		.80	.93	-	225.300	***************************************	.82	.96	*********	interestation of the section of the	25,650	.85	*NAMES AND ADDRESS OF THE PERSON NAMES AND ADDRESS OF THE PERS	1.00
•		whiteinteleda partenensias	22.040	.83	.96	****************	244,400		.85	.99	***************************************	231,200	************	.87	1.00		219.800	26,030	.90	1.00	
	7000		22,210	.59	.69	HOUSENSMAN.	247,500	DOS COMPANION DE PROPERTIES DE	.60	.70	.81	234,400	24,990	.61	.72	.83	221,100	26,090	.62	.74	.86
67	8500	267,200	22,520	.61	.73	.84	253,900	23,980	.62	.74	.86	240,100	25,280	.64	.76	89	226,000	26,360	.65	.79	.92
	10,000	273,100	22,770	.64	.77	.89	259,200	24,230	.65	.79	.92	244,700	25,520	.67	.81	.95	230,300	26,580	.69	.84	.98
	7000	279,500	23,050	.45	.54	.64	265,800	24,530	.45	.55	.65	251,500	25,840	.46	.56		236,900	26,920	.46	.57	.69
71	8500	286,600	23,340	.46	.57	.67	272,100	24,810	.46	.58	.69	257,100	26,100	.47	.59	MODIFICATION OF	241,700	27,170	.48	.60	.73
	10,000	292,500	23,580	.47	.59	.71	277,300	25,030	.48	.60	.73	261,600	26,310	.48	.62	.75	245,700	27,360	.49	.64	.78

GCS11-3003 COOLING CAPACITY (With One Compressor Only Operating)

	1		******************	***************************************	******************	**********	Outd	oor Air	Temp	erati	ure E	ntering (Condens	er Co	oil (ંગ	F)	***************************************	**************		*********	***************************************
Enter	Total		65	5				75	,	***********			85	<u> </u>				95)	E-PARTNESS CONTROL OF THE PARTNESS CONTROL OF THE PART	~~~~
Enter. Wet Bulb (°F)	Total Air Vol. (cfm)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat Dry	nsib Totio (S Bulb	ві /T) (°F)	1	Comp. Motor Watts Input	Rat Dry	nsib Tot io (S Bulb	al /T) (°F)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat Dry		al /T) (°F)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat Dry	nsib Tota io (S Bulb	al /T) (°F)
********	****************	**************	***************	76	80	84	2.000.000.000		76	80	84			76	80	84		***************************************	76	80	84
	7000	153,400	11,000	.70	.79	.87	146,700	11,830	.71	.80	.89	139,600	12,610	.72	.82	.91	132,400	13,340	.73	.84	.94
63	8500	158,700	11,210	.73	.83	.93	151,600	12,060	.74	.85	.95	144,200	12,870	.76	.87	.97	136,600	13,620	.77	.89	1.00
	10,000	163,100	11,380	.76	.88	.98	155,700	12,250	.78	.90	1.00	148,100	13,090	.80	.92	1.00	140,300	13,860	.82	.95	1.00
	7000	164,000	11,410	.56	.65	.73	156,800	12,300	.57	.65	.74	149,200	13,150	.57	.67	.76	141,400	13,940	.58	.68	.78
67	8500	169,100	11,600	.58	.68	.77	161,500	12,250	.59	.69	.79	153,400	13,390	.60	.70	.81	145,200	14,190	.61	.72	.83
	10,000	173,200	11,780	.60	.71	.82	165,100	12,700	.61	.72	.84	156,700	13,580	.62	.74	.86	148,200	14,390	.63	.76	.89
	7000	174,900	11,840	.44	.52	.60	167,000	12,790	.44	.52	.61	159,000	13,710	.44	.53	.62	150,800	14,560	.45	.54	.63
71	8500	179,800	12,040	.45	.54	.63	171,700	13,010	.45	.54	.64	163,100	13,940	.45	.55	.65	154,400	14,810	.46	.56	.67
	10,000	183,800	12,200	.45	.56	.66	175,200	13,180	.46	.57	.67	166,400	14,120	.46	.58	.69	157,400	15,000	.47	.59	.71

GCS11-3003 TOTAL COOLING CAPACITY (With Both Compressors Operating)

	T T			~~~~~~~	************	***************************************	Outd	oor Air	Temr	OFOTI	ızə E	ntering (^ondene	ar C	SIL (O	E)	udosenno marinario en escrito mari	CANTHOLISM MATERIAL STATE	*****************	***************************************	***************************************
! _	ا. ا	************	85)	***************************************			96 96		, o i a r i	<u> </u>	i vieriii y	10				***************************************	11!	5		
Enter. Wet Bulb (°F)	Total Air Vol. (cfm)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat	ensib o Tot tio (S Bulb 80	al /T)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat	ensib Tot io (S Bulb 80	al /T)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To	onsib Totio io (S Bulb 80	al /T)	Total Cool Cap. (Btuh)	Comp. Motor Watts Input	To Rat	ensib Tota tio (S Bulb 80	al /T)
1	7000	279,200	25,220	.72	.82	.91	264,600	26,690	.73	.84		249,500		.75	.86	MANAGE AND ASSESSED.	234,100	29,170	.77	.89	1.00
63	8500	288,400	25,740	.76	.87	.97	273,000	27,260	.77	.89	1.00	257,300	28,640	.79	.92		241,400	29,830	.82	.95	1.00
	10,000	296,100	26,180	.80	.92	1.00	280,300	27,750	.82	.95	1.00	264,600	29,170	.84	.98	1.00	247,600	30,400	.87	1.00	1.00
,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	7000	298,300	26,300	.57	.67	.76	282,700	27,890	.58	.68	.78	266,400	29,340	.59	.69	.80	249,600	30,580	.60	.71	.82
67	8500	307,000	26,780	.60	.70	.81	290,200	28,410	.61	.72	.83	273,100	29,880	.62	.74	.86	255,700	31,130	.64	.76	.89
	10,000	313,400	27,150	.62	.74	.86	296,200	28,800	.63	.76	.89	278,500	30,300	.65	.79	.92	260,800	31,570	.67	.81	.95
CONTRACTOR	7000	318,100	27,410	.44	.53	.62	301,200	29,140	.45	.54	.63	284,100	30,720	.45	.55	.65	266,200	32,090	.45	.56	.66
71	8500	326,400	27,880	.45	.55	.65	308,800	29,640	.46	.56	.67	290,600	31,240	.46	.57	THE OWNER OF THE OWNER OF	272,300	32,610	.47	.59	.71
<u> </u>	10,000	332,800	28,240	.46	.58	.69	314,600	30,020	.47	.59	.71	295,700	31,630	.48	.60	.73	276,800	33,010	.48	.62	.76

BLOWER DATA

GCS11-2753 BLOWER PERFORMANCE

Air		***************************************	*************		***************************************	······································	STAT	C PR	ESSU	RE E	(TERI	VAL 1	OUN	IIT —	(Inch	es W	ater G	auge)	***************************************	-	**************	***************************************	***************
Volume	.2	20	.3	30	.4	Ю		Ю.	.6	30	.7	0'	.8	30	.9	Ю	1.	00	1.	10	1.	30	1.	50
(cfm)	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	ВНР	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	ВНР
7000	600	1.80	640	2.10	670	2.40	700	2.60	730	2.80	760	3.00	790	3.20	820	3.40	845	3.60	870	3.90	930	4.30	985	4.65
7200	610	1.95	645	2.30	680	2.55	710	2.75	740	2.95	770	3.15	800	3.35	830	3.55	855	3.80	880	4.10	940	4.50	995	4.90
7400	620	2.10	660	2.45	690	2.70	720	2.95	750	3.10	780	3.30	810	3.50	840	3.75	860	4.00	890	4.30	950	4.70	1005	5.10
7600	620	2.30	670	2.65	700	2.90	730	3.10	760	3.30	790	3.50	820	3.70	850	3.95	870	4.15	900	4.50	960	5.00	1020	5.30
7800	635	2.40	680	2.85	710	3.05	740	3.25	770	3.45	800	3.65	830	3.85	860	4.15	880	4.40	910	4.70	9 70	5.15	1030	5.50
8000	650	2.65	690	3.00	720	3.20	750	3.40	780	3.60	810	3.80	840	4.00	870	4.35	880	4.55	920	4.90	980	5.35	1040	5.75
8200	665	2.85	700	3.15	730	3.35	760	3.55	790	3.75	820	3.95	850	4.20	880	4.60	900	4.75	930	5.10	990	5.55		
8400	675	3.00	710	3.30	740	3.50	770	3.70	800	3.90	830	4.10	860	4.40	890	4.80	910	5.00	940	5.35	1000	5.75		
8600	690	3.25	720	3.45	750	3.65	780	3.85	810	4.05	840	4.25	870	4.55	900	4.95	920	5.20	950	5.55				
8800	700	3.40	730	3.60	760	3.80	790	4.00	820	4.20	850	4.40	880	4.70	910	5.20	930	5.45	960	5.75				
9000	710	3.60	740	3.75	770	4.00	800	4.20	830	4.40	860	4.60	890	5.00	920	5.40	940	5.70						
9200	720	3.75	750	3.95	780	4.15	810	4.40	840	4.55	870	4.80	900	5.30	930	5.60								
9400	730	3.90	760	4.10	790	4.35	820	4.55	850	4.70	880	5.00	910	5.50										
9600	740	4.05	770	4.25	800	4.50	830	4.75	860	4.90	890	5.25	920	5.75										
9800	750	4.25	780	4.45	810	4.65	840	4.90	870	5.10	900	5.50												
10,000	760	4.45	790	4.65	825	4.90	850	5.10	880	5.30	910	5.75												*-

NOTE All cfm data is measured external to the unit cabinet with the air filters in place. See Accessory Air Resistance data table.

GCS11-3003 BLOWER PERFORMANCE

Air					***************************************		TATI	C PR	ESSU	RE E	KTERI	IAL I	O UN	iiΤ —	(Inch	es W	ater C	auge)	***************************************			the terminal and the t	
Volume	.2	<u>?</u> 0	.3	0	.4	Ю	.5	Ю	.6	0	.7	0	3.	0	.9	Ю	1.	00	1.2	20	1.:	30	1.	40
(cfm)	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
7000	715	2.35	755	2.60	790	2.85	830	3.15	860	3.55	890	3.90	920	4.30	950	4.65	985	5.00	1020	5.40	1040	5.75	1065	5.90
7200	730	2.60	770	2.80	805	3.10	845	3.40	875	3.80	905	4.20	935	4.55	965	4.90	1000	5.25	1030	5.65	1055	5.90	1080	6.15
7400	745	2.75	785	3.05	820	3.30	855	3.65	890	4.05	920	4.40	950	4.80	980	5.15	1010	5.50	1045	5.90	1070	6.20	1095	6.45
7600	760	3.00	800	3.25	835	3.55	865	3.90	905	4.30	935	4.65	965	5.10	995	5.35	1025	5.70	1060	6.20	1085	6.45	1110	6.70
7800	775	3.15	815	3.45	850	3.75	890	4.20	915	4.45	945	4.85	980	5.30	1010	5.65	1040	6.05	1075	6.45	1100	6.75	1130	7.00
8000	790	3.30	830	3.65	865	4.05	900	4.40	930	4.75	965	5.15	995	5.55	1025	5.95	1050	6.30	1085	6.70	1110	7.05	1140	7.55
8200	810	3.60	845	3.90	880	4.25	915	4.65	940	5.00	980	5.45	1010	5.85	1035	6.20	1060	6.50	1095	7.00	1125	7.40	1150	7.80
8400	825	3.75	860	4.20	895	4.55	925	4.85	960	5.35	1000	5.85	1020	6.10	1050	6.50	1070	6.75	1110	7.25	1135	7.75	1165	8.25
8600	840	4.00	875	4.40	910	4.80	940	5.20	975	5.65	1015	6.10	1035	6.35	1060	6.70	1080	7.00	1120	7.55	1150	8.10	1180	8.50
8800	855	4.25	890	4.65	925	5.10	955	5.50	995	5.95	1025	6.35	1050	6.70	1070	7.00	1085	7.25	1135	8.00	1165	8.50		
9000	870	4.55	905	5.00	935	5.35	970	5.75	1010	6.25	1040	6.65	1060	6.90	1075	7.25	1095	7.50	1145	8.30				
9200	890	4.90	920	5.25	955	5.70	990	6.05	1020	6.45	1050	6.95	1070	7.25	1085	7.50	1110	7.85						
9400	905	5.15	940	5.70	970	6.00	1005	6.45	1040	6.90	1060	7.20	1080	7.60	1100	7.90	1125	8.30						
9600	925	5.50	950	5.90	985	6.30	1020	6.75	1045	7.10	1070	7.50	1085	7.80	1115	8.15	1135	8.65						
9800	935	5.80	965	6.15	1005	6.70	1035	7.10	1060	7.50	1080	7.85	1100	8.20	1130	8.65								
10,000	955	6.20	985	6.55	1020	7.00	1050	7.45	1070	7.80	1090	8.20	1115	8.60										

NOTE - All cfm data is measured external to the unit with the air filter in piace. See Accessory Air Resistance data table.

CEILING DIFFUSER AIR THROW DATA

***************************************	Air	*Effective Throw R	ange (feet)
Model	Volume (cfm)	RTD11 Step Down	FD11 Flush
3	8000	39 – 44	53 — 62
GCS11-2753 GCS11-3003	9000	47 — 56	55 — 64
	10,000	49 — 58	57 — 67

^{*}Throw is the horizontal or vertical distance an air stream travels on leaving the outlet of diffuser before the maximum velocity is reduced to 50 ft. per minute.

POWER EXHAUST FANS PERFORMANCE GCS11-2753 AND GCS11-3003


Air Volume (Cfm Exhausted)	Return Air System Static Pressure (Inches Water Gauge)
7050	0
6550	.05
6100	.10
5600	.15
5100	.20
4600	.25

BLOWER DATA

ACCESSORY AIR RESISTANCE

		T.	otal Air Resist	ance (inches v	vater gauge)	
Model	Air Volume	REMD11M		RTD11 Diffuse	r	FD11
No.	(cfm)	Economizer Dampers	2 Sides Open	3 Sides Open	4 Sides Open	Diffuser
***************************************	7000	.033	.42	.34	.31	.36
j	7200	.035	.45	.37	.32	.38
	7400	.036	.48	.39	.35	.40
1	7600	.038	.51	.42	.37	.43
	7800	.039	.55	.46	.40	.47
1	8000	.041	.58	.49	.43	.48
1	8200	.043	.63	.53	.46	.53
GCS11-2753	8400	.045	.67	.56	.49	.56
GCS11-3003	8600	.047	.71	.60	.52	.59
İ	8800	.048	.73	.63	.55	.63
	9000	.050	.79	.67	.58	.66
	9200	.052	.84	.70	.61	.69
]	9400	.054	.87	.73	.64	.72
	9600	.055	.92	.77	.67	.75
	9800	.057	.96	.81	.70	.78
	10,000	.059	1.00	.84	.73	.81

COMBINATION CEILING SUPPLY AND RETURN AIR DIFFUSERS DIMENSIONS (inches)

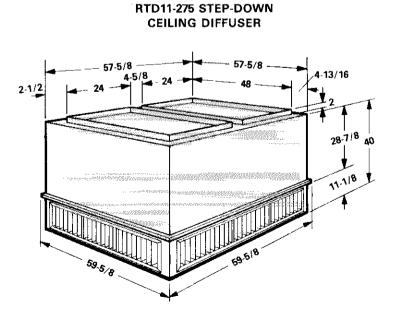

2-1/2 24 45/8 24 48 4-13/16 36-1/8 59-5/8

FD11-275 FLUSH

CEILING DIFFUSER


DIMENSIONS (inches)

CORNER WEIGHTS (Ibs.)


Model No.		Α	8	С	D
GCS11-2753 GCS11-3003	Basic Unit	836	785	716	763
	With Economizer	925	824	773	868
	With Economizer/Exhaust Fans	952	848	820	920

CENTER OF GRAVITY (in.)

Model No.		E	F
GCS11-2753 GCS11-3003	Basic Unit	37-3/4	67-3/4
	With Economizer	36-3/4	68-3/4
	With Economizer/Exhaust Fans	36-3/4	69-3/4

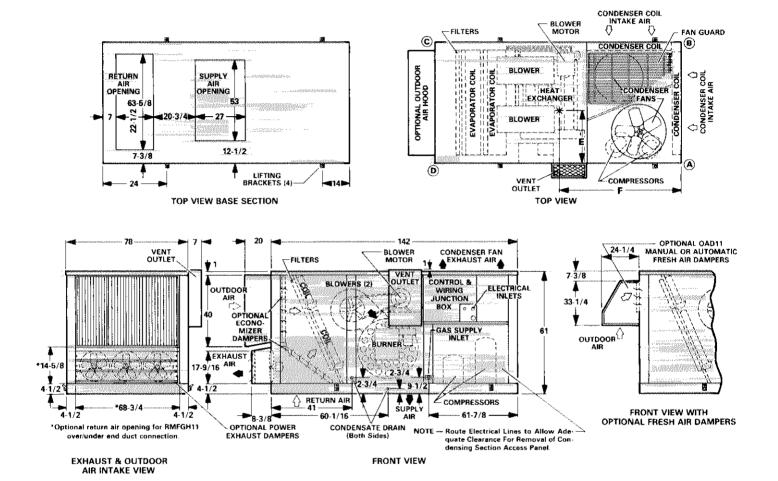

INSTALLATION CLEARANCES (inches)

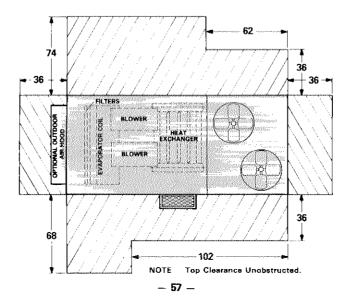


TYPICAL FLASHING DETAIL FOR RMF11 ROOF MOUNTING FRAME

ROOF MOUNTING FRAME SPECIFICATIONS

Roof Mounting frame is rigid enough to be spanned over its entire length or cantilevered if supported on either side of the center of gravity.


Mounting Frame Height	RMF11	RMFH11	
*Frame moment of inertia (I) (in.4)	92	660	
*Frame section modulus $\frac{1}{C}$ (in.3)	11.8	42.7	
Mounting frame weight (lb./foot of length)	9.8	13.5	
Mounting frame design strength (psi)	20,000	20,000	

[&]quot;Includes both sides of frame.




DIMENSIONS (inches)

RMF11-275 ROOF MOUNTING FRAME WITH DOUBLE DUCT OPENING

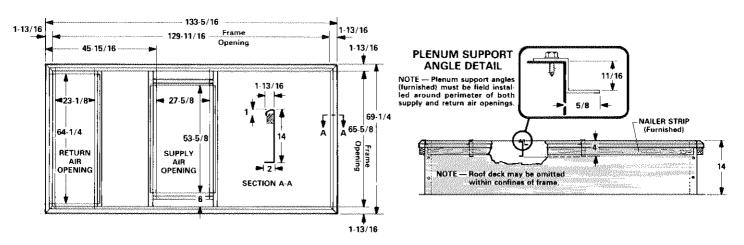


RMF11-275 ROOF MOUNTING FRAME WITH SRT11-275 SUPPLY AND RETURN TRANSITIONS FOR FD11 & RTD11-275 DIFFUSERS

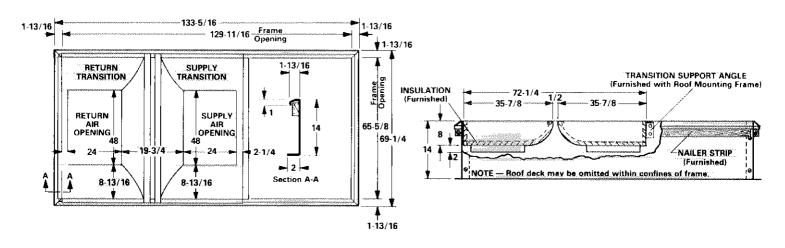


DIMENSIONS (inches)

RMFH11-275 HORIZONTAL ROOF MOUNTING FRAME

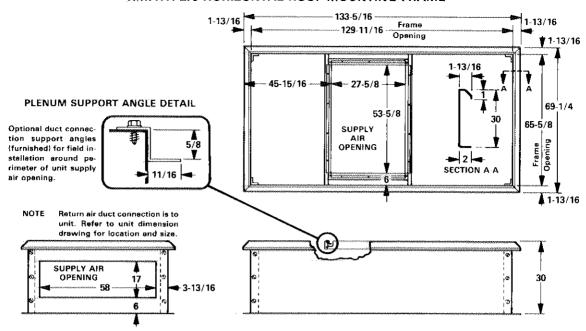


RMFA11-275 ADAPTER ROOF MOUNTING FRAME

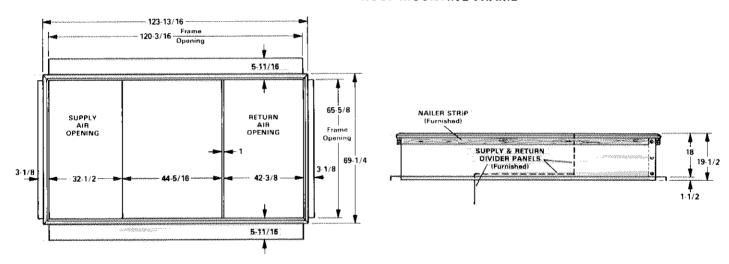

TYPICAL FLASHING DETAIL FOR RMFA11 WITH RMF3 ROOF MOUNTING FRAME

RMFA11 ADAPTER ROOF MOUNTING FRAME WITH RMF3 ROOF MOUNTING FRAME

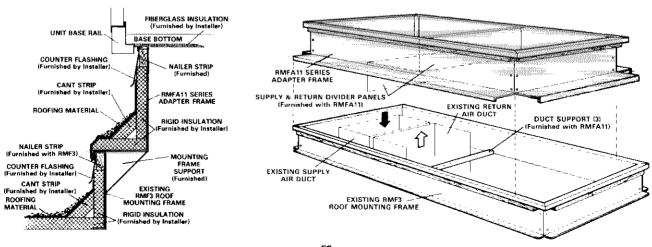

GUIDE SPECIFICATIONS

Prepared for the guidance of architects, consulting engineers and mechanical contractors.

General — Furnish and install a single package combination air to air DX mechanical cooling system and gas fired heating system, complete with automatic controls. The single package unit shall be a standard product of a firm regularly engaged in the manufacture of heating-cooling equipment. The manufacturer shall have parts and service available throughout the United States.

The installed weight shall not be more than lbs. Entire unit shall have a width of not more than inches, a depth of not more than inches and an overall height of not more than inches. The equipment shall be shipped completely factory assembled, precharged, piped and wired internally ready for field connections. In addition, manufacturer shall test operate system at the factory before shipment.

Air Distribution — Equipment shall be capable of bottom or end (horizontal) handling of conditioned air. All air distribution ducts shall be fiberglass or ga. galvanized steel insulated with inch thick lb. density fiberglass or equivalent.

Approvals — All electrical components shall have U.L. Listing. All wiring shall be in compliance with NEC.

Equipment Warranty — Heat exchangers have a limited warranty for a full ten years. Compressors have a limited warranty for a full five years. All other components have a limited warranty for one year. Refer to the Lennox Equipment Limited Warranty certificate included with the unit for details.

The coils shall be non-ferrous construction with aluminum fins mechanically bonded to durable copper tubes. Coils shall be pressure leak tested. Coil face area shall be not less than sq. ft. (evaporator) and sq. ft. (condenser).

Dual compressors shall be resiliently mounted, have overload protection, internal pressure relief and crankcase heater. The refrigeration system shall have suction and liquid line service gauge ports, sight glasses, high pressure switches, loss of charge switches, driers and full refrigerant charge. Control option available shall consist of low ambient control and timed off control. GCS11-2753 shall be rated in accordance with ARI Standard 360-86. GCS11-3003 shall be rated at ARI Standard 360 test conditions.

Heating System — The heating capacity output shall be Btuh with a gas input of Btuh.

Automatic controls furnished as standard equipment shall give single stage or two stage operation. Cylindrical drum and tube heat exchanger shall be constructed of aluminized steel. Combination stainless and aluminized steel power burner shall have prepurge, electric spark ignition, 100% safety shutoff controls, electronic flame sensing controls, series gas valves and limit controls. Staging control shall be with separate gas valves. All controls shall be listed for operation at low outdoor air temperatures. Burner shall be equipped with inspection window and air shutter for combustion air adjustment. Complete service access shall be provided for controls and wiring. Shall be A.G.A. certified for outdoor installation.

Cabinet — Shall be galvanized steel with a paint finish of powder enamel. Cabinet panels where conditioned air is handled shall be fully insulated to prevent sweating and minimize sound. Openings shall be provided for power connection entry. Base shall have drainage holes. Lifting lugs shall be provided for rigging.

Service Access — All components, wiring and inspection areas shall be completely accessible through removable panels.

Condenser Fans — Twin propeller type condenser fans shall discharge vertically and be direct driven by a hp motor. Fan motor shall be totally enclosed with ball bearings, permanently lubricated, inherently protected and equipped with rain shield. Fan shall have a safety guard.

Air Filters — 1" thick disposable frame type fiberglass media filters shall have not less than sq. ft. of free area.

OPTIONAL ACCESSORIES

Roof Mounting Frame — Furnish and install a steel roof mounting frame for bottom or horizontal discharge and return air duct connection. It shall mate to the bottom perimeter of the equipment. When flashed into the roof it shall make a unit mounting curb and provide weatherproof duct connection and entry into the conditioned area. Flashing shall be the responsibility of a roofing contractor. Frame shall be approved by National Roofing Contractors Association.

Economizer Dampers — Furnish and install complete with controls an optional mechanically linked air mixing damper assembly including outdoor air and recirculated air dampers. The assembly shall mount within the confines of the unit cabinet and provide for the introduction of outside air for minimum ventilation and free cooling. Outdoor air hood shall mount external to the unit cabinet. Damper motor shall be 24 volt, fully modulating spring return. Controls shall include electronic discharge air sensor, minimum position potentiometer, and solid-state adjustable outdoor air enthalpy control. Control option shall consist of differential enthalpy control (return air sensor).

Fresh Air Dampers — Outdoor air damper section shall control outdoor air requirements and be available for manual or automatic operation. Dampers shall be adjustable for air quantities up to 25%. Shall include cleanable air filter.

Gravity Exhaust Air Dampers — Pressure operated dampers shall install within the unit. Damper blades shall ride in nylon bearings and be gasketed for tight seal and quiet operation.

Power Exhaust Air Dampers — Direct drive propeller type fans shall exhaust air through pressure relief dampers. Motors shall be overload protected. Pressure operated dampers shall install within the unit and prevent blow back and outdoor air infiltration during the fan off cycle. Damper blades shall ride in nylon bearings and be gasketed for tight seal and quiet operation.

Ceiling Diffusers — Furnish and install a (flush or stepdown) optional combination ceiling supply and return air diffuser. It shall be capable of not less than ft. radius of effective throw. Supply and return transitions shall be available, for field installation in the roof mounting frame, to provide duct connection to the diffuser.

Remote Status Panel — Shall be available for installation within the conditioned area to observe equipment operation. The panel shall include signal lights for Cool Mode, Heat Mode, Compressor 1, Compressor 2, No Heat and Filter.

Remote Switching Status Panel — Shall be available for installation within the conditioned area to control and observe equipment operation. The panel shall include signal lights for Cool Mode, Heat Mode, Compressor 1, Compressor 2, No Heat and Filter. System selector switch and fan switch shall provide operational mode and blower operation. After hours timer switch shall override night setback controls and provide normal operation for time period set.

Control Systems — Shall provide a selection of optional thermostats and related controls to automatically operate the mechanical equipment through the heating or cooling and ventilating cycles as required.